



Signage Standards and Guidelines

Interior Sign System

Updated December 19, 2024

Page/

TABLE OF CONTENTS

SHEET #	SIGN TYPE / SHEET DISCRPTION
SG.001	TABLE OF CONTENTS
SG.002	PROJECT SYMBOLS & LOGOS
SG.003	PROJECT COLORS, FINISHES & TYPEFACE
SG.004-011	SPECIFICATION 10 400
SG. 1	IA1_VINYL_CLEAR GLASS_DOUBLE DOOR
SG. 2	IA1.1_VINYL_TINTED GLASS_DOUBLE DOOR
SG. 3	IB1_DEPARTMENT ID
SG. 4	IC1_FLOOR MOUNTED DIRECTORY
SG. 4.1	IC1.1_FREE STANDING DIRECTORY
SG. 5	IC2_WALL MOUNTED DIRECTORY_ALT LAYOUT
SG. 6	IC2.1_DEPARTMENT WALL MOUNTED DIRECTORY
SG. 7	IC3_DORMITORY WALL MOUNTED FLOORPLAN DIRECTORY
SG. 8	ID1_DIRECTIONAL SIGN - WALL MOUNTED
SG. 9	ID1.1_DIRECTIONAL SIGN - WALL MOUNTED_ALT LAYOUT
SG. 10	ID2_DIRECTIONAL SIGN - OVERHEAD
SG. 11	IE1_ADA PLAQUE - ROOM NAME SIGN TYPE 1
SG. 11.1	IE1.1_ADA PLAQUE - ROOM NAME SIGN WITH ADD. MESSAGES
SG. 11.2	IE1.2_ADA PLAQUE - ROOM NAME SIGN TYPE 2
SG. 11.3	IE1.3_ADA PLAQUE - ROOM NAME SIGN TYPE 3
SG. 12	IE2_ADA PLAQUE - MEETING
SG. 13	IE3_ADA PLAQUE - CHANGEABLE INSERT
SG.13.1	IE3_ADA PLAQUE - CHANGEABLE INSERT_ALT LAYOUT
SG.13.2	IE3.1_ADA PLAQUE - CHANGEABLE INSERT_NO OVERHANG
SG. 14	IF1_ADA PLAQUE - PICTOGRAM
SG. 14.1	IF1_ADA PLAQUE - PICTOGRAM WITH INSERT
SG. 15	IF2_FLAG SIGN
SG. 16	IG_STAIRWELL SIGN
SG. 17	II_ELEVATOR WARNING - IN CASE OF FIRE
SG. 18	IK_WARNING SIGN
SG. 18.1	IK1_WARNING SIGN MD
SG. 18.2	IK2_WARNING SIGN LG
SG. 19	IH_LAB SAFETY WARNING
SG. 19.1	IH.2_EHS LAB SAFETY WARNING
SG.19.2	IH.3_ROOM SCHEDULE



Page Southerland Page Architects, P.C.
 100 Peachtree Street, NW
 Mezzanine
 Atlanta, GA 30303
 pagethink.com
 TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
 Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
 Denver / Dubai / Houston / Los Angeles / Mexico City /
 Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

Table of Contents

DRAWING SHEET

SG.001

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB

File Path:
 Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021



1 Project Arrow (Use arrows only in the configurations above)
 SG.002 SCALE: NTS



2 Project Pictograms
 SG.002 SCALE: NTS



3 Project Logo 1 - Standard Logo
 SG.002 SCALE: NTS



4 Project Logo 2 - Horizontal Lock-Up
 SG.002 SCALE: NTS



5 Project Logo 3 - Vertical Lock-Up
 SG.002 SCALE: NTS

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE






Project Symbols & Logos

DRAWING SHEET

SG.002



Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB

P PAINT COPY COLOR SPECIFICATIONS

 P1 ROWMARK CHARCOAL GRAY 311307V	 P2 APCO A02 BLACK	 P3 COLOR TO MATCH PMS 540 C	 P5 Paint to match Matthews Brushed Aluminum	 P6 Paint to match APCO A01 WHITE
---	--	--	---	---

1 Paint Color Specifications
SG.004 SCALE: NTS

C PRINT COPY COLOR SPECIFICATIONS

 C1 C 0 M 0 Y 0 K 80	 C2 C 0 M 0 Y 0 K 100	 C3 COLOR TO MATCH PMS 7462 C	 C4 C 0 M 100 Y 100 K 0
--	---	--	---

2 Print Copy Color Specifications
SG.004 SCALE: NTS

M MATERIALS & FINISHES

 M1 3M OPAQUE GRAPHIC FILMS MATTE WHITE 7725-20, 7125-20	 M2 3M OPAQUE GRAPHIC FILMS INTENSE BLUE 7725-47, 7125-47	 M3 APCO ACRYLIC A01 WHITE	 M4 NATURAL SATIN ALUMINUM	 M5 3M TRANSLUCENT GRAPHIC FILMS DUSTED CRYSTAL 7725SE-314	 M6 Insert Paper APCO A72 BONE WHITE A00 WHITE ON REVERSE or EQUIVALENT
--	---	--	--	--	---

3 Materials and Finishes
SG.004 SCALE: NTS

**ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz 1234567890**

T1 DIN 2014 Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz 1234567890

T2 DIN 2014 Regular

4 Project Typeface(s)
SG.004

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz 1234567890

T3 DIN 2014 Demi

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

**Project Colors, Finishes
& Typeface**

DRAWING SHEET

SG.003

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

SECTION 10400 - SPECIFICATIONS

PART 1 GENERAL

1.1 RELATED DOCUMENTS:

Drawings and general provisions of Contract or purchase agreement, including General and Supplementary Conditions and Division 1 Specifications sections (Refer to architectural specifications and contract requirements for this project which are part of the architectural construction documents), apply to this section. The work covered in this section consists of providing signs and graphics as shown in the drawings or where scheduled and comprising the interior and exterior sign systems. Contract Documents consist of the drawings, including any supplementary engineering drawings, specific product/manufacturer drawings, the sign locations plans, and the message schedule adjoining this specification section 10400. Any general provisions of Contract, including General and Supplementary Conditions, Division 1 Specifications sections, as applicable to this section, would also be considered as part of the contract documents.

1.2 PROPRIETARY RIGHTS:

All proprietary rights in the subject matter of the material in the ac-companying drawings, descriptions and specifications, and rights to the material itself are reserved to the submitter's use. Reproduction, loaning or transmitting of the descriptions, specifications or drawings without consent in writing of the Architect is not permitted. Acceptance of the specifications and drawings denotes acceptance of these conditions.

1.3 SUBMITTALS:

The following outlines submittal requirements unique to this section of the work, especially shop drawing content and samples: Other requirements from Division 1, Shop Drawings and Submittals section would apply (Refer to architectural specifications and contract requirements for this project which are part of the architectural construction documents).

A. Shop drawings:

1. Submit complete shop drawings for manufactured and fabricated items. Indicate materials, layouts, sizes, methods, finishes, footings and anchorage devices, connections and other details of construction, as well as the relation to supporting and adjacent work where applicable. Identify coatings on the shop drawings along with the method of application. Create and confirm layout conditions not shown on the contract documents.
 - a. Identify all pre-fabricated products proposed for use.
 - b. Indicate manufacturer, brand name, quality and type coating for each surface to be finished or refinished.
 - c. Submit complete shop drawings and erection drawings conforming to all current applicable industry standards and local codes. Preparation of shop drawings shall not be sublet without the written permission of Owner. A message schedule and sign layouts with messages is required
 - d. After award of contract, but prior to the beginning of detailed shop drawings, submit drawings showing typical details of connections. The Contractor shall arrange to meet with Architect and Owner's representative approximately one (1) week after submittal to review drawings and coordinate comments. The typical details as accepted shall be used to control detail design, shop drawing preparation and approval.
 - e. The Contractor shall submit drawings of sign connections and suspension details; computations shall be prepared and checked by a Registered

Professional Engineer in Georgia covering all members, connections (welds, bolts, etc.) and footings, indicating such meets the Design Specifications for Sign Structures stress requirements and dead load deflection tolerances, design computations and drawing accuracy.

- f. Specify procedures for the relocation and refinishing of any existing elements and provide a schedule or clearly outlined plan for the logistics associated with these operations.

B. Samples: Submit four samples of each of the following, unless otherwise specified:

1. Finishes:

- a. Submit 4" x 4" samples of each finish specified, this includes those used in re-finishing on site or off site as well as new finishes applied in the shop.
- b. Surface-applied graphics shall be on actual substrate upon which they will appear, thus vinyl materials shall be applied appropriately to both painted and other vinyl backgrounds as specified in the drawings.
- c. Hardware items: Submit samples of each type of anchor, insert or other fastener to be used, these will be returned to Contractor.

C. Prototypes: Submit for review, approval and demonstration of representative craftsmanship one sign unit (or partial sign as indicated) of the following sign types, to be reviewed and retained for comparison at [Insert Name] General Contractor Job Trailer:

1. [To be determined based on project need]
2. [To be determined based on project need]
3. [To be determined based on project need]
4. [To be determined based on project need]
5. [To be determined based on project need]

Prototype samples shall be retained as control samples. Written approvals or comments shall be furnished

D. Maintenance data: Submit maintenance recommendations and instructions for each material used as part of contract close-out. Include recommendations for cleaning procedures, intervals and touch-ups.

E. Scheduling: Submit the final schedule for construction work and installation within ten (10) days of sample approvals. Indicate dates of completion for prototypical units for approval, dates of partial deliveries and total completion. Dates given shall be consistent with the time requirements submitted with the bid.

1.4 DELIVERY, STORAGE AND HANDLING

- A. Store materials where directed by Owner or owner's representative.
- B. Maintain neat, clean conditions in all building areas; remove trash, rags and waste materials at end of each day's work. Protect the floor and wall surfaces of this space against damage or defacement.
- C. Close any open containers at the end of day's work. Leave no materials open.
- D. Acrylic and other glazing materials or finish materials with or requiring protective wrapping shall only have this protection removed as required during fabrication and installation and



Page Southerland Page Architects, P.C.
100 Peachtree Street, NW
Mezzanine
Atlanta, GA 30303
pagethink.com
TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
Denver / Dubai / Houston / Los Angeles / Mexico City /
Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.004

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

once the area is clear of work or activities which might cause damage to the installed work. Care shall be taken in handling surfaces and products to prevent scratching, chipping, or cracking.

- E. Protection: Cover finished work of other trades and/or the existing property of the Owner and/or pre-finished items and surfaces.
- F. Store materials a minimum of 4" above ground on framework or blocking and cover with protective waterproof covering. Provide air circulation and ventilation. Store in dry, conditioned space.

1.5 QUALITY CRITERIA

- A. Acceptable fabricators shall meet the following criteria:
 - 1. Sign contractors and/or subcontractors shall have been regularly engaged in the manufacture, fabrication and installation of sign systems of comparable scope and quality for a minimum of five (5) years and shall have completed at least one project of similar scope and complexity in the last three years.
 - 2. Sign contractors and/or subcontractors shall submit a minimum of five (5) references listing project type, scope of work, Owner and date of completion, Owner's address and telephone number.
 - 3. Sign contractors and/or subcontractors shall submit one (1) set of shop drawings as a representative sample of those prepared for a previous project.
- B. Welders' qualifications:
 - 1. Welders, welding operators and tackers shall be qualified by tests in accordance with the American Welding Society (AWS) Code by an independent agency. Any welder, welding operator or tacker who has not used the process for which he has been qualified for over six (6) months shall be re-qualified.
- C. Industry segments: Where referenced in this section, the work shall comply with the requirements of the following standard specifications, unless otherwise specified.
 - 1. Aluminum Association (AA): "Standards for Aluminum Mill Products," "Designation System for Aluminum Finishes," and "Standard for Anodically Coated Aluminum Alloy for Architectural Applications."
 - 2. American Iron and Steel Institute (AISI).
 - 3. American National Standards Institute (ANSI)
 - 4. American Society for Testing Materials (ASTM)
 - 5. American Welding Society (AWS) "Recommended Practice for Resistance Welding," and "Structural Welding Code."
 - 6. Americans with Disabilities Act (ADA) Design Guidelines (ADADG)
 - 7. Concrete Reinforcing Steel Institute (CRSI)
 - 8. National Association of Architectural Metal Manufacturer (NAAMM) "Metal Bar Grading Manual," including Standard Specification, and "Metal Finishes Manual."

1.6 JOB CONDITIONS

- A. Field measurements: Take field measurements to ascertain exact sizes before fabrication. Indicate exact dimensions on shop drawings. Field verify all locations

specified by the drawings or any condition considered questionable, unclear or not drawn to scale.

- B. **Field verification for underground utilities and any additional obstructions must occur prior to fabrication and installation.**
- C. Environmental requirements:
 - 1. Comply with manufacturer's recommendations regarding environmental conditions under which materials may be applied.
 - 2. Apply no adhesive or coating materials in spaces where dust is being generated.
- D. Coordination: Coordinate work with the Owner and the work of other sections of the specifications to ensure that surfaces to receive signs are properly completed, inspected, and approved prior to commencement of work. Commencement of work in any space shall constitute acceptance by the Contractor of surfaces to receive identifying devices.

1.7 WARRANTIES

- A. Warrant the joints in laminated constructions for a period of five (5) years from Date of Substantial Completion against failure or delamination.
- B. Warrant all room signs for a period of five (5) years from Date of Substantial Completion against discoloration and delamination of any portion of the sign.
- C. Warrant vinyl film for a period of five (7) years from Date of Substantial Completion against delamination from the substrate.
- D. Warrant raised letters for a period of five (5) years from Date of Substantial Completion against delamination from the substrate.
- E. Paints or inks and finishes shall be guaranteed not to cause discoloration, deterioration, or delamination of any materials used in fabrication. Warrant paint finishes for a period of five years from the date of substantial completion.
- F. Warranty Provisions: During the warranty period, restore defective work to the standard of the contract documents without cost to the Owner, including all labor, materials, refinishing and all costs incidental to the work.
- G. Warrant all electrical components and signs for a period of at least one year, parts and labor, or greater if stipulated elsewhere in the specification section for electrical work.

1.8 GRAPHICS, ARTWORK AND ELECTRONIC FILES:

The designer and consultants shall only furnish artwork in an electronic form if it already exists or was created in that form during the course of designing the project. Formats for graphic designs shall be in that of its original creation and may be manual or photo-mechanical or electronic/digital, and if digital, are likely to have been prepared in graphic design industry standard computer software. Contract document drawings or layouts for the work shall not be transferred or transmitted electronically to the contractor for purposes of creating shop drawings or for fabrication.

PART 2 PRODUCTS

2.1 ADA SIGNAGE COMPONENTS

- A. ADA Panels:
BASE OPTION (As noted in the design drawings.)



Page Southerland Page Architects, P.C.
100 Peachtree Street, NW
Mezzanine
Atlanta, GA 30303
pagethink.com
TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
Denver / Dubai / Houston / Los Angeles / Mexico City /
Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.005

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

1. Material: Provide horizontally brushed finish 1/8" Aluminum panels with 1-ply, 1/32" profile acrylic material chemically bonded to aluminum to create tactile copy and pictograms to be applied to aluminum panel. Use Raster method patented process for placing Braille dots on aluminum panel; computer engineered, using special carbide engraving bit, press-fit tool with vacuum pump, and stainless-steel Rasters.
2. Finish: Paint components per design drawings and clear coat per these specifications (Section 2.7)

B. ADA Panels:

ALTERNATE OPTION (As noted in the design drawings.)

1. Material: Provide tactile copy and Grade 2 Braille raised 1/32 inch minimum from plaque first surface by manufacturer's phenolic photopolymer bonded process. Signface of single material, tactile characters and Braille integral to phenolic substrate. Adhesive-fixed characters are not acceptable.
2. Finish: Paint to match colors specified, per manufacturer's standard for phenolic backed photopolymer material.
3. Finish: Paint per design drawings and clear coat per these specifications (Section 2.7).

2.2 PLASTICS

- A. This Section includes the Plastic Fabrication as shown and specified in the described system(s):
 1. Signage
- B. The extent of Solid Polymer Fabrication is shown on the drawings.
 1. Additional fabrication and installation details can be found on the 3Form Partner Preliminary Project Review, if applicable.

2.3 SUBMITTALS

- A. General: Submit the following in accordance with conditions of contact and Division 1 specification section 01 33 00 "Submittal Procedures".
- B. Product Data: Submit manufacturer's product data; include product description, fabrication information, and compliance with specified performance requirements.
- C. Submit product test reports from a qualified independent 3rd party testing agency indicating each type and class of panel system complies with the project performance requirements, based on comprehensive testing of current products. Previously completed test reports will be acceptable for current manufacturer and indicative of products used on this project.
 1. Test reports required are:
 - a. Rate of Burning (ASTM D 635)
 - b. Self-Ignition Temperature (ASTM D 1929)
 - c. Density of Smoke (ASTM D 2843)

2.4 QUALITY ASSURANCE

A. Manufacturers Qualifications

1. Materials and systems shall be manufactured by a company continuously and regularly employed in the manufacture of specified materials for a period of at least three (3) consecutive years and which can show evidence of those materials being satisfactorily used on at least three (3) projects of similar size, scope and location. At least one (1) of the projects shall have been successful for use one year or longer.
2. Manufacturer must offer a documented reclaim process that will take back, at the manufacturers cost, panels that are at their end-of-life cycle. Return process is preceded by following requirements highlighted in Section 02 42 00 Removal and Salvage of Construction Materials.
3. Manufacturer must have documented training and qualification

2.5 FABRICATION - GENERAL NOTES

- A. General: Comply with requirements indicated for materials, thicknesses, finishes, colors, designs, shapes, sizes, attachment methods, chassis specifications and details of construction.
- B. Clear Protective Finish: All signs, unless noted otherwise on design drawings, will have a satin clear coat applied over the paint color. For interior ADA signs, this clear coat shall cover all tactile copy and braille. Clear coat shall be compatible with paints. Refer to Section "2.7 Coatings, paragraph L".
- C. Preassemble: Preassemble signs in the shop to the greatest extent possible to minimize field assembly. Disassemble signs only as necessary for shipping and handling limitations. Clearly mark units for reassembly and installation, in a location not exposed to view after inal assembly.
- D. No Visible Fasteners: Conceal fasteners if possible; otherwise, locate fasteners to appear inconspicuous. Fasteners should not appear on the face of a sign, unless this is documented with an approved shop drawing. Fasteners should be located on sign returns whenever possible if they cannot be concealed. If fasteners are visible, detail on shop drawing submittal for review and approval prior to fabrication.
- E. Countersink Fasteners: Any exposed fasteners shall be countersunk, flush with surrounding area. If this is not possible, detail on shop drawing for review and approval prior to fabrication.
- F. Paint Exposed Fasteners: Always paint any exposed or visible fasteners to match the surrounding sign material finish.
- G. Form Panels to Required Size and Shape: Comply with requirements indicated for design, dimensions, finish, color, and details of construction.
- H. Joints and Seams: Coordinate dimensions and attachment methods to produce sign panels with closely fitting joints. Align edges and surfaces with one another in the relationship indicated.
- I. Welds: Ensure welded joints are smoothed and any gaps are filled and smoothed prior to finishing.

2.6 ACCESSORIES:

- A. Adhesive tape:



Page Southerland Page Architects, P.C.
 100 Peachtree Street, NW
 Mezzanine
 Atlanta, GA 30303
 pagethink.com
 TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
 Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
 Denver / Dubai / Houston / Los Angeles / Mexico City /
 Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.006

Principal-In-Charge:
David Deis
 Project Manager:
CB/PN
 EGD Designers:
CB
 Drawn by:
CB
 File Path:
Y:\PROJ\ATL14\X24\XXX\14AC2400\3_Design\14_Graphics_Branding
 W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

1. Clear, acrylic adhesive transfer tape, very high bond.
2. Thickness shall be required to achieve maximum adhesion with minimum visibility. Follow manufacturer's instructions/recommendations for the application of tapes, pressures applied, and selection of correct adhesive formulation.
3. Use clear adhesive silicone as supportive attachment in cases where tape will not provide adequate adhesion, particularly rough surfaces.

B. Anchors and fasteners:

1. Anchors, inserts or fasteners shall be compatible with sign materials, shall not result in galvanic action or chemical interaction of adhesives and shall have demonstrable and sufficient strength for intended use.
2. Anchors and fastenings for aluminum shall be stainless steel, zinc or cadmium coated steel. Anchors and fasteners shall be concealed where possible. Indicate locations on shop drawings.
3. Anchors and fastenings for exterior use shall be galvanized steel in accordance with ASTM A153-82.
4. Wherever possible, anchors to concrete and masonry shall be cast-in-place. Use expansion shields where anchors cannot be located before concrete is poured.
5. Fasteners to solid masonry and concrete shall be one of the following:
 - a. flat-head drop-in expansion bolts.
 - b. Powder-actuated fasteners; appropriate size drive pin for concrete and for masonry.
 - c. Fasteners to cells of hollow masonry shall be drive pins of the appropriate size.
 - d. Fasteners to roll or formed steel members shall be powder-actuated fasteners of the appropriate size.
 - e. Fasteners to metal deck shall be self-drilling, self-tapping screws.
 - f. Expansion shields shall be machine bolt type, tubular type, or self-drilling tubular type.
6. Anchor bolts for wood blocking to concrete and masonry shall be the appropriate size steel for masonry, unless otherwise noted, and provided with washer and nut at both ends.
7. Anchor bolts for wood blocking to steel members shall be appropriate size steel and provided with washer and nut.
8. Provide miscellaneous anchors and fasteners as required to secure work in place.
9. Versilok® brand (mfr.: Parker US Adhesives) or an approved equal shall be used as a structural adhesive for aluminum and may be employed in the concealed fastening of components for signs. Follow manufacturer's instructions for the correct formulation, preparation and procedures.

D. Non-shrink grout:

1. Non-shrink Grout: Use a premixed, factory-packaged, non-staining, non-corrosive, non-gaseous grout specifically recommended by manufacturer for applications

such as those in this project.

2. Place grout under bearing surfaces after they have been aligned and leveled. Completely fill space so as to give full and even bearing. Prepare concrete surfaces, mix and apply grout and cure in accordance with the grout manufacturer's printed instructions for the purpose intended.

2.7 COATINGS (PAINTS):

- A. Acceptable manufacturer:** Except as otherwise noted, products specified as a standard of quality in the industry of manufacturing and fabricating signage shall be those manufactured by Matthews Paint Company, an acrylic polyurethane, UltraLow (<50g/L) VOC and lead-free coating system (or equal).

B. Miscellaneous materials:

1. Paint thinners and tints shall be products of same manufacturer as paints or approved by manufacturer for use with their products.
2. Shellac, turpentine, patching compounds and similar materials required for execution of work shall be pure, best quality products.
3. As required by governing law, compounds used in finishing products shall be free of Volatile Organic Compounds (VOCs) and meet all environmental requirements for manufacture, handling, application and disposal of materials.

- C. Colors:** Sign colors shall match approved samples and shall be exactly as specified in unit descriptions. Sign colors shall be consistent in chroma and value, shall maintain proper opacity or translucency and shall be free of all imperfections.

- D. Finishes:** Sign finish shall be satin and not exceed 15 degrees of gloss for all ADA compliant signage. All other sign finishes shall be satin unless noted otherwise in design drawings. Sign finish shall be smooth and free of all imperfections.

- E. Paint selection:** Paints and inks required shall be made for the surface material on which they are to be applied and as recommended by the manufacturer of the paint or ink. Exact identification of paint and ink shall be noted on the shop drawings with method of application. Prime coats or other surface pre-treatments, where recommended, shall be included in the work. Select sign paint finishes for durability and resistance to graffiti.

F. Preparation:

1. Surfaces to receive finishes shall be free of debris, oils, dust or other deleterious materials.
2. Previously painted masonry:
 - a. Where existing paint is loose or blistered, remove by scraping
 - b. Remove debris and chalking from surfaces after scraping, by washing with detergent and water. Flush with clean water.
3. Galvanized metals: Wash with an appropriate solvent to remove grease, oil and contaminants. Wipe dry with clean cloth.
4. Ferrous metals: Prepare surface by removing loose mill scale, rust, accessible slag or flux deposit, dirt or any foreign matter by power brushing. Remove oil and grease deposits by solvent.
5. Aluminum:

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.007

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

- a. Sand or scrape to remove oxide.
- b. Remove grease and soil in a solution of detergent.
- c. Etch surface of aluminum in a sodium hydroxide solution 4 to 5 ounces per gallon at 60 C for 6 minutes.
- d. Deoxidize in a nitric oxide base chromate solution at room temperature. Vary time according to type of aluminum alloy used.
- e. At room temperature, rinse in clear running water between each step above.
- f. Apply appropriate aluminum compatible primer.
- g. Paint surface as soon as possible after drying.

G. Application:

1. Apply paint, sealers and spackles only when moisture content of surfaces is 12% or less for interior wood.
2. Apply paint when the relative humidity is below 85% and ambient temperature is above 55 F.
3. Apply paint materials using clean brushes, rollers or spraying equipment.
4. In general, paint application shall be by brush or airless spray. Paint applications by brushing shall be free of objectionable brush marks. All applications must meet approval of the Architect with representative sample submittals.
5. Apply materials at rate stated on label placed on can by paint manufacturer for the type of surface being painted.
6. Comply with manufacturer's recommendations for drying time between coats.
7. Sand and dust between coats to remove defects visible from a distance of 3'-0".
8. Finish coats shall be smooth, free of brush marks, streaks, laps or pile-up of paint.
9. Make edges of paint adjoining other materials or colors clean and sharp without overlapping.
10. Primer coats may be omitted for surfaces specified to receive factory applied primer if primer is compatible with finish coats. If a primer coat is not compatible, substitute a bond coat as recommended by paint manufacturer for specified primer coat.
11. Primer coats may be omitted for surfaces previously painted only if existing paint is compatible with specified new paint.
12. Contractor shall be responsible for application of any additional coats necessary to achieve required coverage and color uniformity.
13. All acrylic paints shall be 100% acrylic resins.

H. Enamels:

1. Air dried enamel finish shall have a minimum coating thickness of 1.5 mils and show no corrosion when tested in accordance with salt spray test, federal test method no. 151, for 96 hours. Finished work shall be smooth and free of imperfections.

2. Baked enamel finish shall have minimum coating thickness of 1.5 mils and show no corrosion when tested in accordance with salt spray test, federal test method no. 151, for 96 hours.

I. Urethane Paint on Aluminum:

1. Aluminum shall be pre-treated as recommended by the paint manufacturer, including:
 - a. degreasing process and rinse.
 - b. chemical etching process and rinse.
 - c. deoxidizing process and rinse.
 - d. compatible priming process, rinse and dry.
2. Prime surfaces with the manufacturer's recommended primer.
3. Apply paint at the rate of 2.5 mils per coat by air or airless spray, brush or roller. Coating shall be even and free from any marks or streaks.

J. Ferrous Metal:

1. Ferrous metal items, except items to be encased in concrete and areas adjacent to field welds, shall be thoroughly cleaned.
2. After cleaning, give the surface one shop coat of an industry standard primer paint. Apply thoroughly and evenly to a dry surface. Surfaces inaccessible after assembly or erection shall be given an additional shop coat of a different color than the first coat. Each coat shall have a minimum dry film thickness of 2.5 mils.
3. After erection, touch up with prime paint members where shop coat has been damaged, welds, areas adjacent to welds and field bolts.

K. Ink:

1. Inks required shall be made for the surface material on which they are to be applied and shall be applied as recommended by the manufacturer of the ink.
2. Exact identification of the ink shall be noted on the shop drawings along with method of application.
3. Prime coats or other surface pre-treatment where recommended shall be included in the work.
4. Inks and finishes shall be guaranteed not to cause discoloration, deterioration, or delamination of any materials used in fabrication.
5. Apply ink when the relative humidity is below 85% and ambient temperature is above 55 degrees F.
6. Ink shall not be applied until the preceding coat has dried.
7. Graphic colors shall match approved samples and shall be exactly as specified. Graphic colors shall be consistent in chroma and value, shall maintain proper opacity or translucency and shall be free of all imperfections.
8. Screened sign finish shall be high gloss. Sign finish shall be smooth and free of all imperfections.

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.008

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

9. See PART 3, Serigraphy/Screen Printing.

L. Protective coating / graffiti resistance:

1. To protect paint finish, apply a clear, water-based plastic coating. The coating shall not yellow or discolor, shall not be affected by pollutants or by climatic erosion. Graffiti shall not penetrate its surface. Application and maintenance shall follow manufacturer's instructions.
2. Coatings applied by the approved method shall be thinned only to provide the required workability. Apply coats uniformly, free from runs and brush marks or streaking.

2.8 DIGITALLY PRINTED FILM :

- A. Acceptable manufacturer: Except as otherwise noted, products specified as a standard of quality in the industry of manufacturing and fabricating signage shall be those manufactured by 3M, specifically 3M Controltac IJ180Cv3 printed using 3M inks and utilizing 3M 8520 Matte overlam and SCPM-44X premask (or equal) to allow the product to be removed from the wall in the future without damaging the wall surface.
- B. Application:
 1. Wall surface to receive digitally printed film shall be painted thoroughly with a latex based paint, that has dried completely.

2.9 GRAPHIC FILM (Translucent, Opaque, Reflective, and Specialty):

- A. Acceptable manufacturer: Except as otherwise noted, products specified as a standard of quality in the industry of manufacturing and fabricating signage shall be those manufactured by 3M, specifically 3M Controltac, 3M Scotchcal, and 3M Scotchlite (or equal).
- B. Application:
 1. Surface to receive film shall be prepped according to manufacturer's instructions.
- C. Fabrication:
 1. Film shall be cut and applied using tools and processes in accordance with manufacturer's instructions to maintain manufacturer's warranty.

PART 3 EXECUTION 3.1 INSPECTION

- A. Inspection of substrates:
 1. Before installation, surfaces to receive identifying devices shall be free from defects and imperfections that would prevent an acceptable installation.
 2. Commencing of work in any space shall constitute acceptance by the Contractor of surfaces to receive identifying devices as being in a satisfactory condition to permit an acceptable installation. If the Contractor's inspection of such surfaces discloses unsatisfactory conditions, he shall notify the Owner in writing and by telephone and then await further instruction; otherwise, no claims will be considered for unsatisfactory work due to real or alleged faulty surfaces.

3.2 PREPARATION AND PROTECTION:

- A. Aluminum shall be separated from direct contact with metals other than stainless steel, zinc, cadmium, or nickel bronze by painting contact surfaces with aluminum compatible

primer and paint and coated with heavy-bodied bituminous paint or by non-absorptive tape or gasket.

- B. Exterior aluminum imbedded or in contact with wood, concrete or masonry shall be painted with aluminum compatible primer and paint and with heavy-bodied bituminous (asphalt) paint. The painted area shall extend 1" above grade.
- C. Protect the work and adjacent work, landscape /hardscape and materials against damage during progress of work until completion. Drop cloths of paper or plastic shall be used around all areas where paint is being applied and appropriate precautions shall be taken to prevent overspray, hazardous conditions or damage to adjacent work.

3.3 INSTALLATION, APPLICATION AND ERECTION:

- A. Serigraphy / Screen Printing / Silver & Gold Leaf:
 1. Screen printed images shall be executed with screens prepared from original or electronically imaged digital printing. No hand cut screens will be accepted. Original art shall be defined as artwork that is a first-generation reproduction of the specified art.
 2. Edges and corners of images shall be clean; rounded corners, cut or ragged edges, edge build-up, bleeding or surface pinholes will not be accepted.
 3. Edges and corners of finished letterforms shall be precise, crisp, clean and free of ticks, discontinuous curves, line wave, cut or ragged edges, edge build-up, bleeding, surface pinholes and other imperfections. Letterforms shall conform to the prescribed letterform proportions.
 4. Screens shall be of a mesh count fine enough to eliminate any texture or pattern in screened graphic images.
 5. Letterforms shall be aligned to maintain a base line parallel to the sign format.
 6. Message copy on the drawings is for layout purposes only. Actual copy for signs shall be printed using camera-ready art or typesetting.
- B. Installation of sign panels and graphic units:
 1. Erect, mount or install all panels and units to be level, plumb and true.
 2. Use sufficient concealed fasteners and anchors to hold sign panels and graphic units in place. Use only concealed shims. Visible fasteners may only be used where approved in shop drawings or as part of an intentional design detail.
 3. Make Owner or Owner's project manager aware of conflicts in sign locations as shown in the drawings.
 4. Mount all graphic units and sign panels at consistent heights indicated by the drawing.
- C. Structural steel:
 1. In planning the method of erection, make full allowance for obstructions encountered which may result from work performed by other trades as well as the operations of the Owner.
 2. Furnish and deliver to the job site anchor bolts leveling plates and templates for setting the bolts.



Page Southerland Page Architects, P.C.
 100 Peachtree Street, NW
 Mezzanine
 Atlanta, GA 30303
 pagethink.com
 TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
 Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
 Denver / Dubai / Houston / Los Angeles / Mexico City /
 Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.009

Principal-In-Charge:
David Deis
 Project Manager:
CB/PN
 EGD Designers:
CB
 Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
 W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

3. Furnish and place all temporary bracing necessary for erection before bolting and welding. Only light drifting will be permitted to draw parts together. Drifting to match unaligned holes will not be permitted. Enlargement of holes necessary to make connections resulting from misfit shall be done by drilling and reaming and the proper size bolt shall then be used.
 4. Concrete footings with embedded anchor bolts with nuts and washers shall be in place to receive steel beam.
 5. Field Connections: Field connections shall be bolted or welded as indicated. High strength bolts shall be used for bolted connections or primary framing members, struts, ties, and other members which form a part of the bracing system.
 6. High Strength Bolt: High strength bolting, including materials and installation, shall comply with code requirements. Connections shall be bearing type and shall be designed based on allowable stresses without threads in the shear plane, except that friction type connection shall be used for moment connections and bracing systems.
 7. Field Welding: Field welding will be permitted only where indicated on design and approved shop drawings. Field welding shall be in accordance with the approved welding procedures and the AWS Structural Welding Code.
 8. Flame-Cutting: No flame-cutting will be permitted without the consent of the Owner or Architect. If consent is given, flame-cut members shall be finished to an acceptable appearance equal to a sheared finish.
 9. Cleaning and touch-up painting:
 - a. After erection, field welds, field bolts and voids or abrasions in shop coat shall be cleaned, degreased and touched up with same paint used for shop coats. Surfaces to be field painted shall be cleaned and left in a condition acceptable for the application of finish paint. Brush strokes are not acceptable.
 - b. Where necessary for a subsequent contractor to remove mud or other foreign material or repair shop coat in preparation for finish painting, this will be done at the Contractor's expense.
 - c. Installation of metal and steel fabrications and assemblies: adjust assembly prior to anchoring to ensure matching alignment at abutting joints. Anchor posts to concrete by the means specified in the engineer's drawings.
- E. Lighting and electrical provisions:
1. Study the drawings for indications that electrical power is required for a sign type. If so, the Contractor shall make provisions for the appropriate supply of power to the location of the sign. Coordinate hookup in accordance with the prevailing building code.
 2. Build all electric signs in accordance with the Underwriter's Laboratories specifications.

3.4 ADJUSTING, CLEANING AND PROTECTION:

- A. Remove and replace damaged identifying devices with new identifying devices free of defects.
- B. Clean exposed surfaces promptly after completion of installation in accordance with

recommendations of manufacturer.

- C. Clean exposed metal work with cleanser recommended by manufacturer of materials and rinse with clean water. Do not use harsh chemicals or abrasive. Surfaces with stains which cannot be removed by cleaning shall be refined or replaced to the satisfaction of the Owner at no extra cost to Owner.
- D. Signs shall be free of tape, packing paper, dirt, smudges, and other foreign material.
- E. Spatters, drippings, smears, and / or spray shall be completely removed.
- F. Plastic surfaces shall be cleaned upon completion in accordance with manufacturer's instructions. Supply one pint of manufacturer's recommended cleaner for Owner's use.
- G. Touch up work after installation shall be performed by the sign manufacturer and approved by Owner.
- H. Protection:
 1. Work in progress shall be protected at all times from staining, scratching, chipping or other damage until acceptance by the Owner.
 2. Provide final protection in a manner acceptable to the fabricator and installer until Date of Substantial Completion.

3.5 METAL FABRICATION AND CONSTRUCTION:

- A. General information: All sign panels shall be fabricated with precision and high standards of quality craftsmanship. All seams, where necessary shall be hairline. All removable panels shall operate smoothly and fit accurately. Polyester (catalyst activated) filler, where used shall be sanded smoothly and painted to achieve an undetectable smooth effect. All edges shall be sanded and corners slightly rounded. Fasteners shall be hidden or if visible shall be countersunk and painted to match the surrounding finish. Flawed or faulty workmanship is subject to rejection by the Owner and shall be replaced with an acceptable unit. Allow for thermal movement resulting from changes in ambient temperature in the design, fabrication, and installation of installed metal assemblies to prevent buckling, opening up of joints, and overstressing of welds and fasteners. Base design calculations on actual surface temperatures of metals due to both solar heat gain and nighttime sky heat loss.
- B. Form metal fabrications from materials of size, thickness, and shapes indicated but not less than that needed to comply with performance requirements indicated. Work to dimensions indicated or accepted on shop drawings, using proven details of fabrication and support. Use type of materials indicated or specified for various components of each metal fabrication.
- C. Form exposed work true to line and level with accurate angles and surfaces and straight sharp edges.
- D. Shear and punch metal cleanly and accurately. Remove burrs.
- E. Ease exposed edges to a radius of approximately 1/32 inch, unless otherwise indicated. Form bent-metal corners to smallest radius possible without causing grain separation or otherwise impairing work.
- F. Remove sharp or rough areas on exposed traffic surfaces.
- G. Weld corners and seams continuously to comply with AWS recommendations and the following:

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE
SPECIFICATION 10 400

DRAWING SHEET

SG.010

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC240033_Design14_Graphics_Branding
14_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 2. Obtain fusion without undercut or overlap.
 3. Remove welding flux immediately.
 4. At exposed connection, finish exposed welds and surfaces smooth and blended so that no roughness shows after finishing and contour of welded surface matches those adjacent. Fill and smooth any voids/gaps between seams prior to finishing with paint.
- H. Form exposed connections with hairline joints, flush and smooth, using concealed fasteners wherever possible. Use exposed fasteners of type indicated or, if not indicated, Phillips flat-head (countersunk) screws or bolts. Locate joints where least conspicuous.
- I. Provide for anchorage of type indicated, coordinate with supporting structure. Fabricate and space anchoring devices to provide adequate support for intended use.
- J. Shop Assembly: Pre-assemble items in shop to greatest extent possible to minimize field splicing and assembly. Disassemble units only as necessary for shipping and handling limitations. Use connections that maintain structural value of joined pieces. Clearly mark units for re-assembly and coordinated installation.
- K. Cut, reinforce, drill and tap miscellaneous metal work as indicated to receive finish hard ware, screws, and similar items.
- L. Fabricate joints that will be exposed to weather in a manner to exclude water or provide weep holes where water may accumulate.
- M. Waterjet Technology:

All aluminum that is specified to be cut with waterjet technology shall maintain a smooth edge. Fabricator is to use vector artwork of design provided by designer. For applications where material pushes through cut aluminum, there must be a tolerance between the aluminum and push-through material of 1/64" or less. Fabricator is to use vector artwork of the design provided by designer. Maintain smooth cut edge through out so that push-through material fits tightly.

3.6 SIGN LOCATIONS AND MESSAGE SCHEDULES:

- A. Message copy on the drawings is for layout purposes. Actual copy for signs shall be printed using digitally generated fonts or vector art provided by designer.
- B. Sign locations and messages: The Owner will provide verification of an updated edition of the sign location plans and sign message schedules (attached as part of these contract documents).

3.7 SUBSTITUTIONS:

- A. Document each request with complete data substantiating compliance of proposed Substitution.
- B. A request constitutes a representation that the Contractor:
 1. Has investigated proposed Product and determined that it meets or exceeds the quality level of the specified Product.
 2. Will provide the same warranty for the Substitution as for the specified Product.

3. Will coordinate installation and make changes to other Work which may be required for the Work to be complete with no additional cost to Owner.
 4. Waives claims for additional costs or time extension which may subsequently become apparent.
 5. Is acceptable as an alternative to regulatory officials.
- D. Substitutions will not be considered when they are indicated or implied on shop drawing or product data submittals, without separate written request, or when acceptance will require revision to the Contract Documents.
- E. Substitution Submittal Procedure:
1. Submit three copies of the request for Substitution for consideration. Limit each request to one proposed Substitution.
 2. Submit shop drawings, Product data, and certified test results attesting to the proposed Product equivalence.
 3. The signage consultant and owner's representative will notify the Contractor, in writing, of decision to accept or reject request.

----- END SPECIFICATION 10400-----



Page Southerland Page Architects, P.C.
 100 Peachtree Street, NW
 Mezzanine
 Atlanta, GA 30303
 pagethink.com
 TEL: 404-524-2200

ARCHITECTURE / ENGINEERING / INTERIORS / PLANNING / CONSULTING
 Albany / Albuquerque / Atlanta / Austin / Boston / Dallas /
 Denver / Dubai / Houston / Los Angeles / Mexico City /
 Orlando / Phoenix / Raleigh / San Francisco / Washington DC

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

SPECIFICATION 10 400

DRAWING SHEET

SG.011

Principal-In-Charge:
David Deis
 Project Manager:
CB/PN
 EGD Designers:
CB
 Drawn by:
CB

File Path:
Y:\PROJ\ATL14XX24XXX\14AC24003_Design\14_Graphics_Branding
 W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
IA1
Vinyl
Clear Glass

DRAWING SHEET

SG.1

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL140024XXX\14AC24003_Design\14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

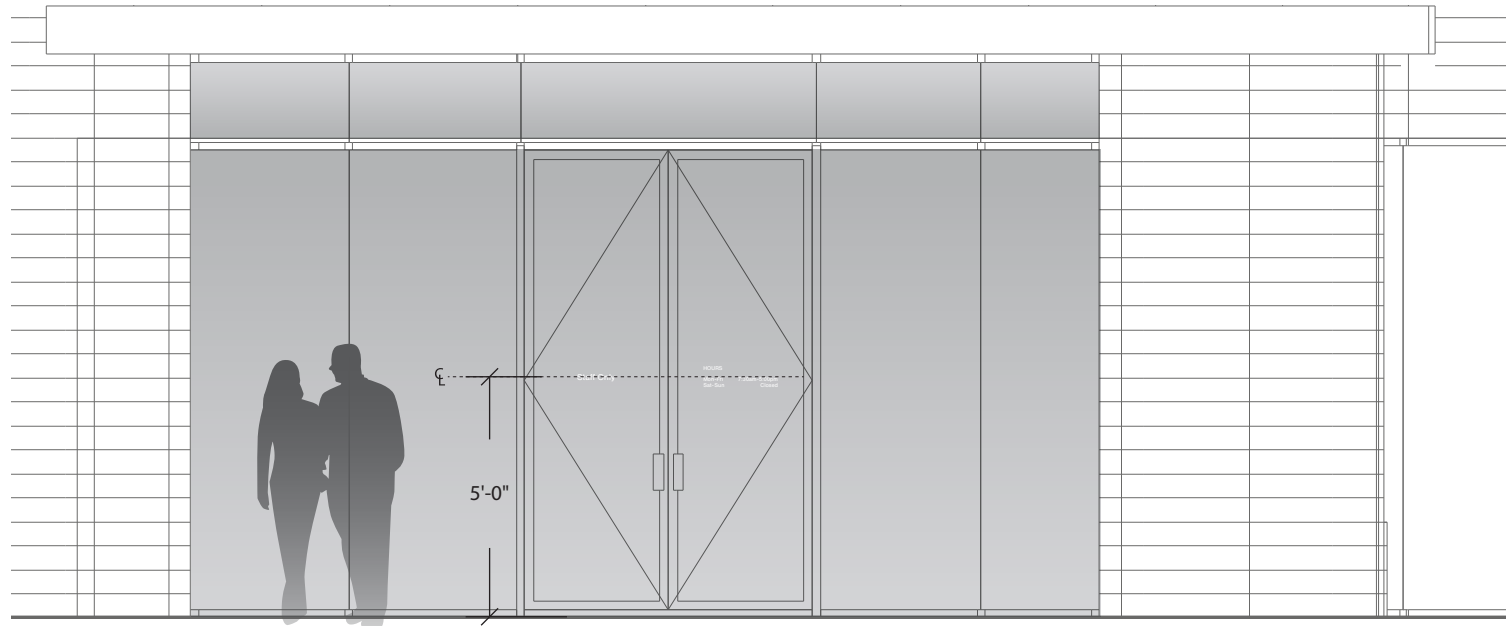


3 ST IA1-Location Elevation
SG.1 Scale: 1/4" = 1'-0"


White vinyl letters applied to second surface of clear glass entry door **M1** **T2**

* If glass is tinted, see IA1.1 Sheet SG.2

Location, message, logo, sheet dimension and hours to be coordinated for each building

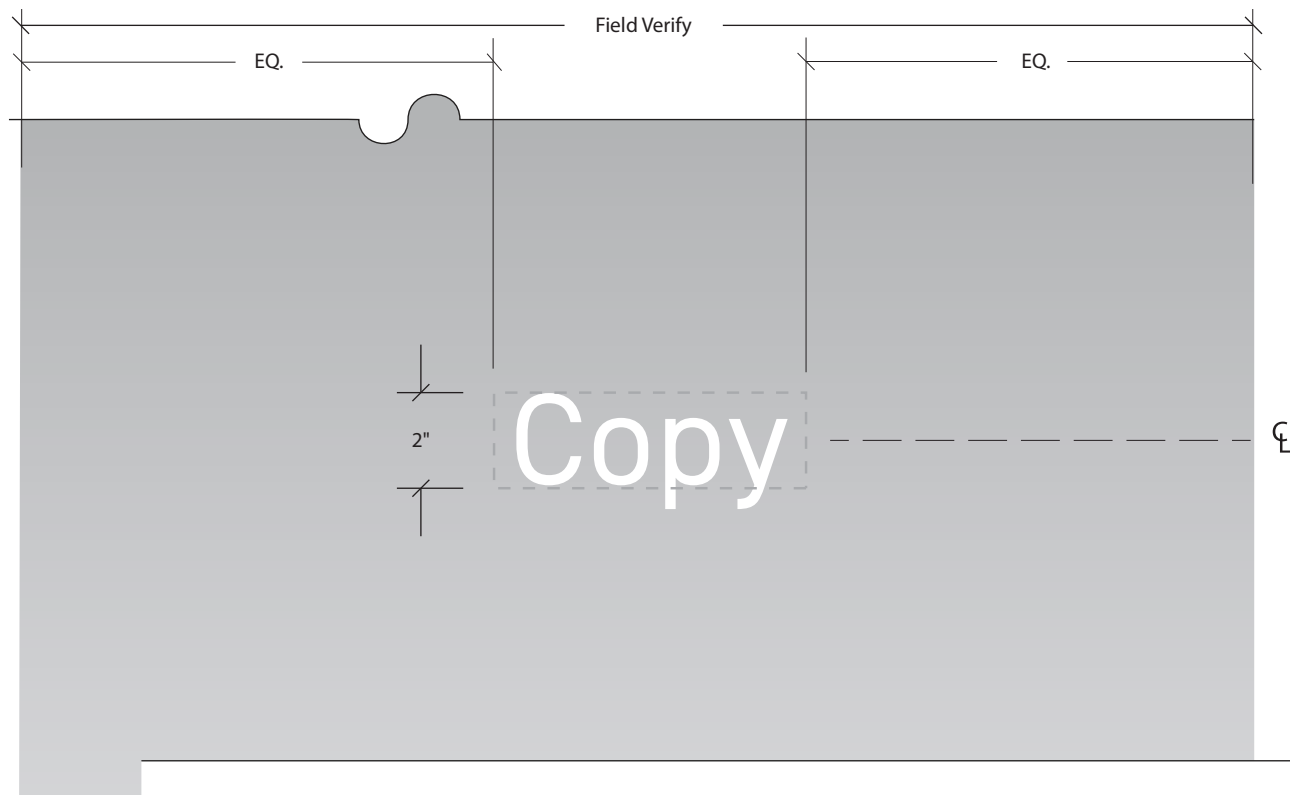

1 ST IA1_Vinyl on Clear Glass Door_Left Door Front View
SG.1 Scale: 3" = 1'-0"

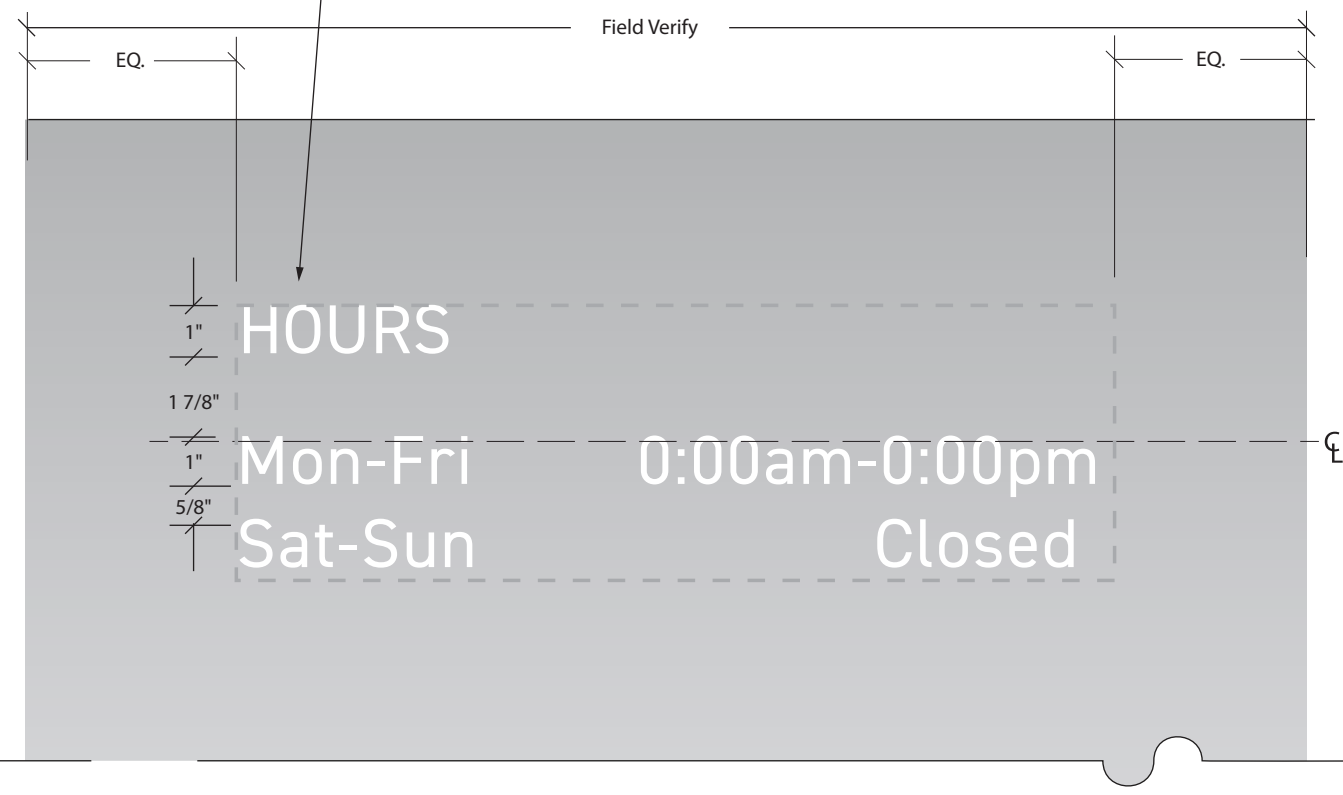

2 ST IA1_Vinyl on Clear Glass Door_Right Door Front View
SG.1 Scale: 3" = 1'-0"

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

IA1.1

**Vinyl
Tinted Glass**

DRAWING SHEET

SG.2

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021



3
SG.2 ST IA1.1- Location Elevation
Scale: 1/4" = 1'-0"


White or Dusted Crystal vinyl with reverse cut text **M1** or **M5** **T2**

Applied to first surface of tinted glass entry door *


* If glass is clear, see ST IA1/Sheet SG.1

Applied vinyl circle with reverse cut symbol. **M2**

Location, message, logo, sheet dimension and hours to be coordinated for each building

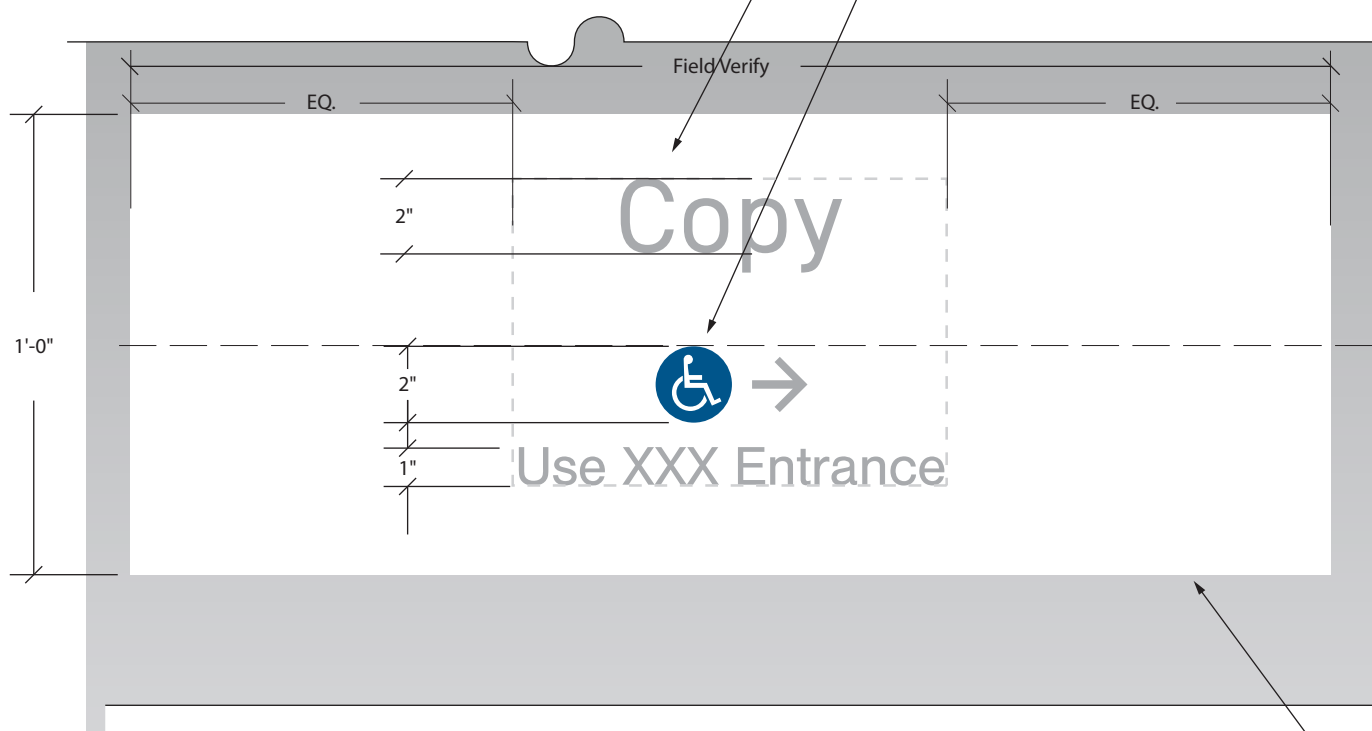

1
SG.2 ST IA1.1- Left Door_Tinted Glass
Scale: 1:5

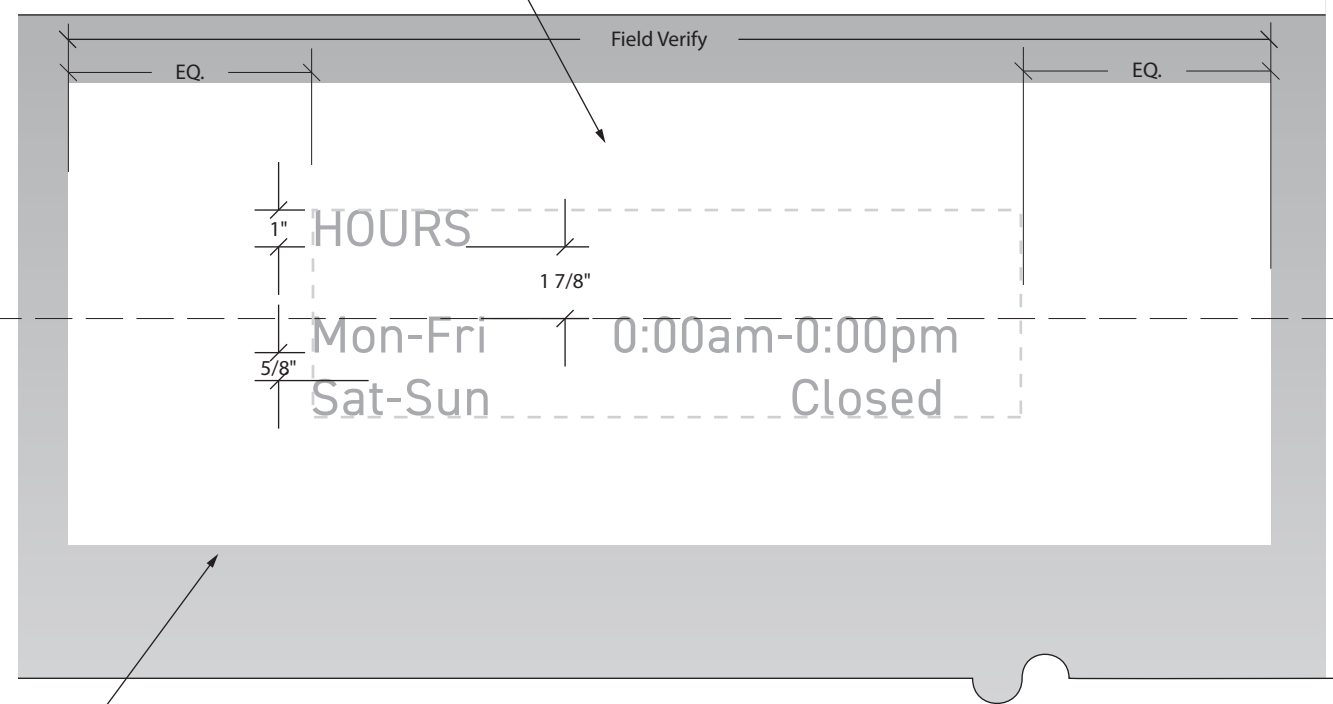

2
SG.2 ST IA1.1- Right Door_Tinted Glass
Scale: 1:5

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IB1
Department ID

DRAWING SHEET


SG.3

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

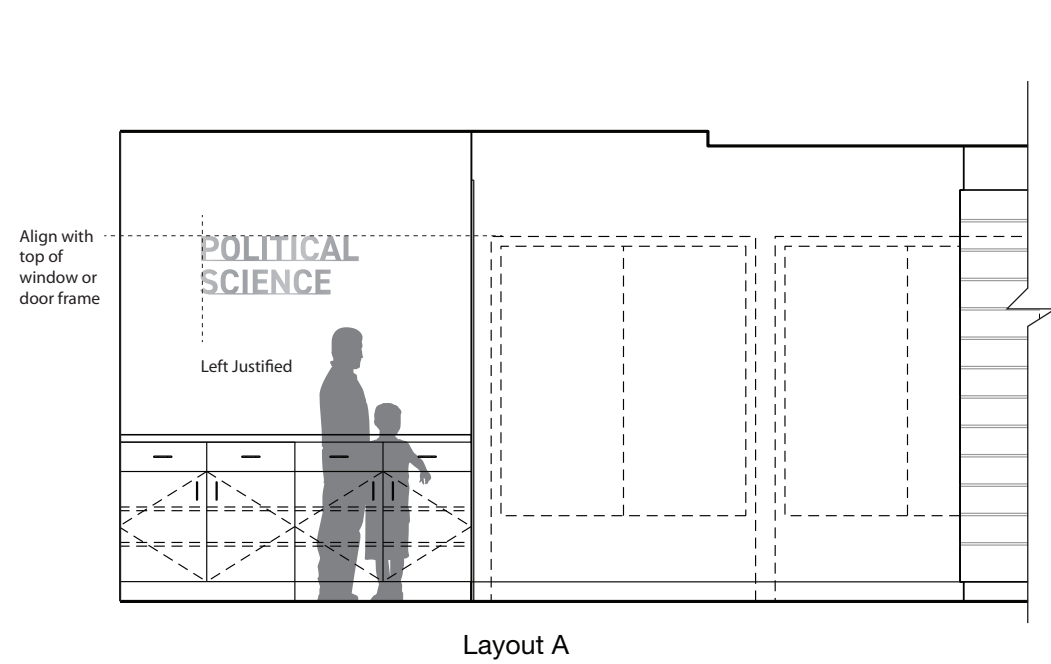


Layout A

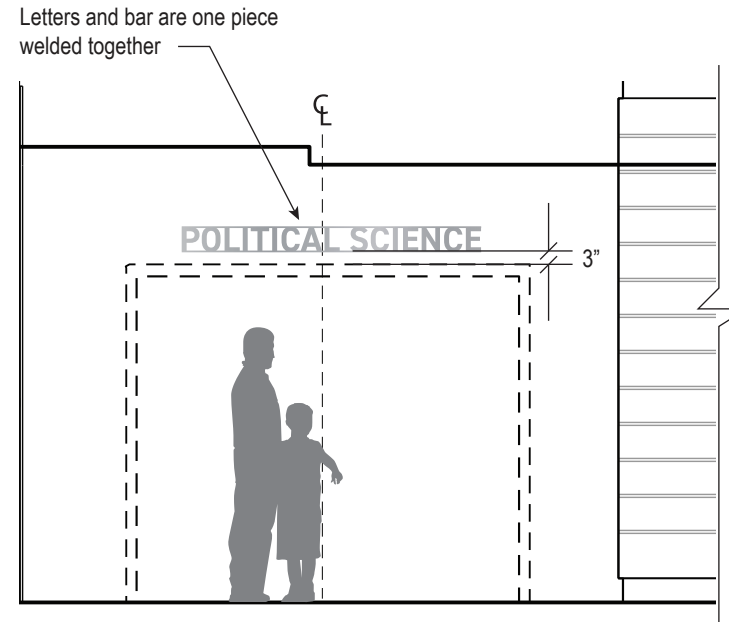

Layout B

4 ST IB1 - Location Elevations - Layout A and B
SG.3 Scale: 1/4" = 1'-0"

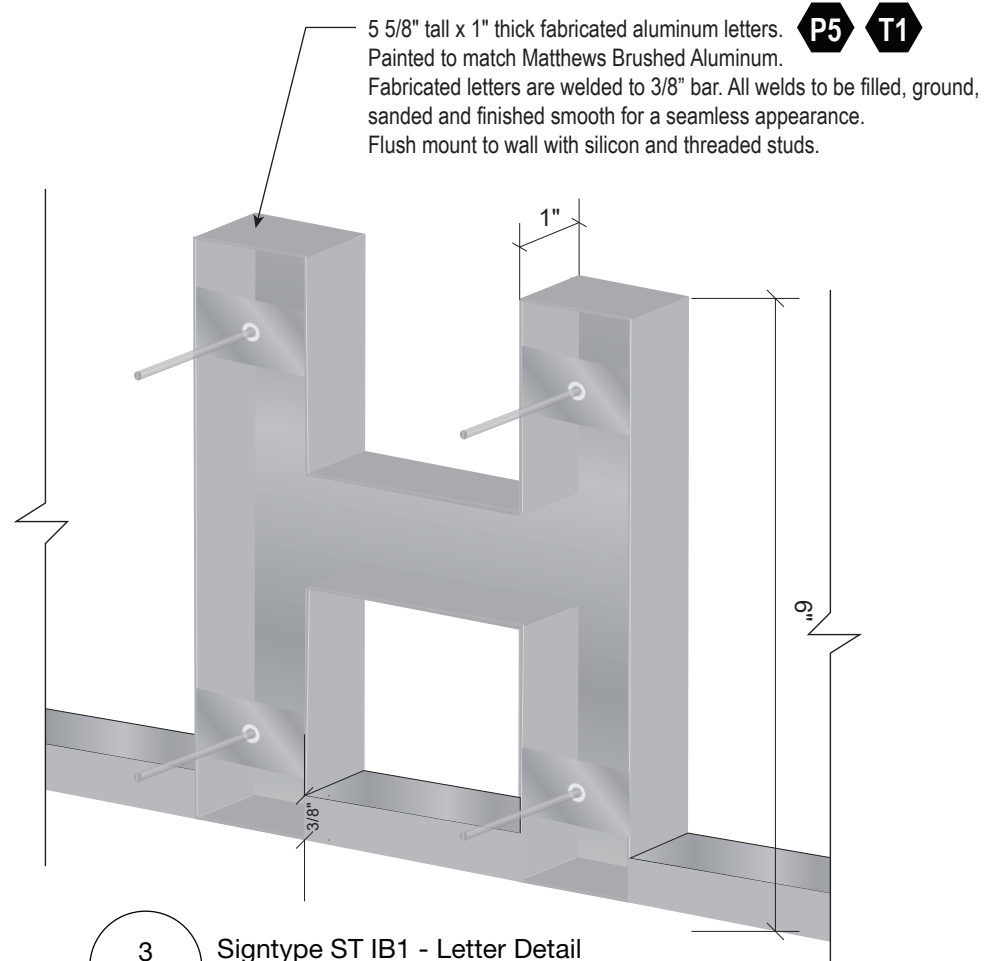


3 Signtype ST IB1 - Letter Detail
SG.3 Scale: HALF

POLITICAL SCIENCE


2 Signtype ST IB1 - Front Elevation Layout B
SG.3 Scale: 3/4" = 1'-0"

POLITICAL SCIENCE

1 Signtype ST IB1 - Front Elevation Layout A
SG.3 Scale: 1 1/2" = 1'-0"

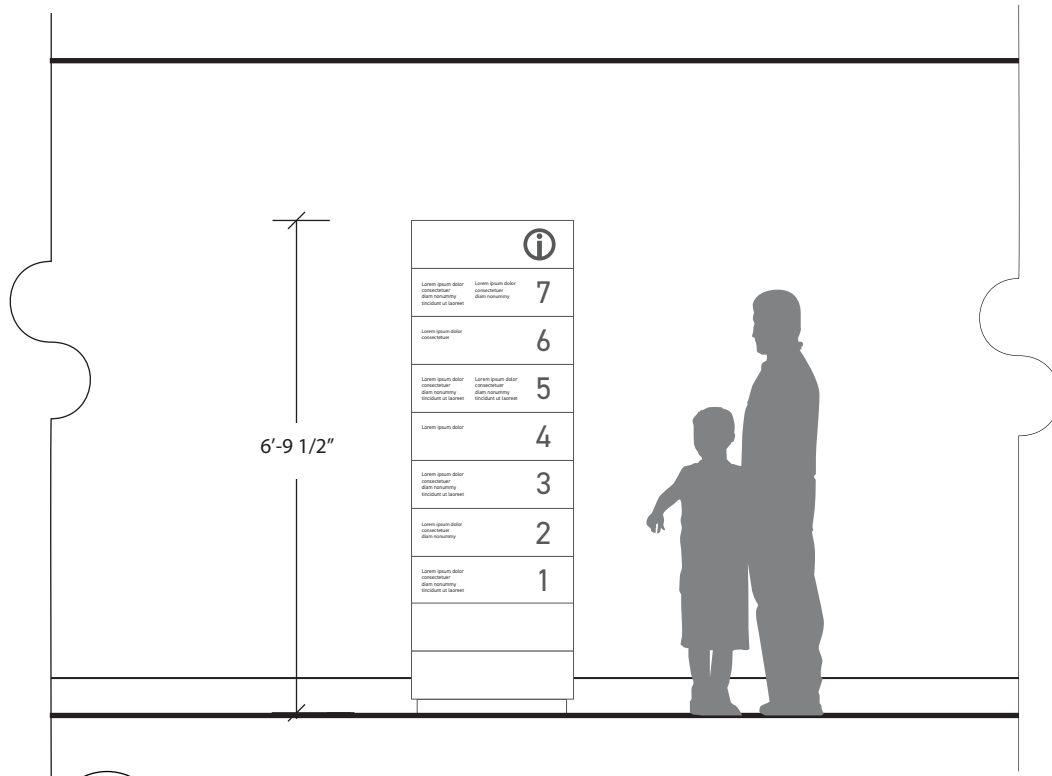


3 ST IC1 - Location Elevation
 SG.4 Scale: 3/8" = 1'-0"

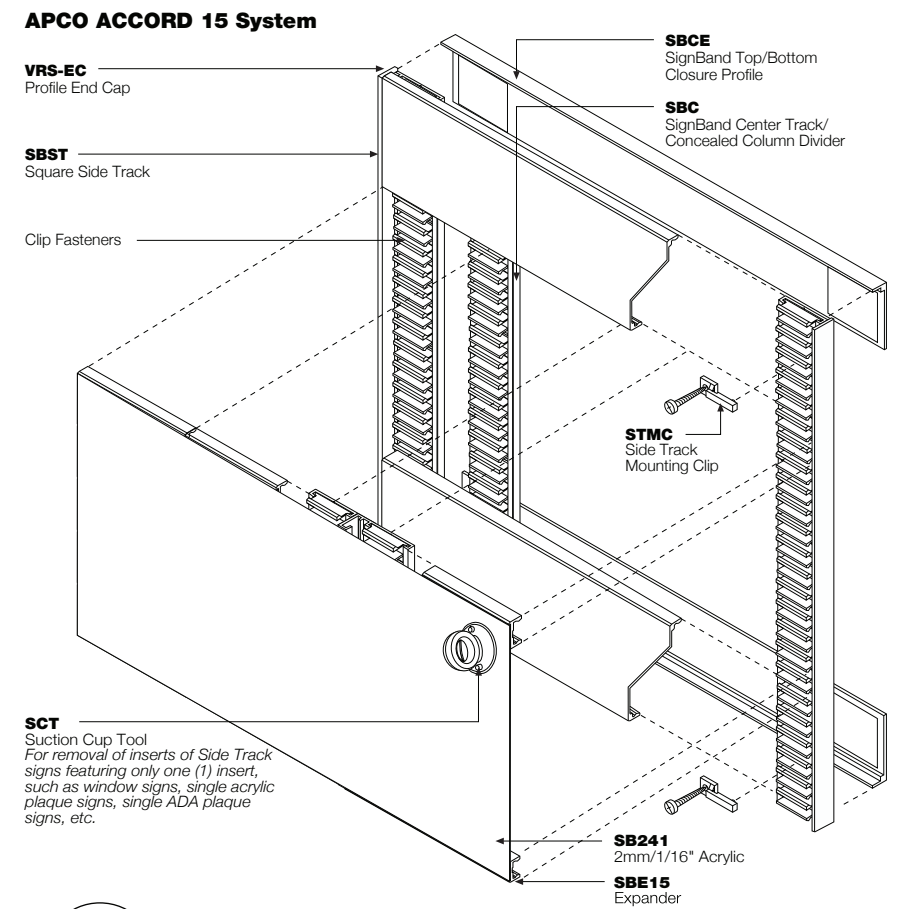

4 ST IC1_Detail
 SG.4 SCALE: N.T.S

Fabricated aluminum cabinet.
 1/4" aluminum angle with 1/8" aluminum sign faces.
 All seams/welds to be filled, ground, sanded and finished smooth for a seamless appearance.
 Apco Accord Sign System to be attached to face of cabinet.
 Mechanically fasten sign cabinet to floor.

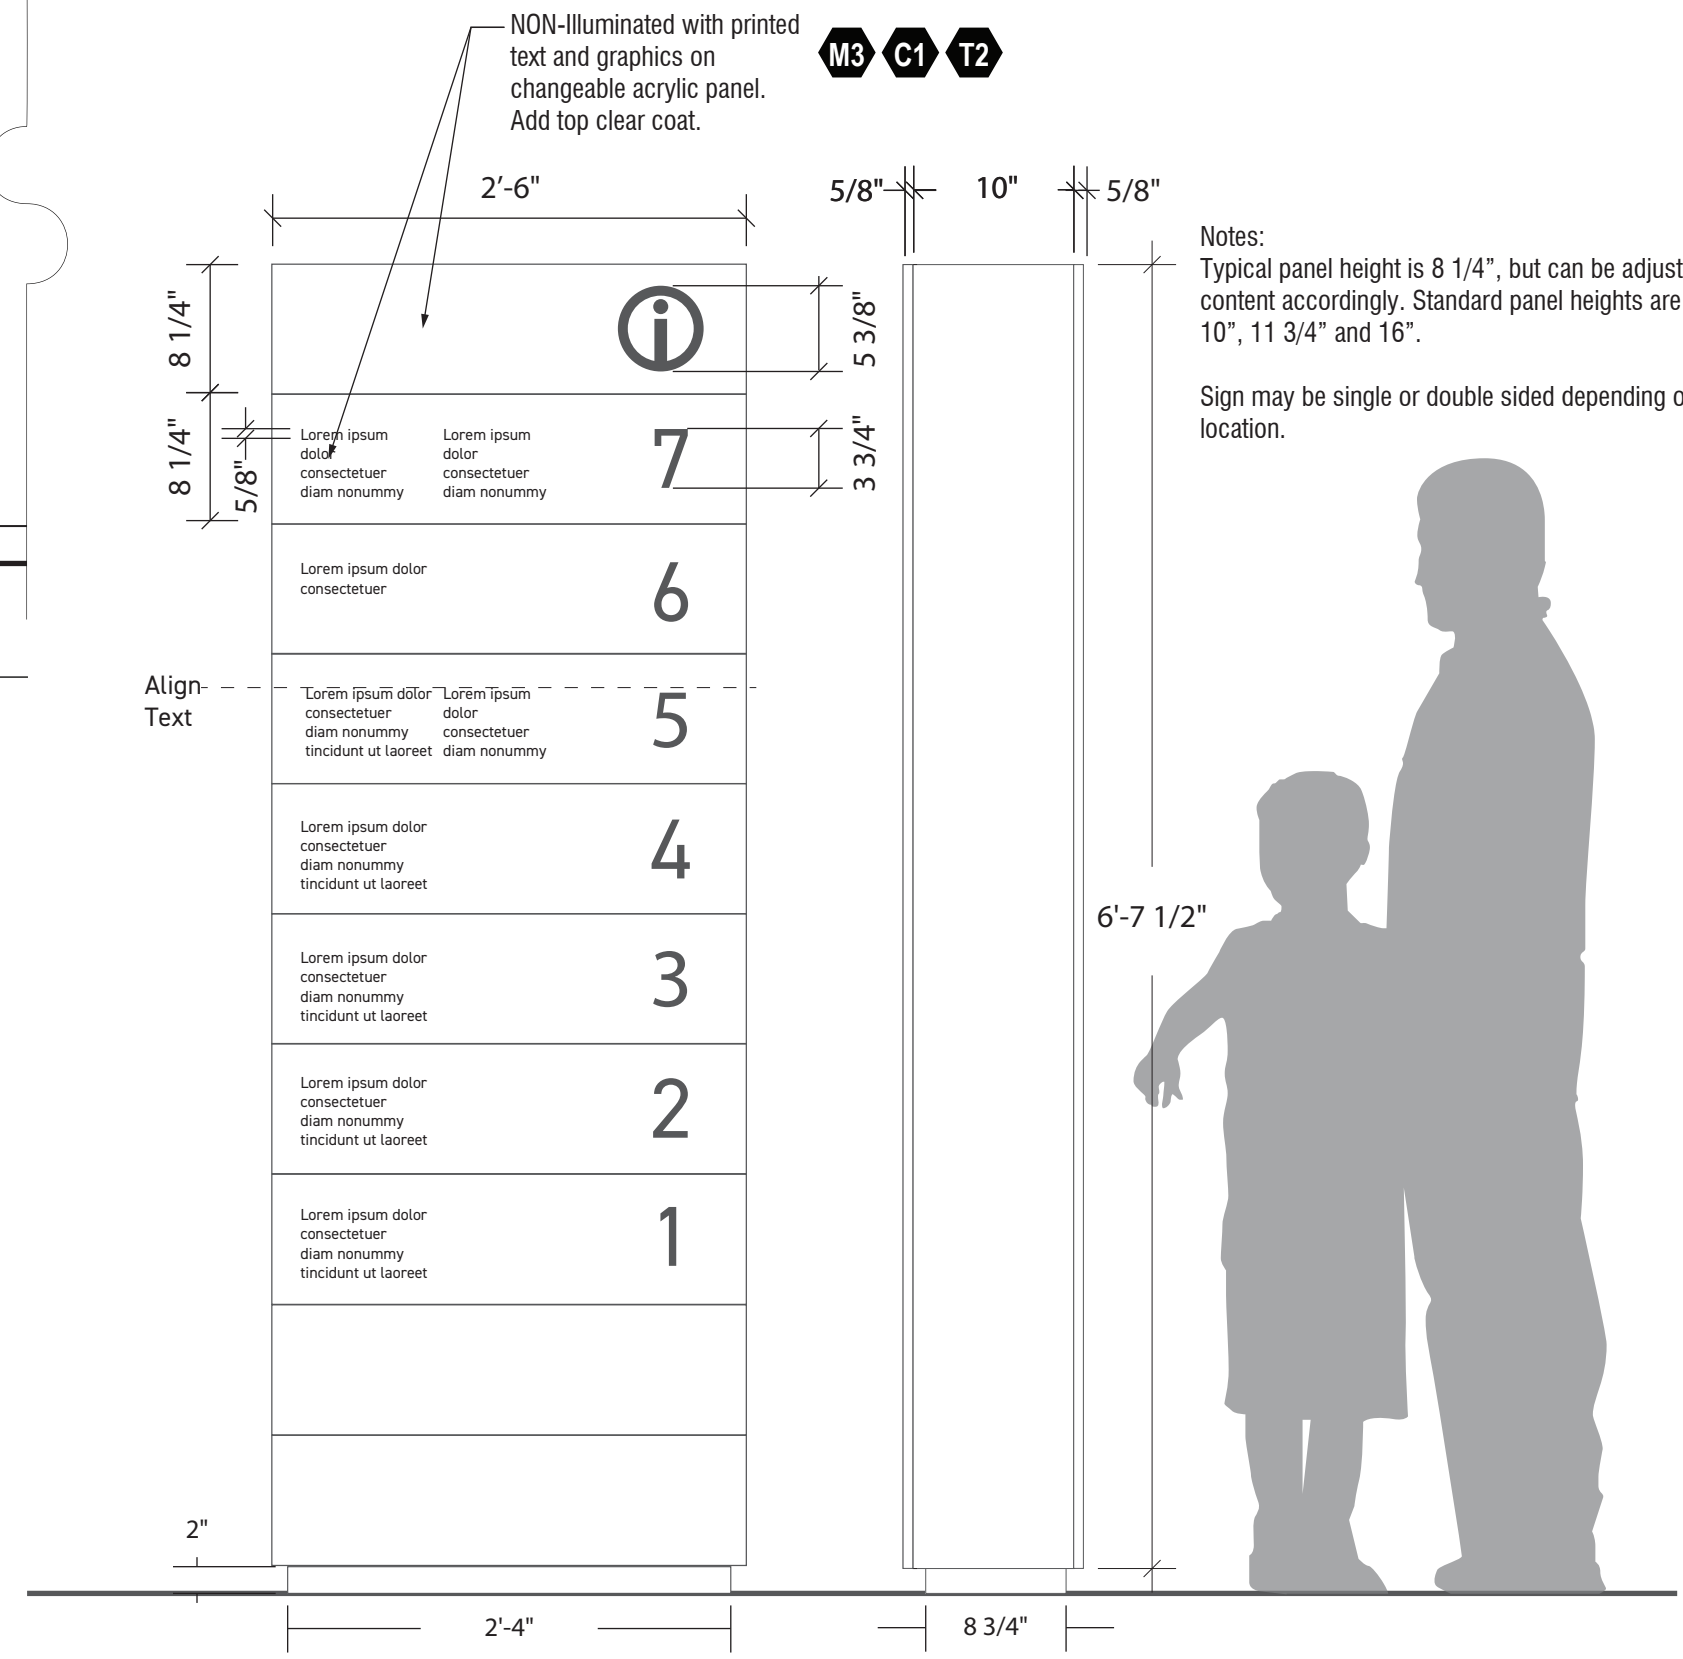

1 ST IC1_Floor Mounted Directory_Front Elevation
 SG.4 SCALE: 1" = 1'-0"

2 ST IC1_Floor Mounted Directory_Side View
 SG.4 SCALE: 1" = 1'-0"

Notes:
 Typical panel height is 8 1/4", but can be adjusted to fit content accordingly. Standard panel heights are 8 1/4", 10", 11 3/4" and 16".
 Sign may be single or double sided depending on location.

NON-Illuminated with printed text and graphics on changeable acrylic panel. Add top clear coat.
 M3 C1 T2

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No.	Description
1	Updated XM.1, XM.2 and XM.3

TITLE
IC1
Floor Mounted Directory

DRAWING SHEET
SG.4

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB
 File Path:
 Y:\PROJ\ATL14\X24\XXX14AC240033_Design14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IC1.1
Freestanding Directory

DRAWING SHEET


SG.4.1

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
14_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

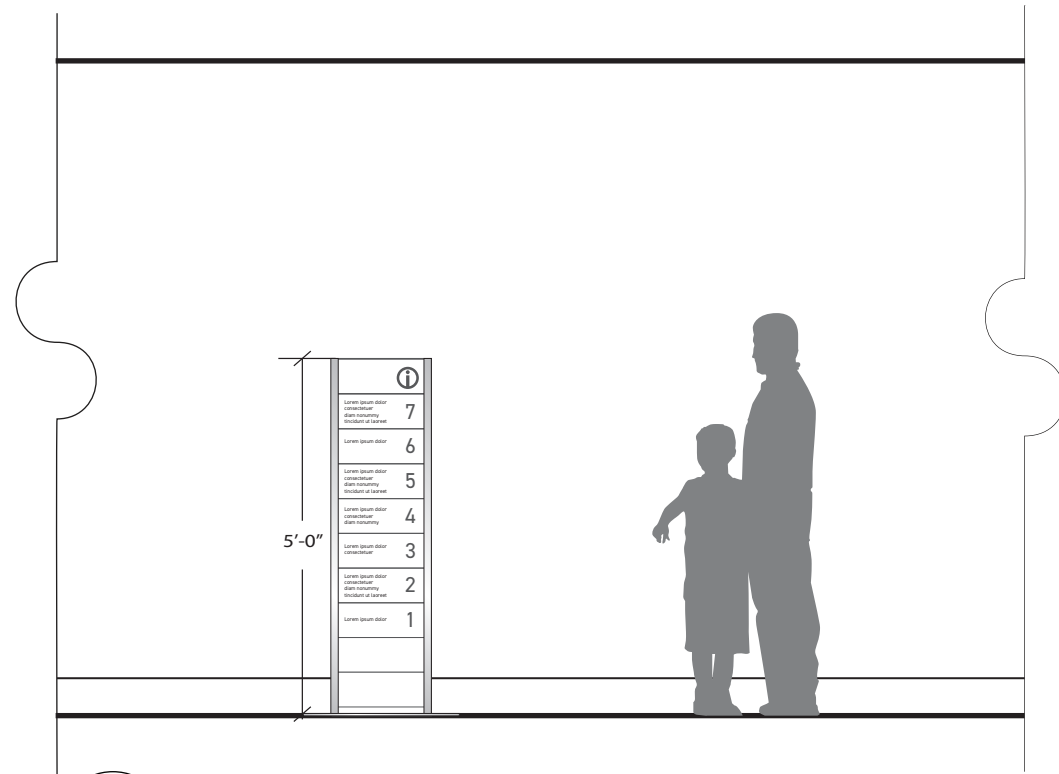

3 ST IC1.1 - Location Elevation
SG.4.1 Scale: 3/8" = 1'-0"

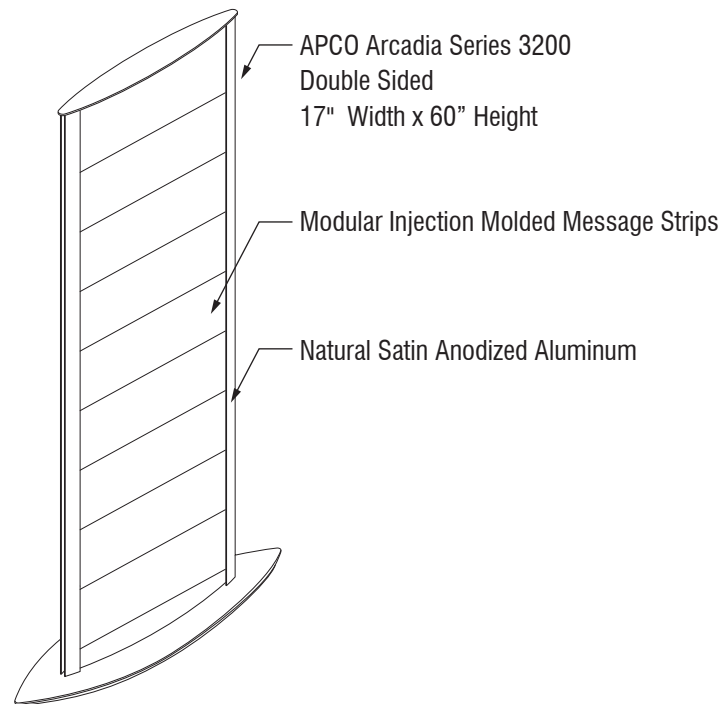

1 ST IC1.1 - Details
SG.4.1 Scale: NTS

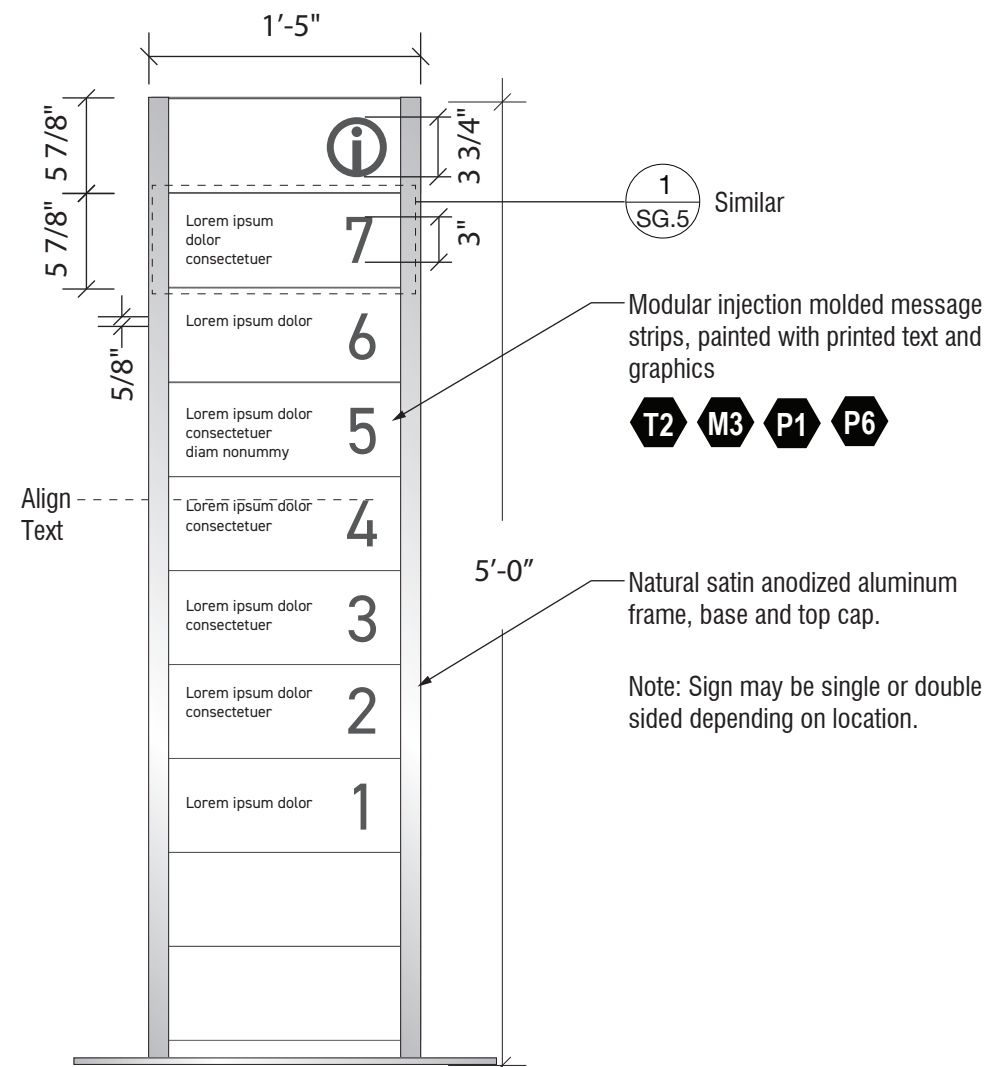

2 ST IC1.1_Freestanding Directory - Front Elevation
SG.4.1 SCALE: 1" = 1'-0"

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
IC2
Wall Mounted Directory
Alternate Layout

DRAWING SHEET


SG.5

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL14\X24\XXX14AC240033_Design14_Graphics_Branding
14_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

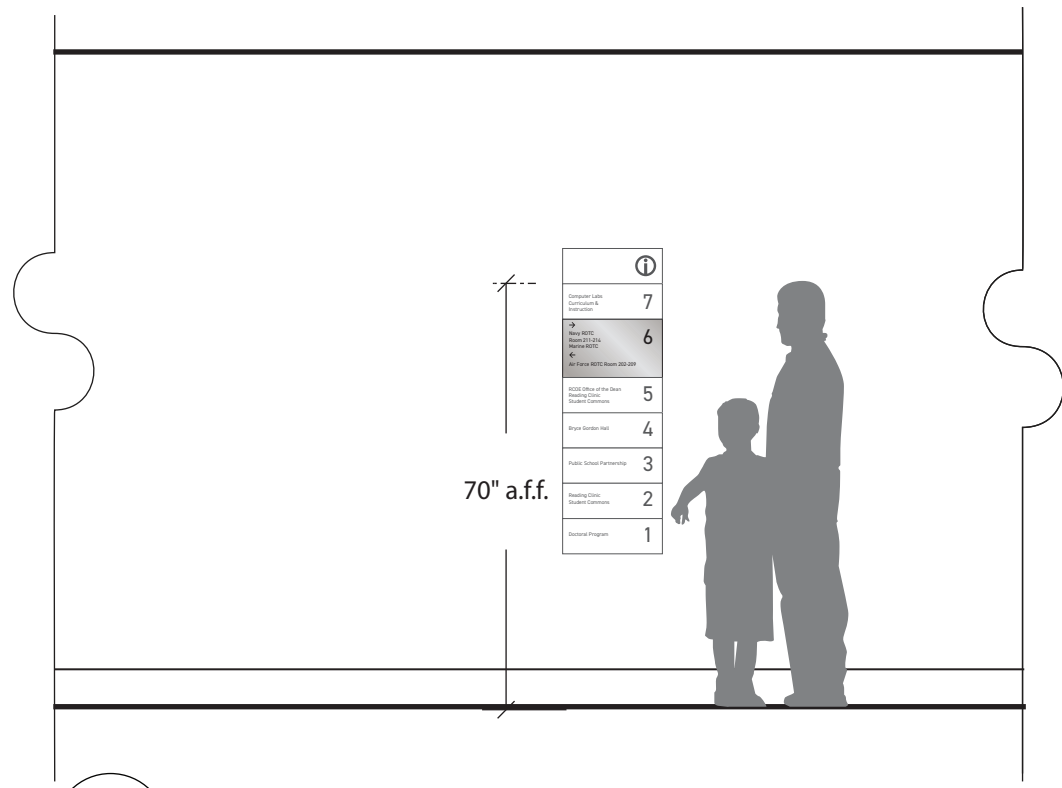


3 ST IC2 - Location Elevation
Scale: 3/8" = 1'-0"

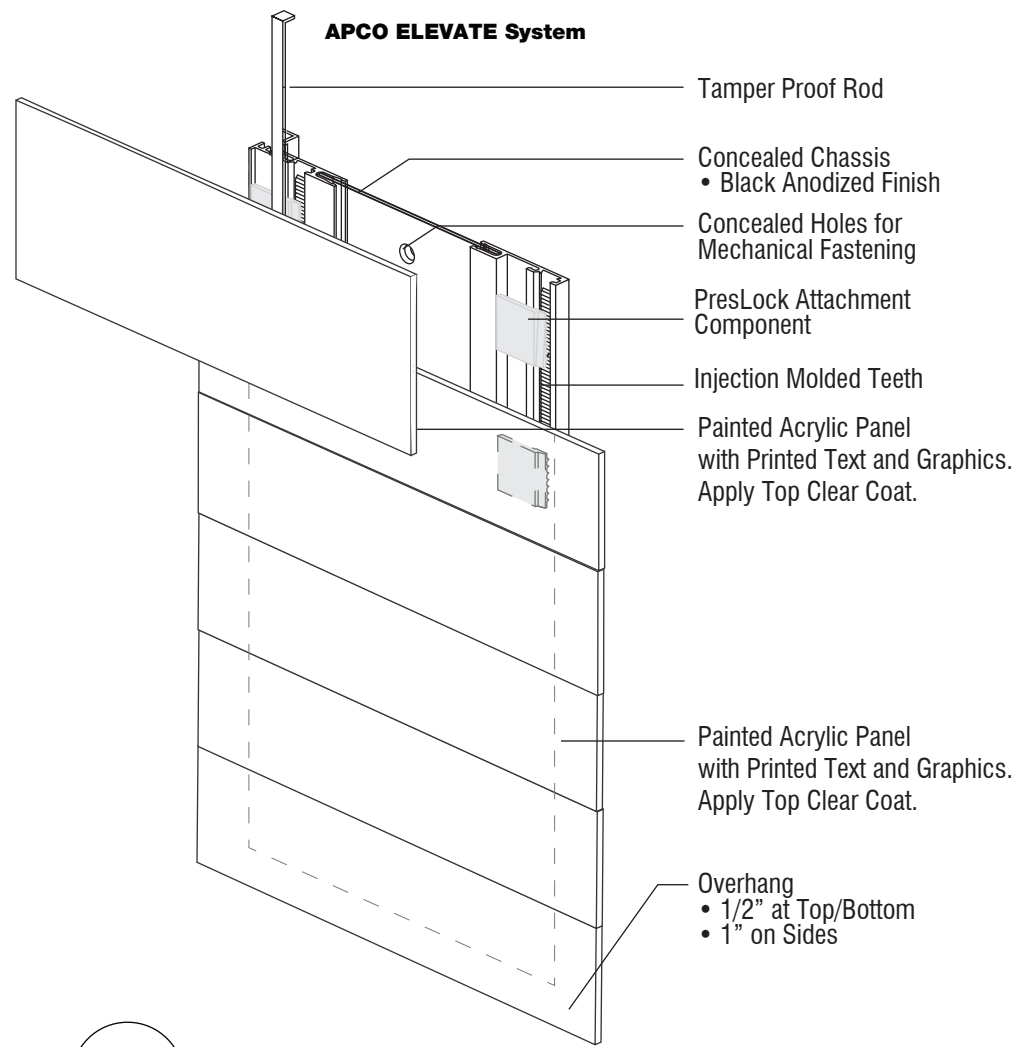

4 ST IC2_Detail
SCALE: N.T.S

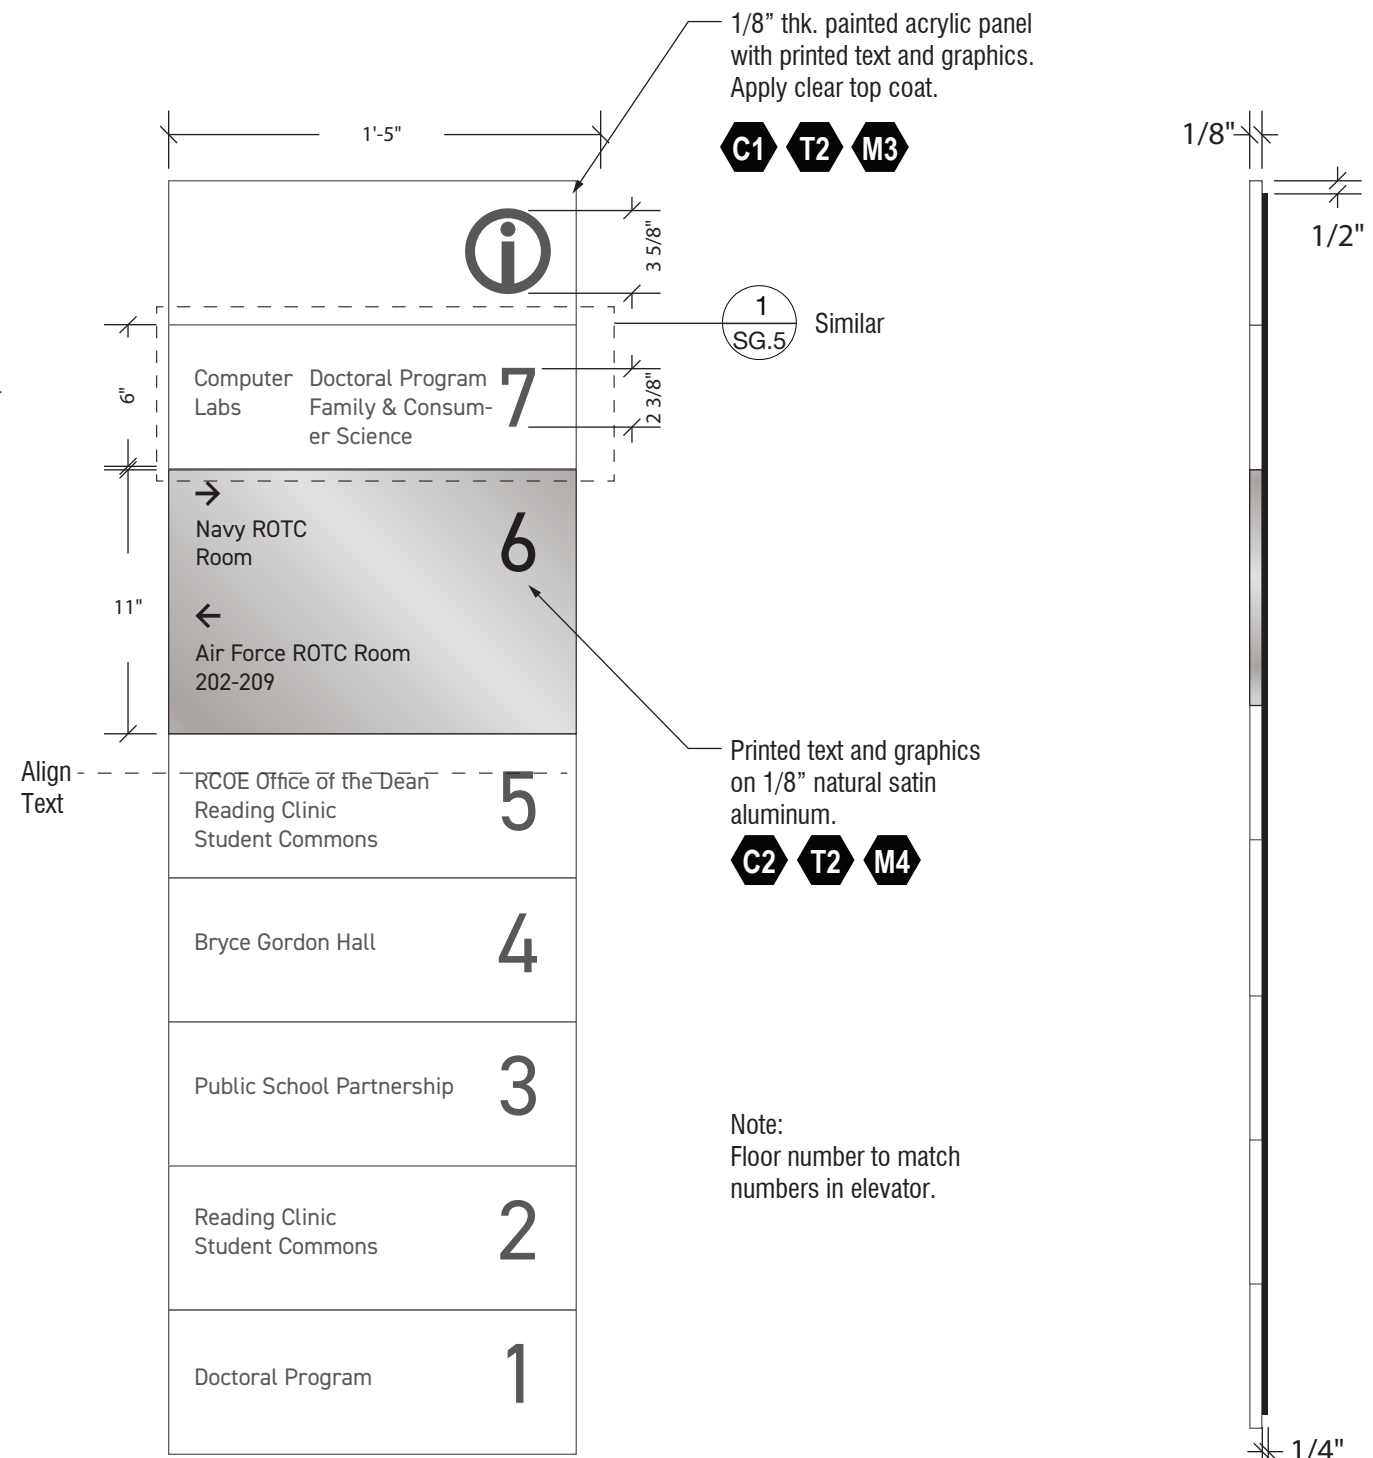


1 ST IC2_Front Elevation
SCALE: 1 1/2" = 1'

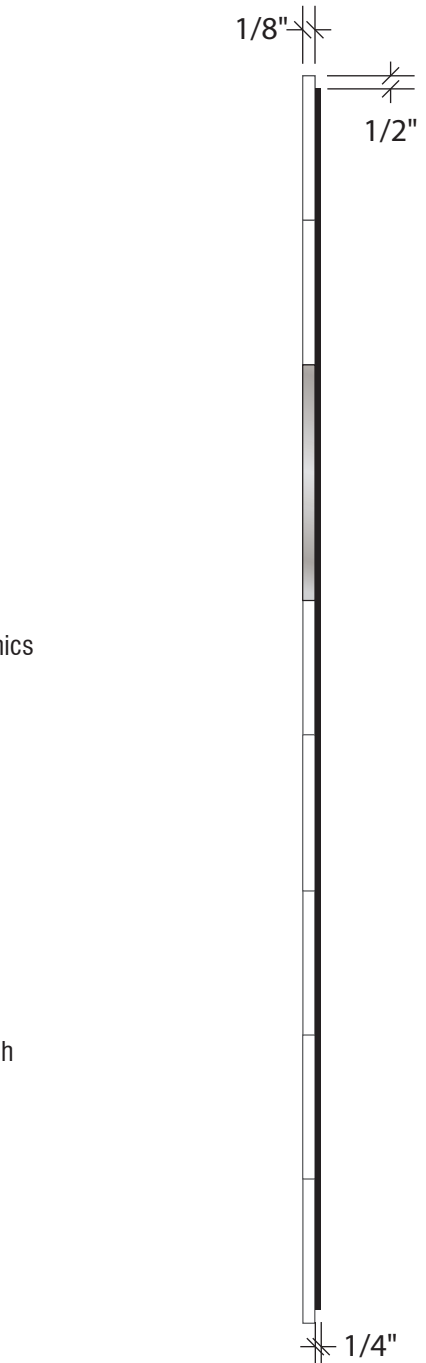


2 ST IC2_Side View
SCALE: 1 1/2" = 1'


Note:
Floor number to match
numbers in elevator.

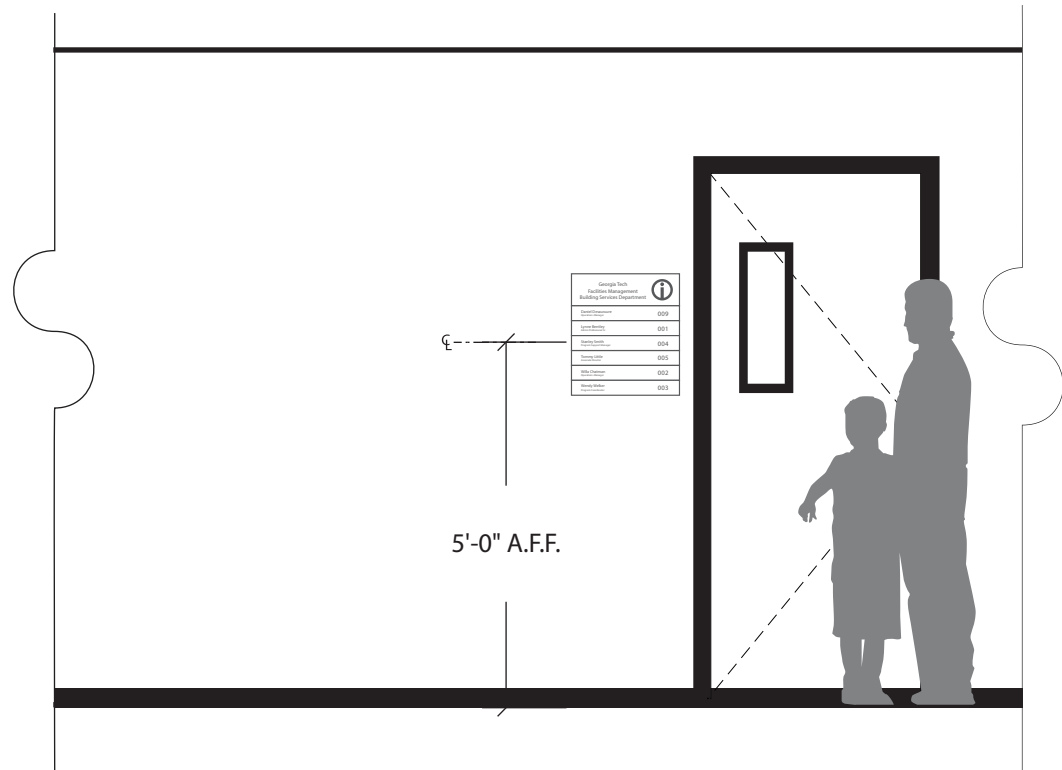


3 ST IC2.1 - Lobby Wall Mounted Directory_Location Elevation
 SG.6 Scale: 3/8" = 1'-0"

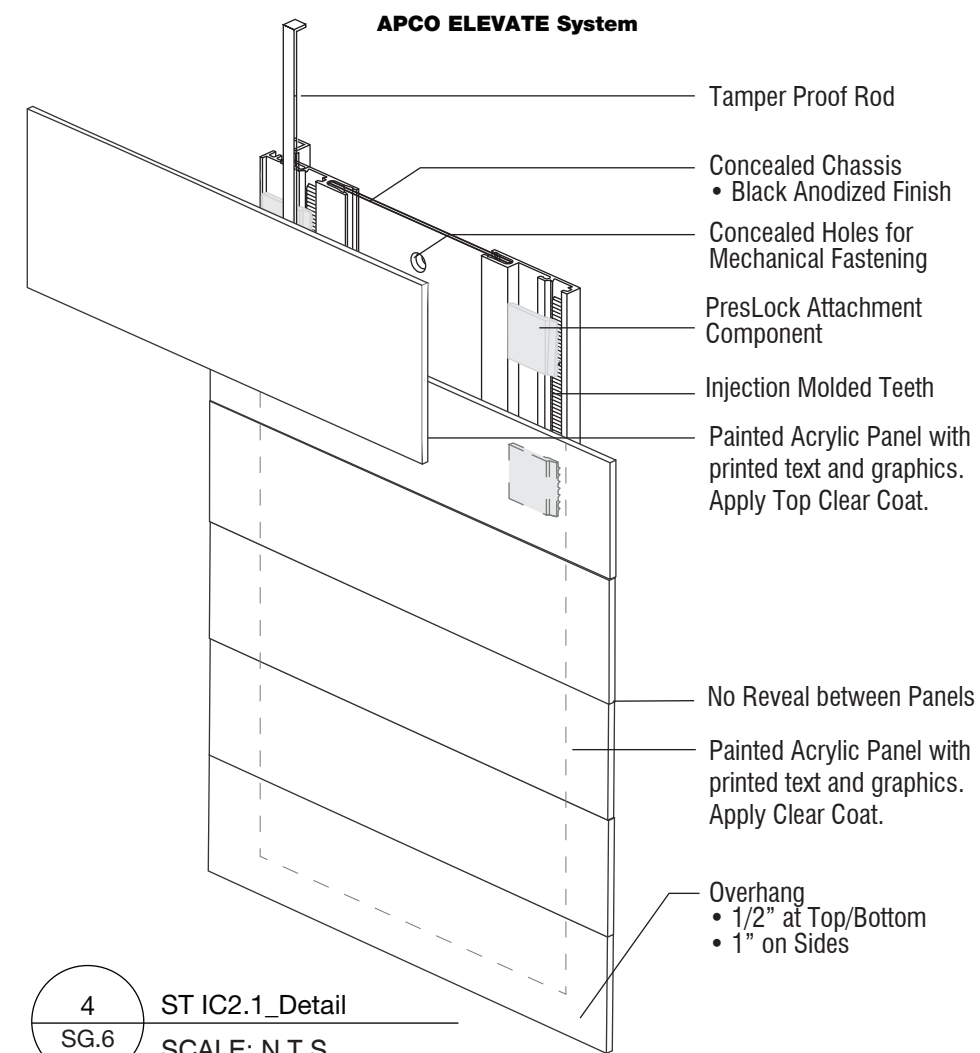

4 ST IC2.1_Detail
 SG.6 SCALE: N.T.S

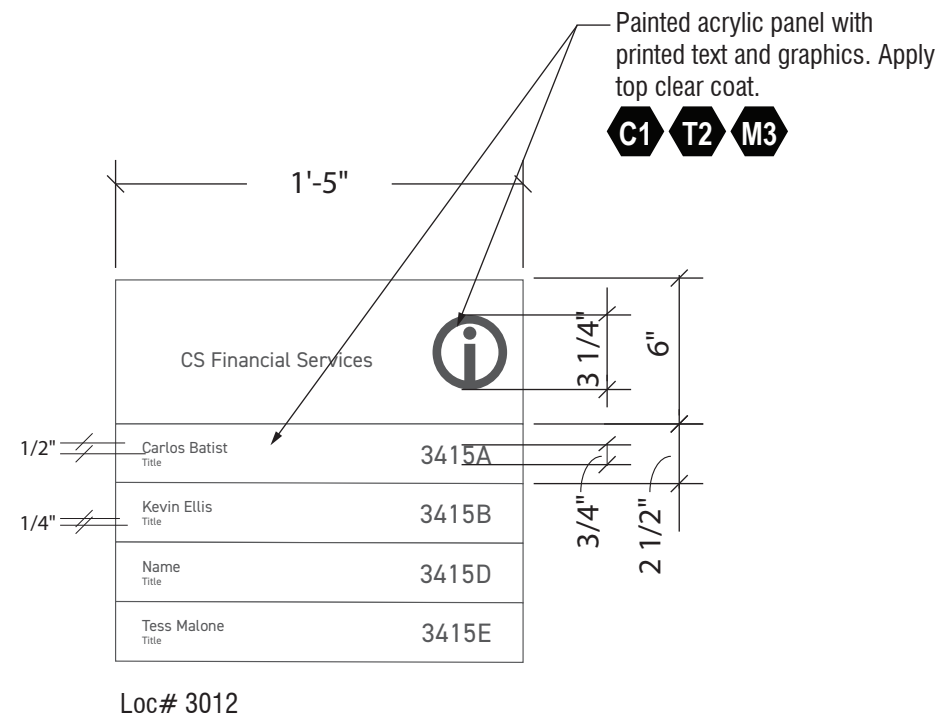


1 ST IC2.1_Lobby Wall Mounted Directory_Front Elevation
 SG.6 SCALE: 1 1/2" = 1'

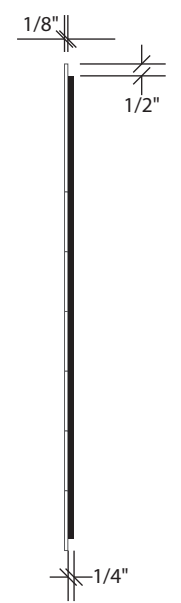


2 ST IC2.1_Side View
 SG.6 SCALE: 1 1/2" = 1'


Rev. No.	Description
1	Updated XM.1, XM.2 and XM.3

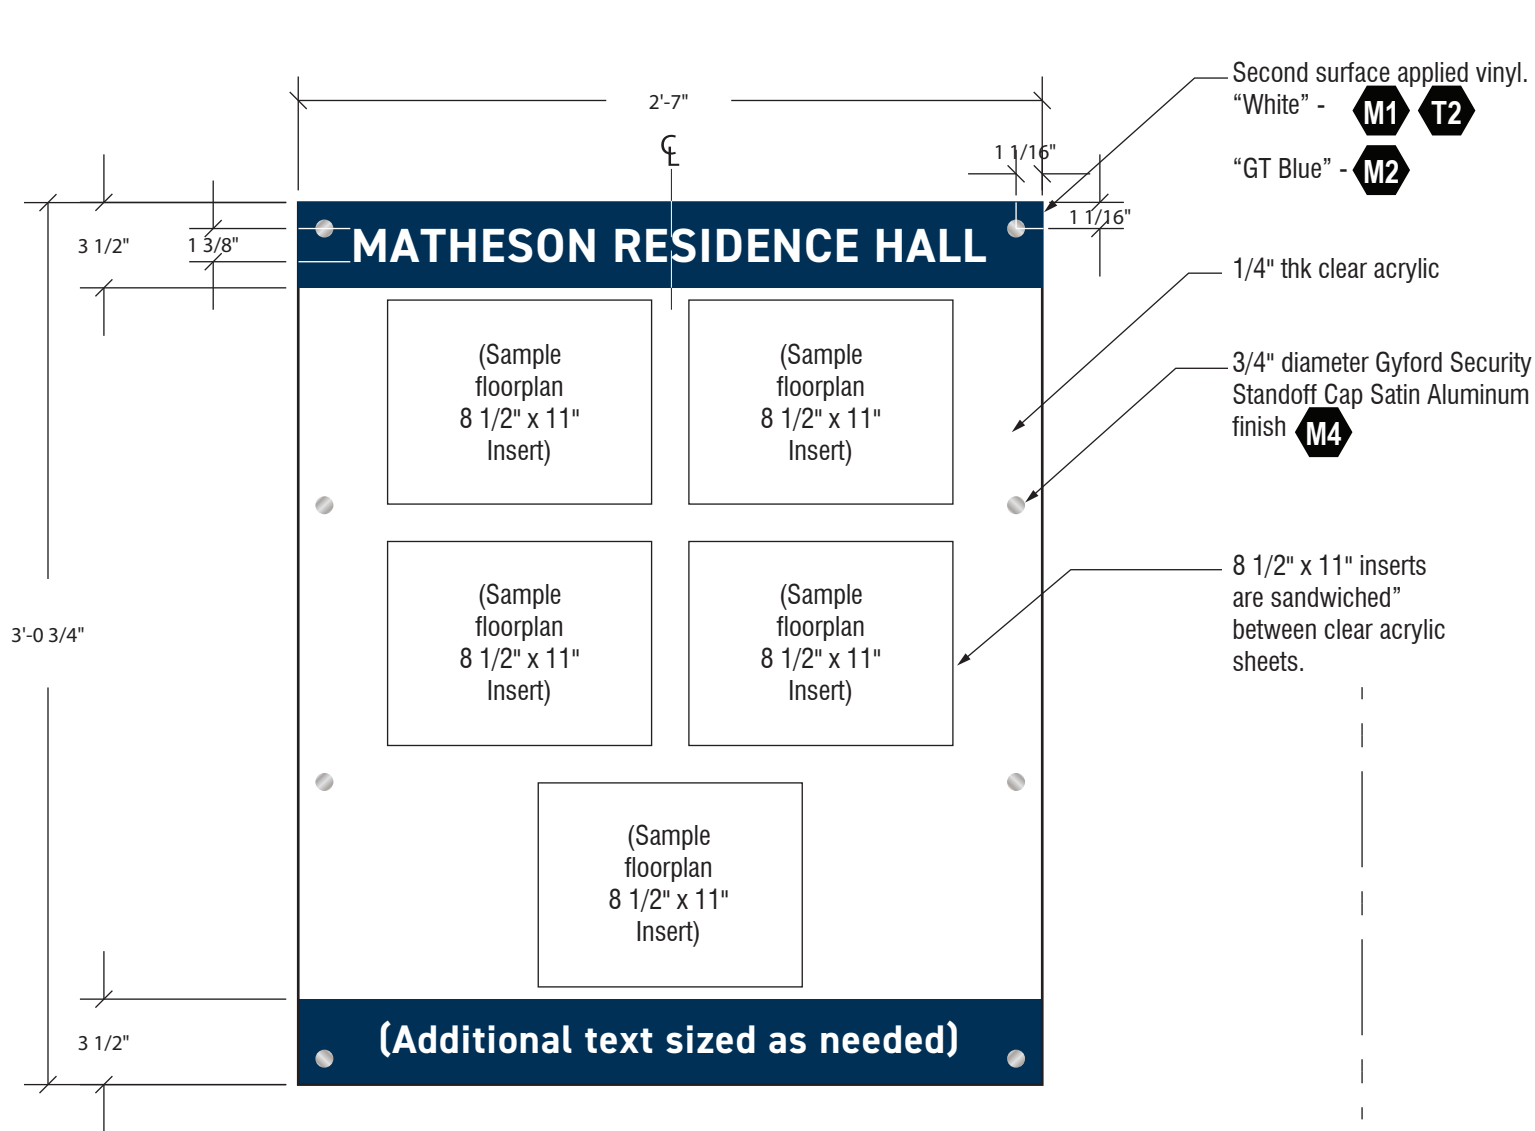


2 IC3_Front Elevation
SG.7 Scale: 1-1/2" = 1'-0"

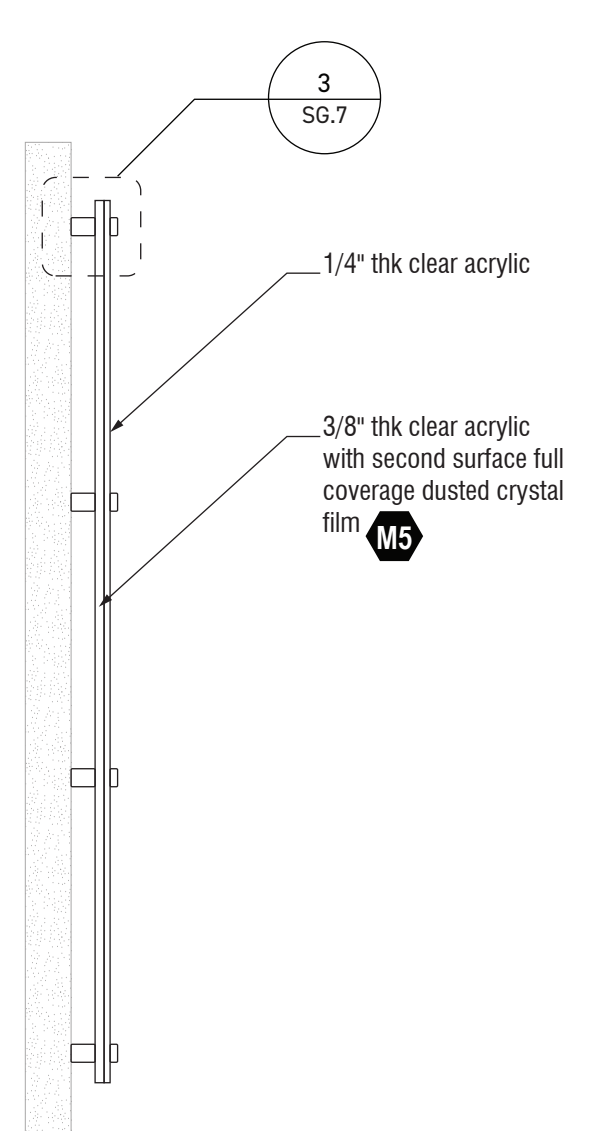

3 IC3_Side View
SG.7 Scale: 1-1/2" = 1'-0"

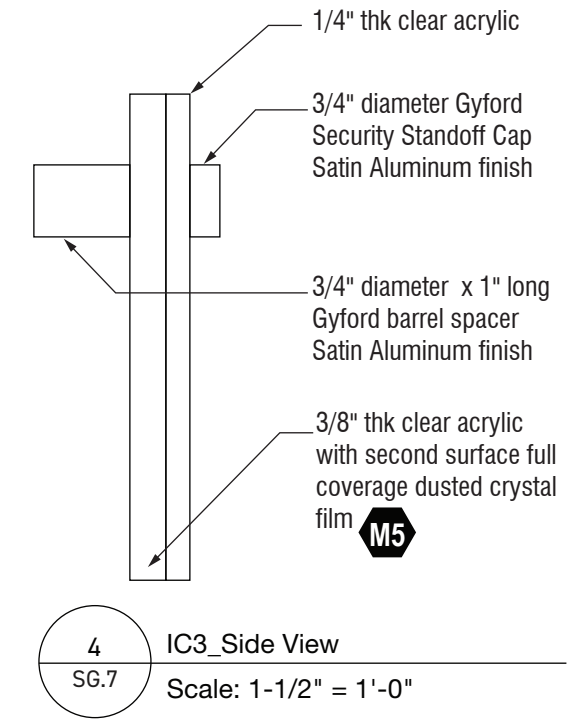

4 IC3_Side View
SG.7 Scale: 1-1/2" = 1'-0"

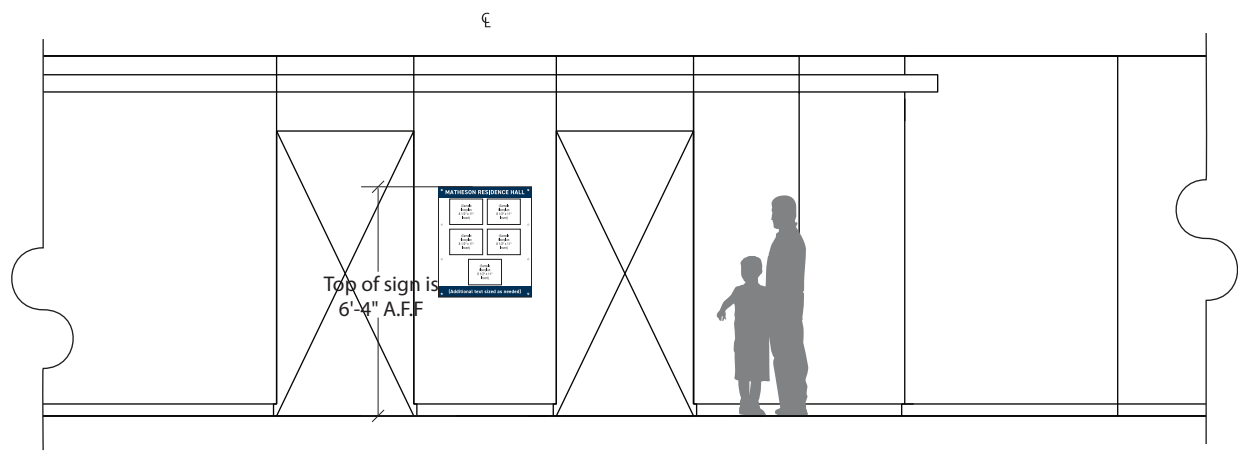

1 ST IC3 - typical Location Elevation
SG.7 Scale: 3/16" = 1'-0"

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No.	Description
1	Updated XM.1, XM.2 and XM.3

TITLE
IC3
Dormitory Wall Mounted
Floorplan Directory
DRAWING SHEET
SG.7

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE
ID1
Directional Sign -Wall Mounted


DRAWING SHEET

SG.8


Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB

Drawn by:
CB

File Path:
Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
14_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

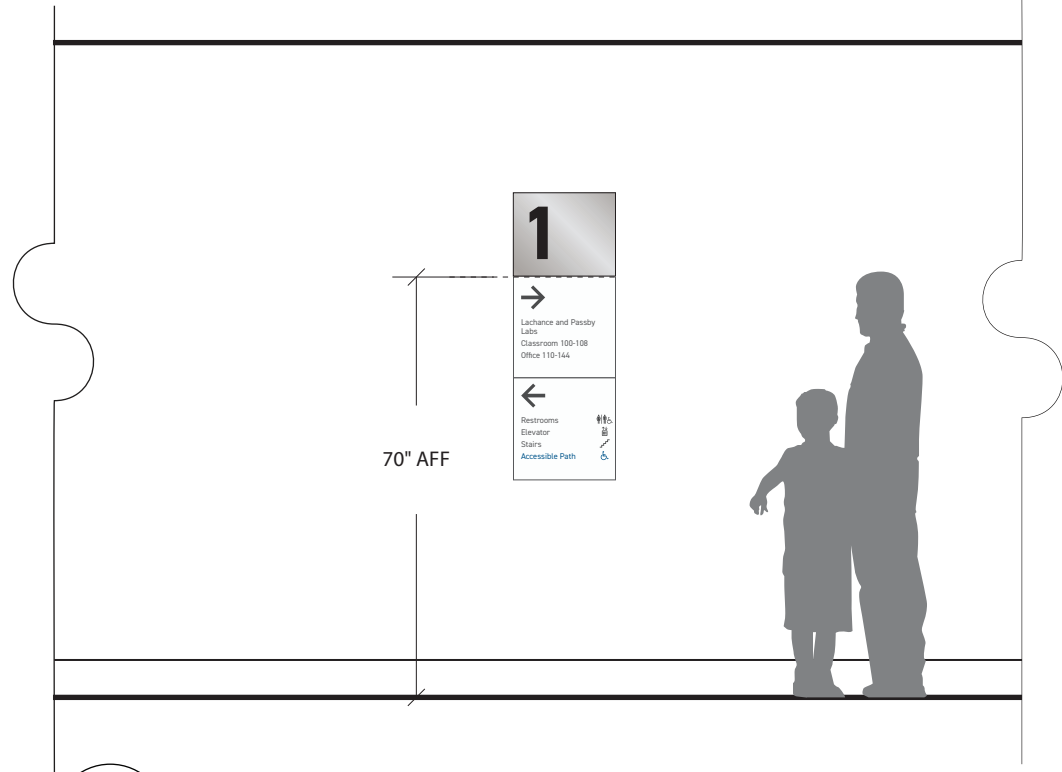


4 ST ID1 - Location Elevation
SG.8 Scale: 3/8" = 1'-0"

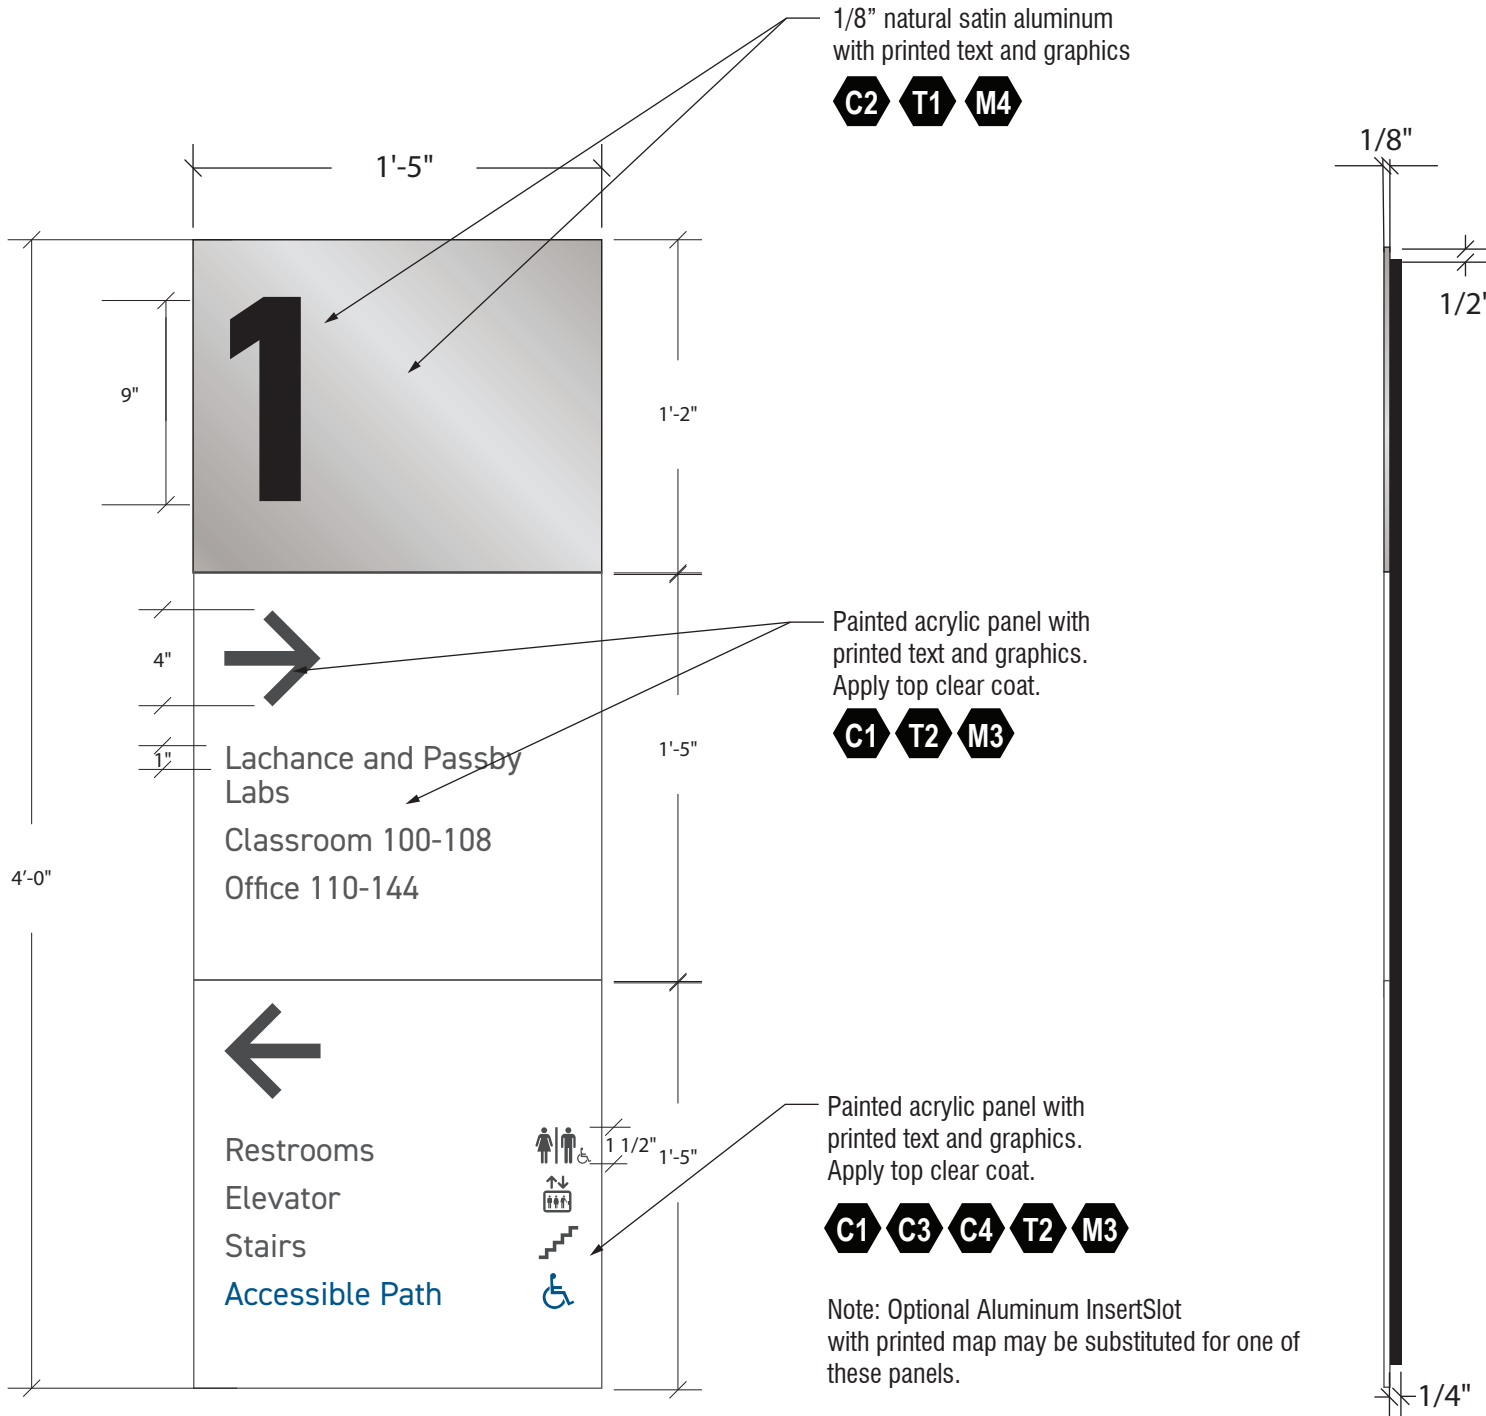

2 ST ID1 - Front Elevation
SG.8 SCALE: 1 1/2" = 1'

3 ST ID1 - Side View
SG.8 SCALE: 1 1/2" = 1'

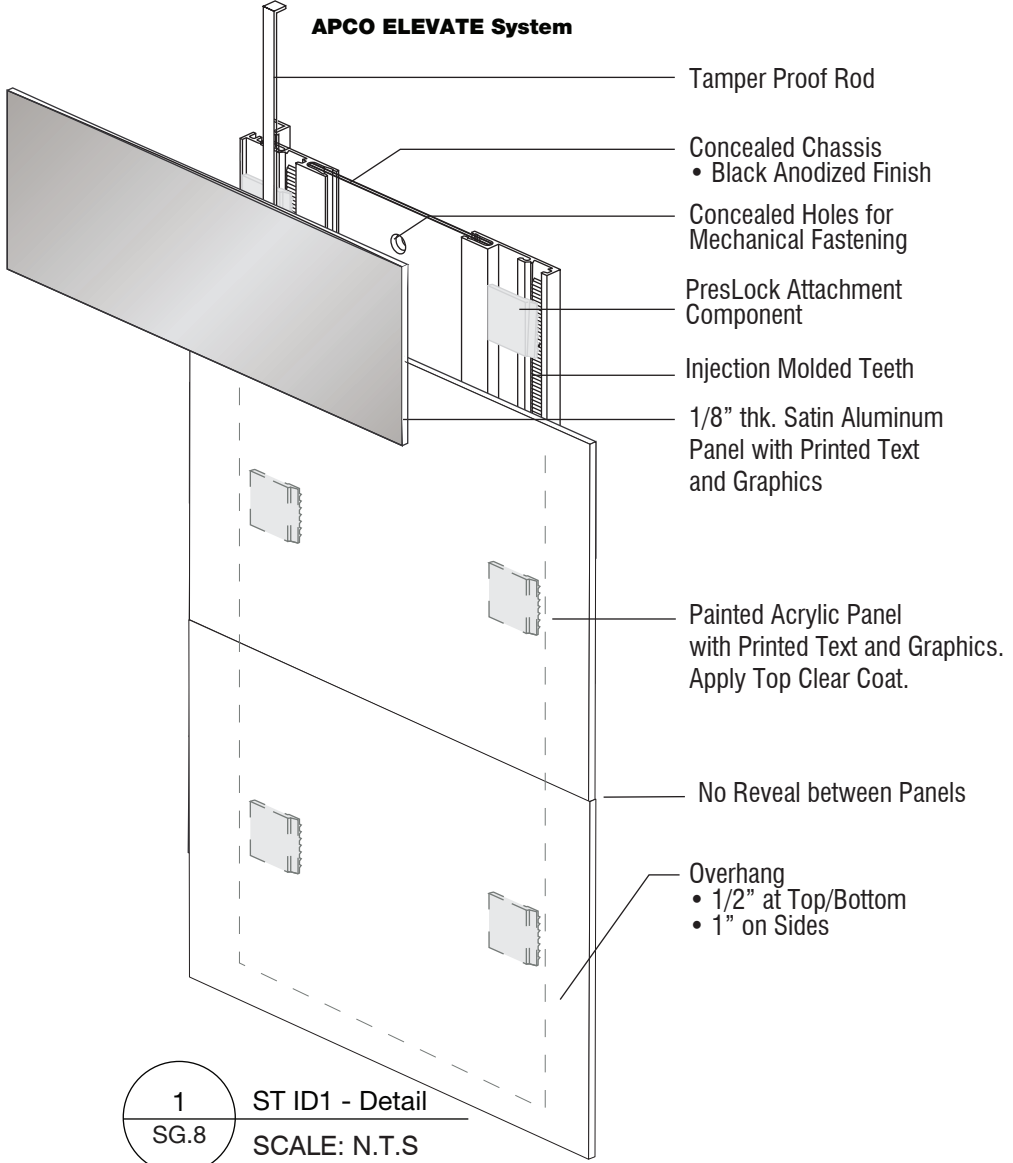

1 ST ID1 - Detail
SG.8 SCALE: N.T.S

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


ID1.1
Directional Sign - Wall Mounted - Alt Layout

DRAWING SHEET


SG.9

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding\4_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

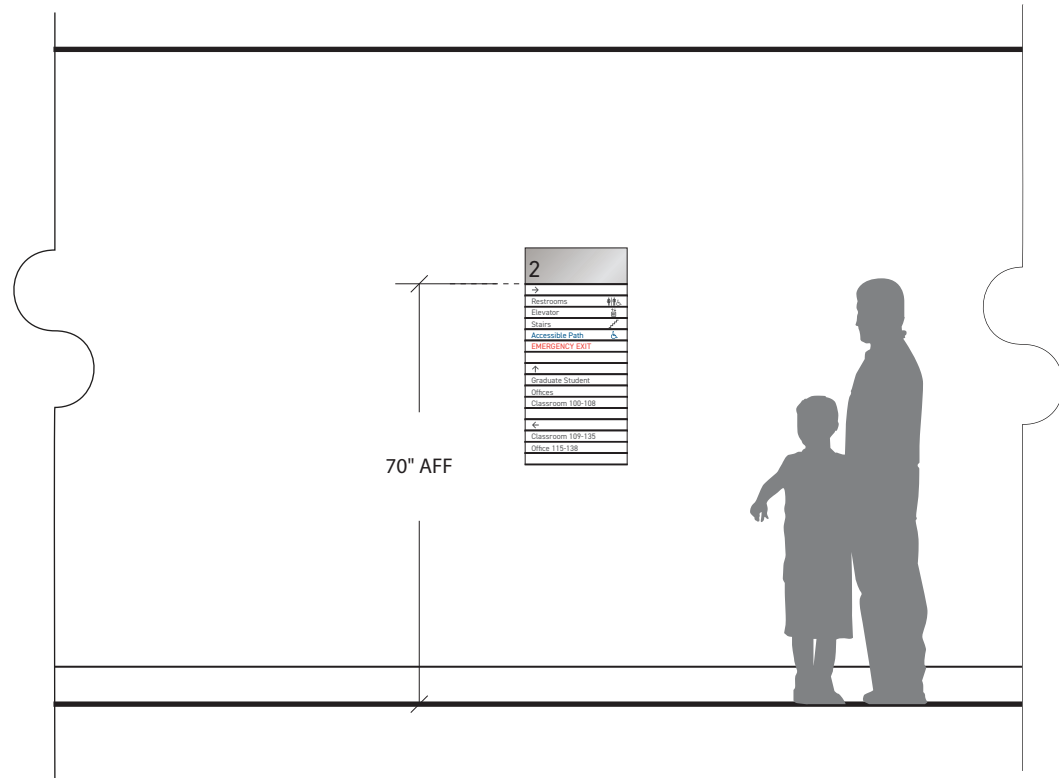

3 ST ID1.1 - Location Elevation
SG.9 Scale: 3/8" = 1'-0"

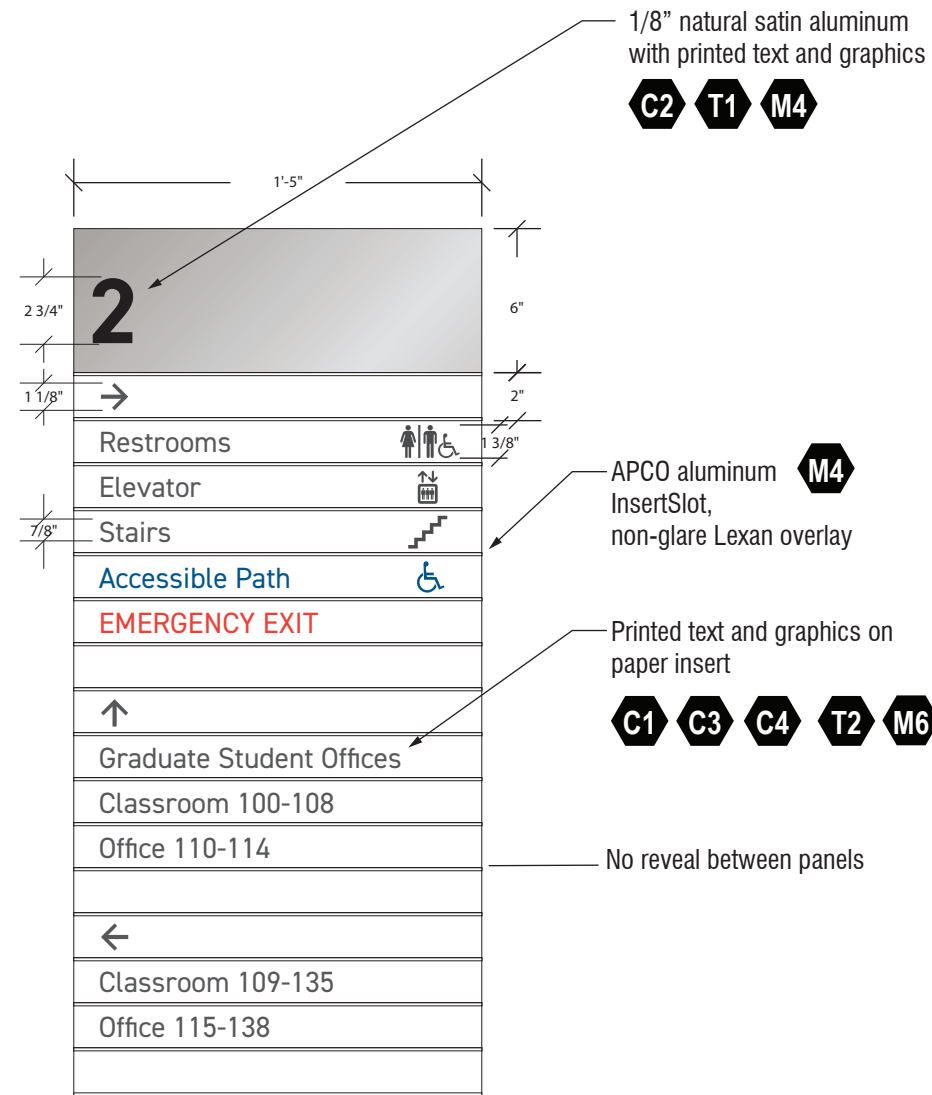

1 ST ID1.1- Alternative Layout/ Paper Inserts - Front View
SG.9 Scale: 1 1/2" = 1'

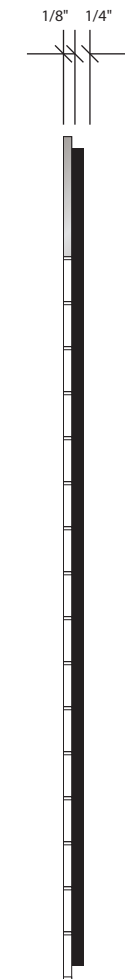

2 ST ID1.1- Sideview
SG.9 Scale: 1 1/2" = 1'

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
ID2
Directional Sign - Overhead

DRAWING SHEET


SG.10

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB

File Path:
 Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

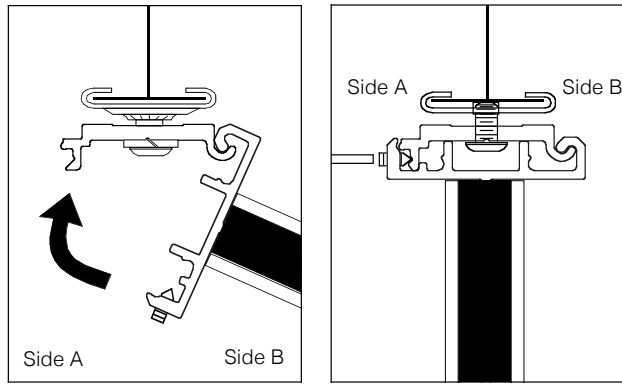


5 ST ID2 - Details
 SG.10 Scale: 3/8" = 1'-0"

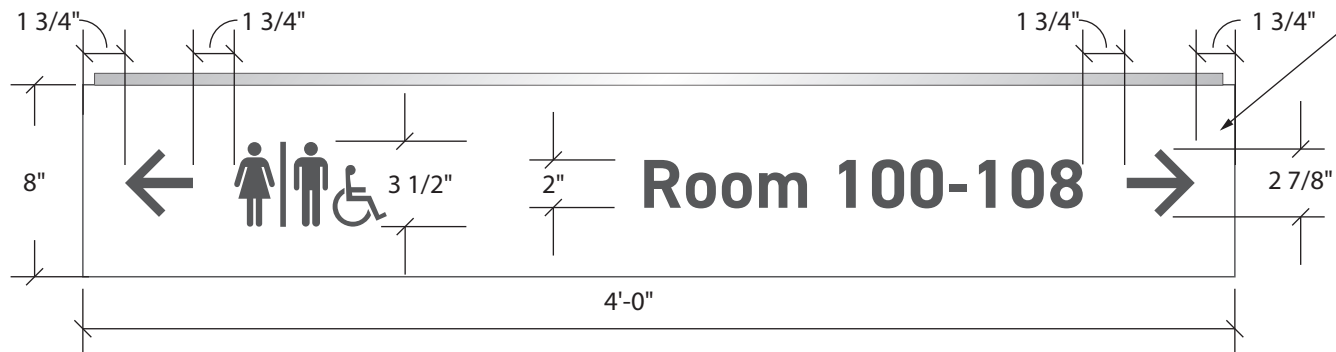


Painted acrylic panel with
 printed graphics and text.
 Apply clear top coat.


C1 T1 M3

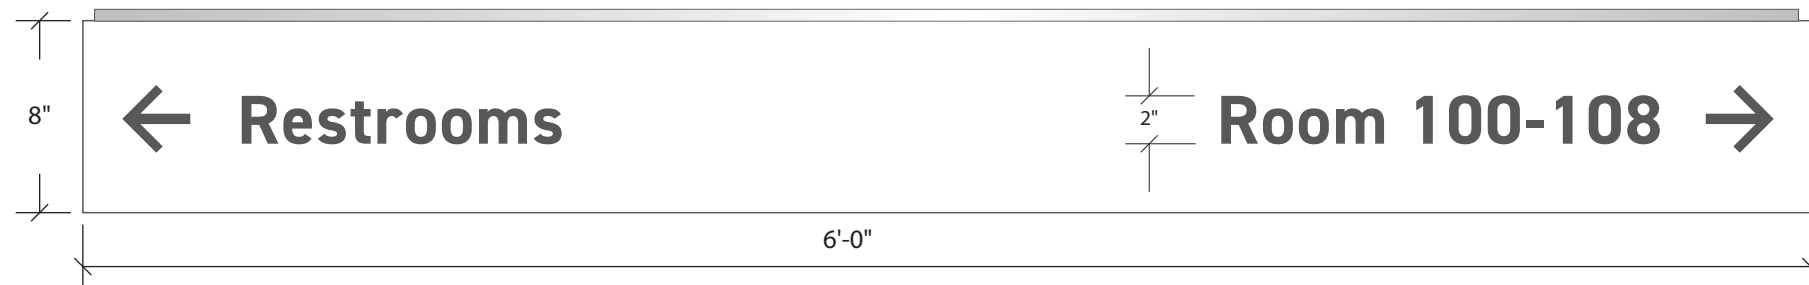


3 ST ID2 - Front Elevation
 SG.10 Scale: 1 1/2" = 1'-0"

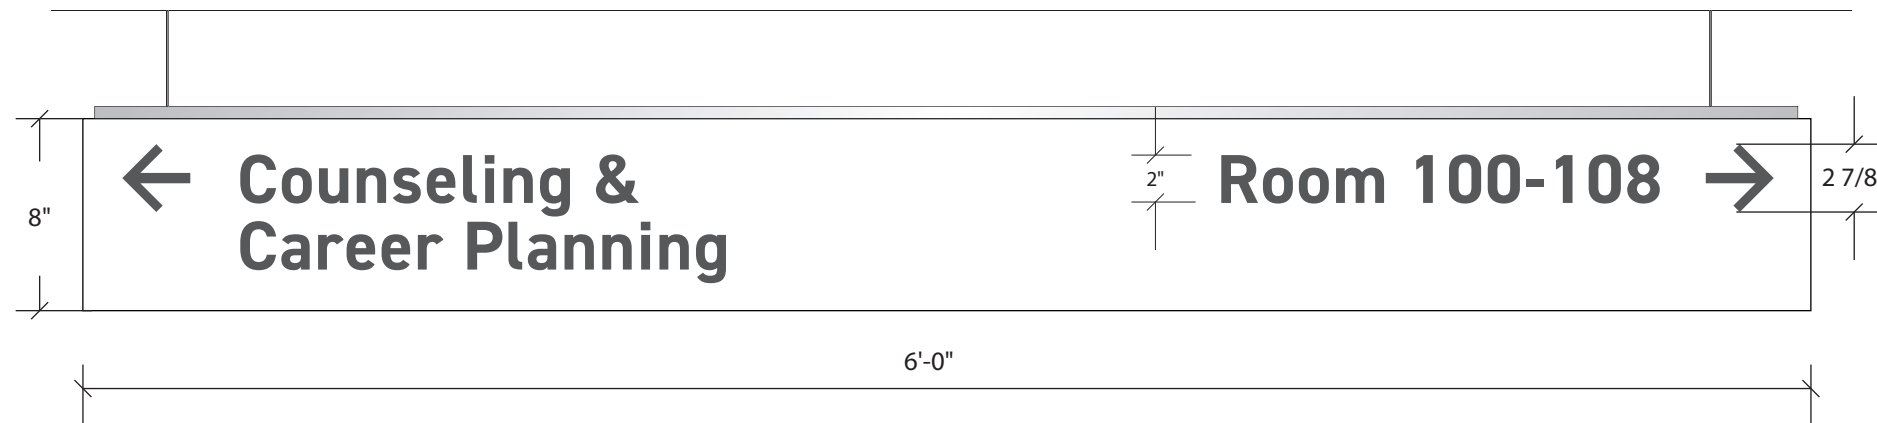


1 ST ID2 - Front Elevation
 SG.10 Scale: 1 1/2" = 1'-0"

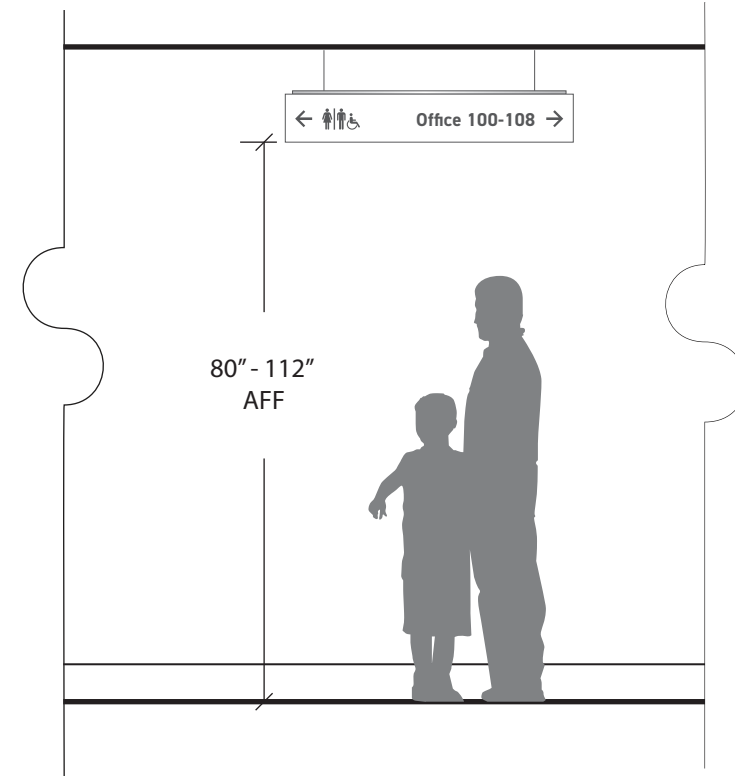

4 ST ID2 - Location Elevation
 SG.10 Scale: 3/8" = 1'-0"

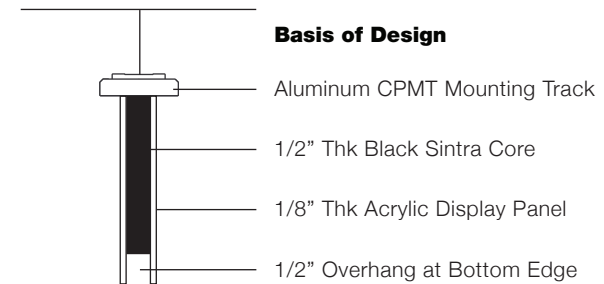

2 ST ID2 - Side View
 SG.10 Scale: 1 1/2" = 1'-0"

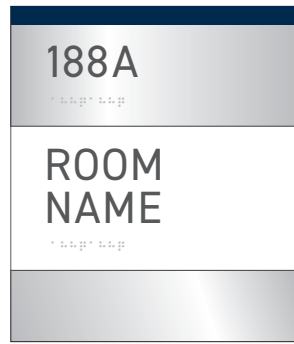

ADA Panel w/ Color Stripe_ - Color TBD




ADA Panel_Room Number with Department name




ADA Panel w/ Logo

NOTE: GT TO PICK THE OPTION PER SPECIFIC BUILDING, LOGO TO PROVIDE BY GT

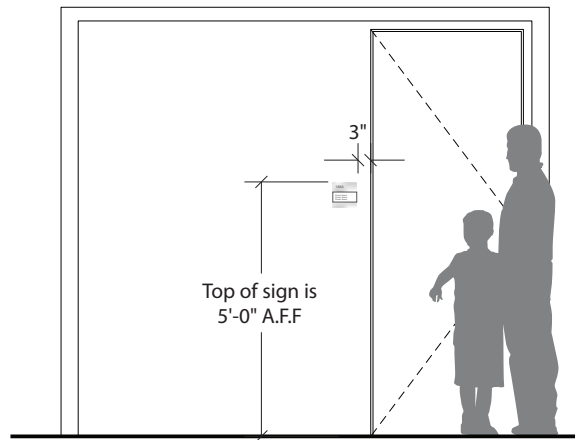


5 ST IE1_ADA Plaque - Exterior_Elevation
SG.11 Scale: 1/4" = 1'-0"

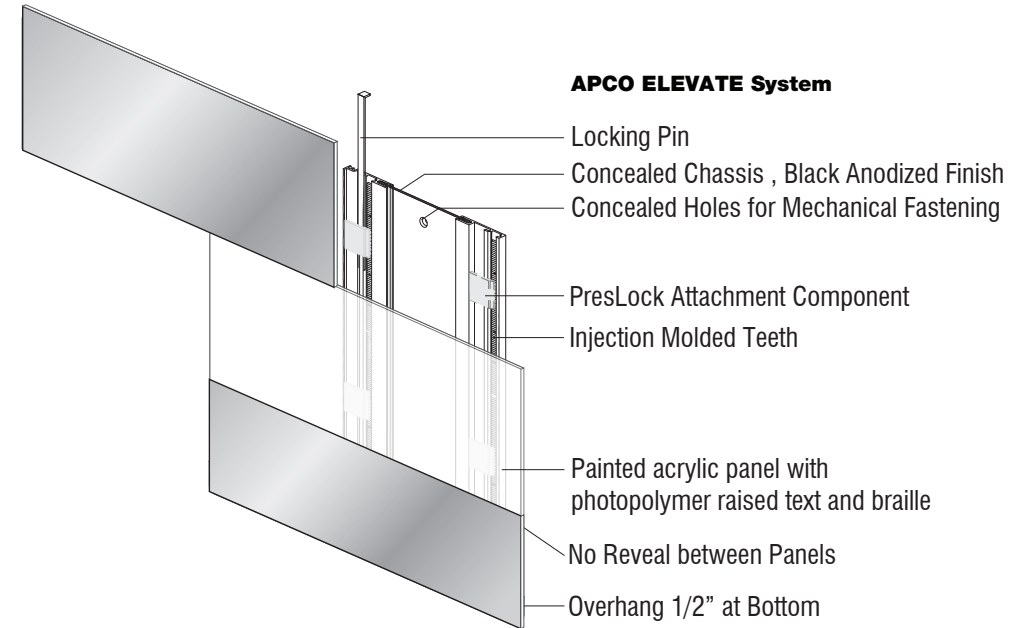


6 ST IE1_Detail
SG.11 Scale: N.T.S


4 Alt Graphic Panel
SG.11 Scale: 3" = 1'

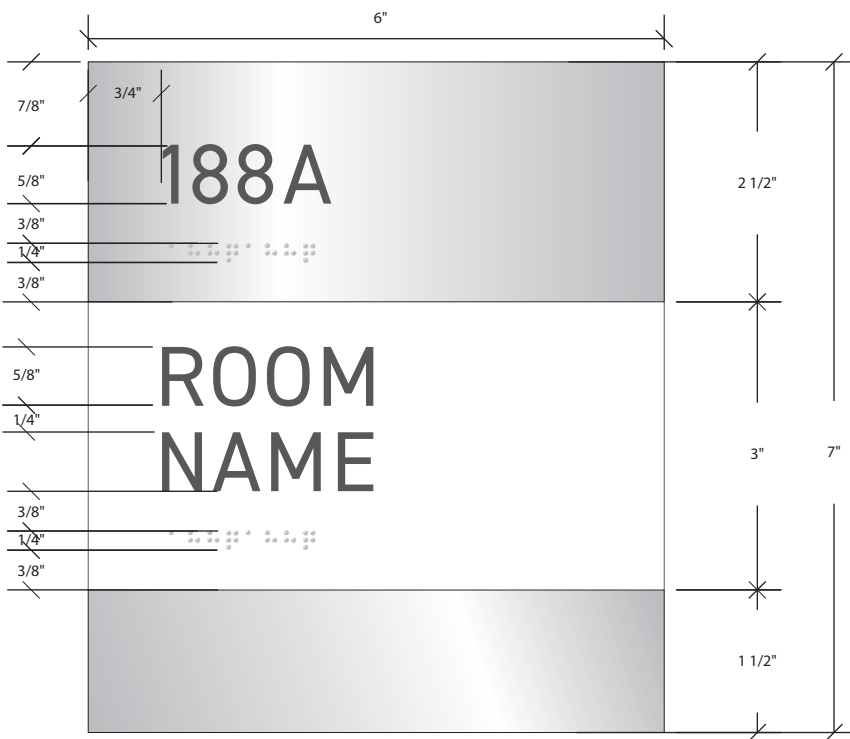

1 ST IE1_ADA Plaque - Interior_Front Elevation
SG.11 Scale: 1:2

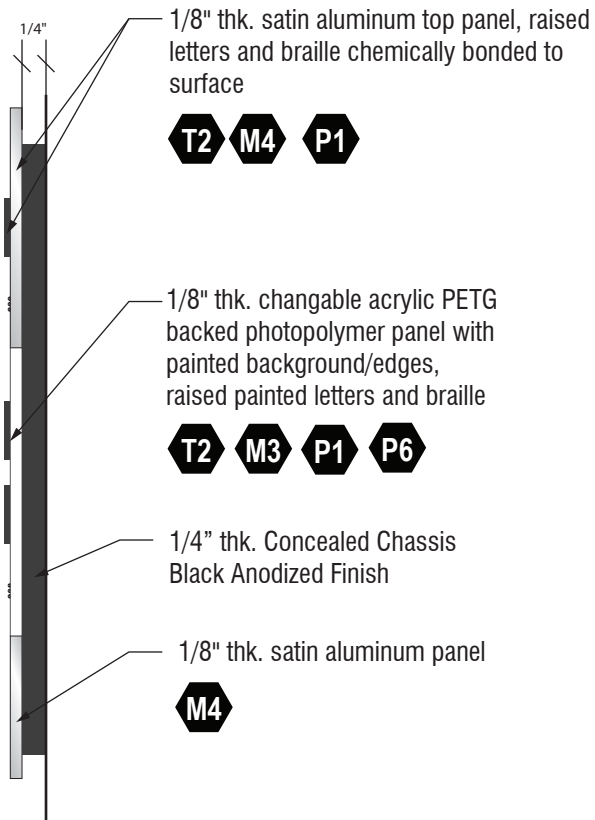

2 ST IE1_Side View
SG.11 Scale: 1:2

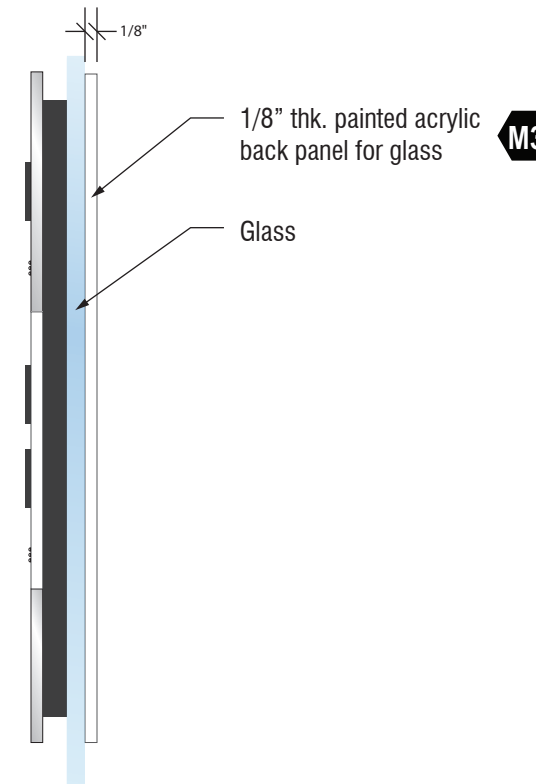

3 ST IE1_On Glass_Side View
SG.11 Scale: 1:2

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description


1 Updated XM.1, XM.2 and XM.3

TITLE
IE1
ADA Plaque - Room
Name Sign Type 1


DRAWING SHEET

SG.11

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

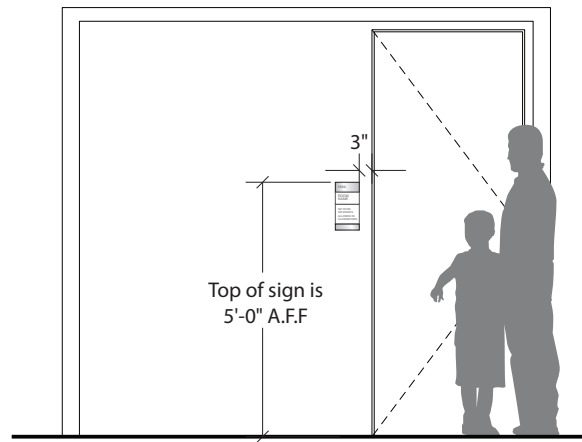

4 ST IE1.1_Location Elevation
 SG.11.1 Scale: 1/4" = 1'-0"

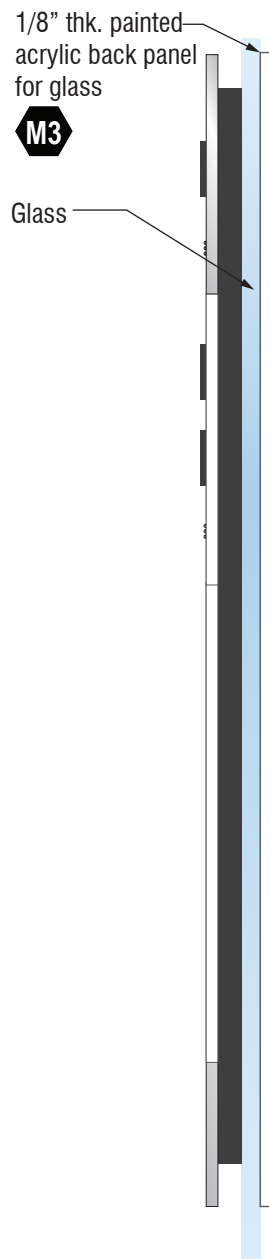

1 ST IE1.1_On Glass_Side View
 SG.11.1 Scale: 1:2

APCO ELEVATE System

1/8" thk. satin aluminum panel, raised letters and braille chemically bonded to surface



Potential graphics, letters color, logo place hold for specific building or department.

1/8" thk. changable acrylic PETG backed photopolymer panel with painted background/edges, raised painted letters and braille



1/4" thk. Concealed Chassis Black Anodized Finish


1/8" thk. changable acrylic panel with painted background/edges, printed text and graphics



1/8" thk. satin aluminum panel



2 ST IE1.1_Side View
 SG.11.1 Scale: 1:2

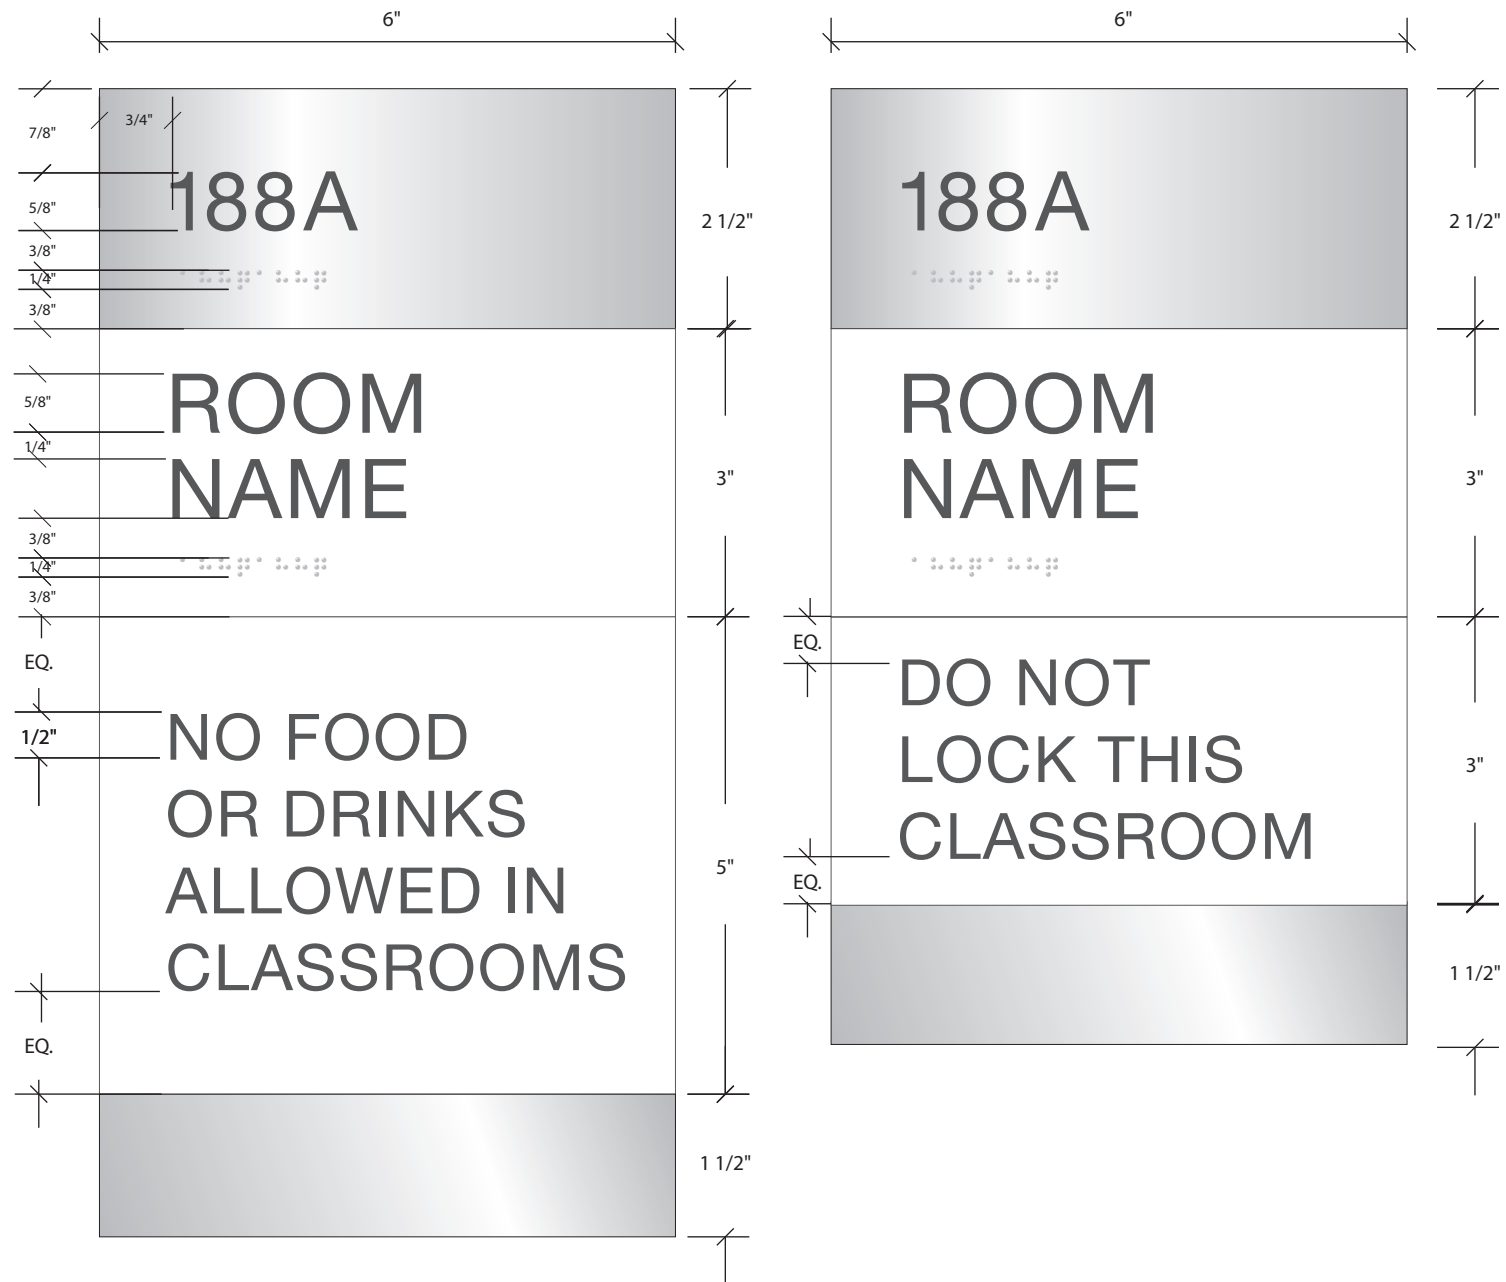

3 ST IE1.1_Additional Message Panel- Front Elevation
 SG.11.1 Scale: 1:2

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE
IE1.1
ADA Plaque - Room Name
Sign with Add. Message


DRAWING SHEET

SG.11.1


Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB



NOTE: GT TO PICK THE OPTION PER SPECIFIC BUILDING, LOGO TO PROVIDE BY GT

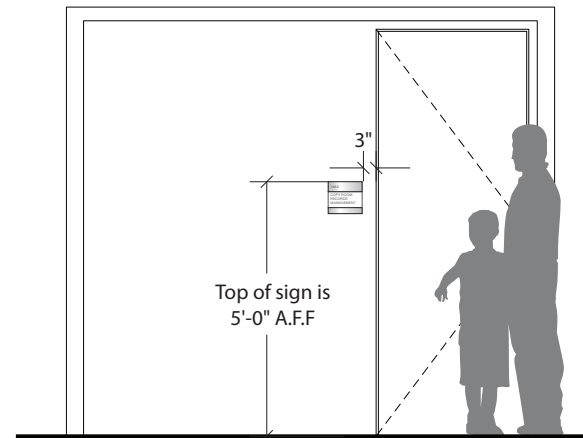


6 ST IE1.2_Location Elevation
SG.11.2 Scale: 1/4"=1'-0"

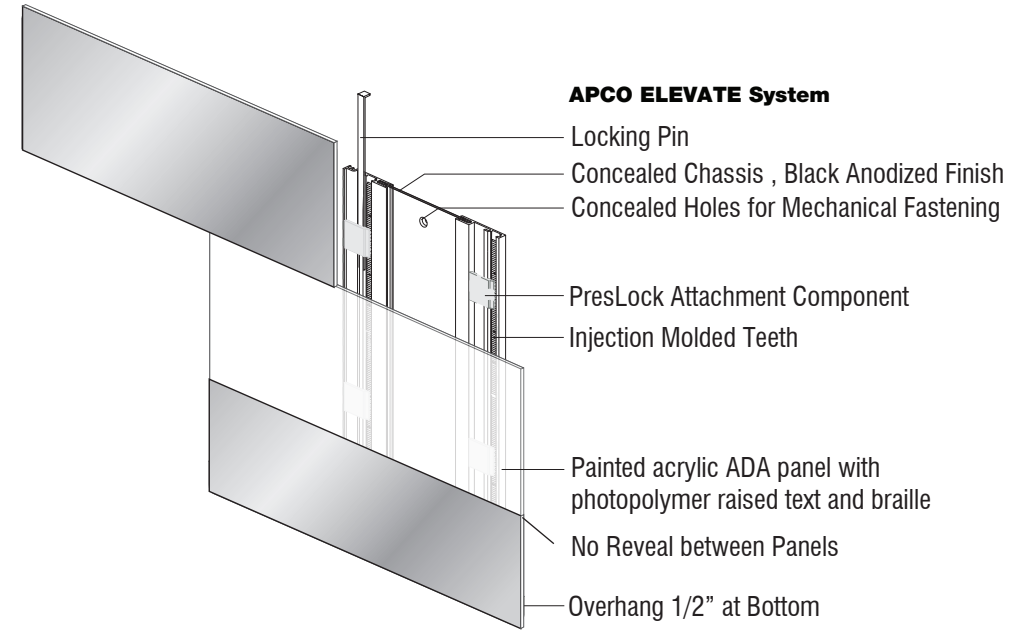


7 ST IE1.2_Detail
SG.11.2 Scale: N.T.S


5 Alt Graphic Panel
SG.11.2 Scale: 3"=1'-0"

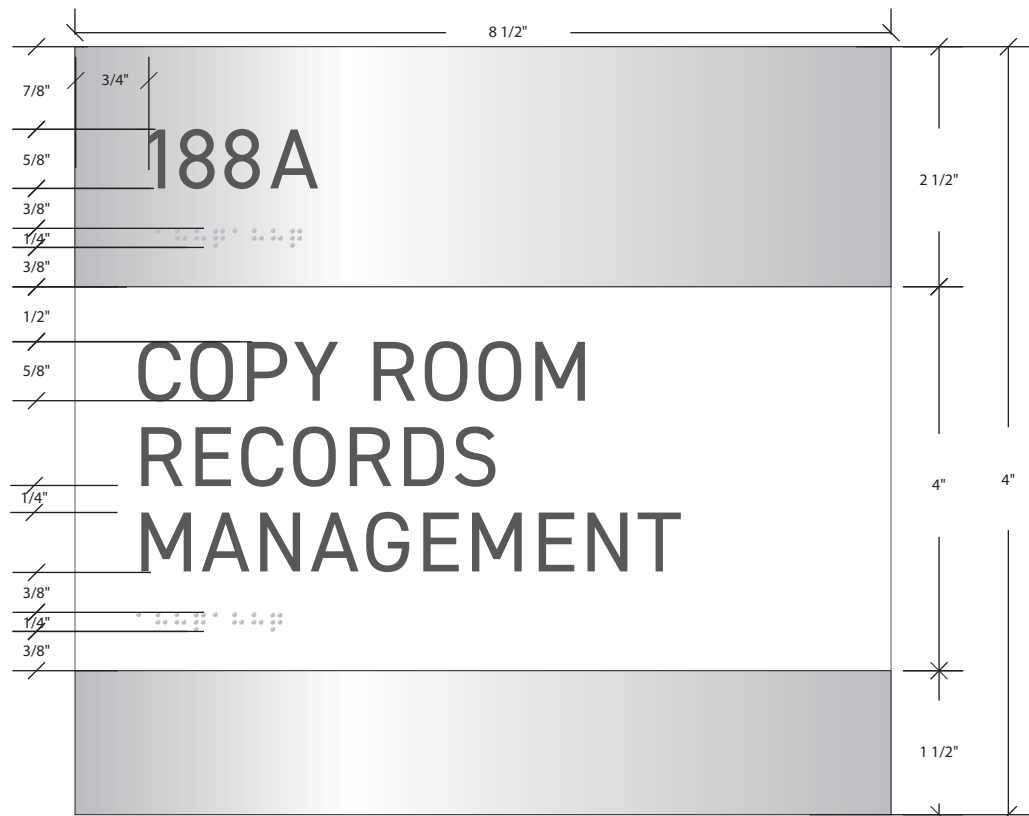


1 ST IE1.2_Front Elevation
SG.11.2 Scale: 1:2

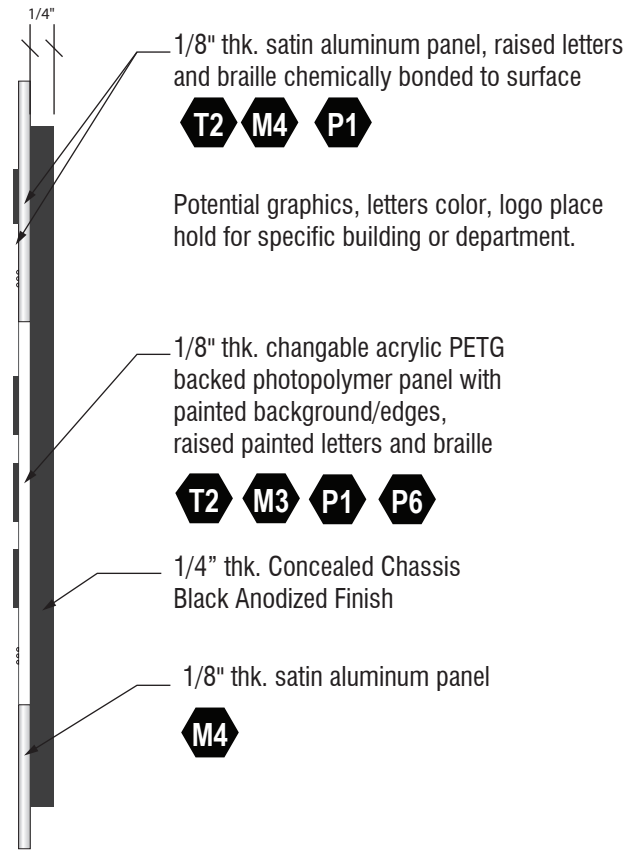

2 ST IE1.2_Side View
SG.11.2 Scale: 1:2

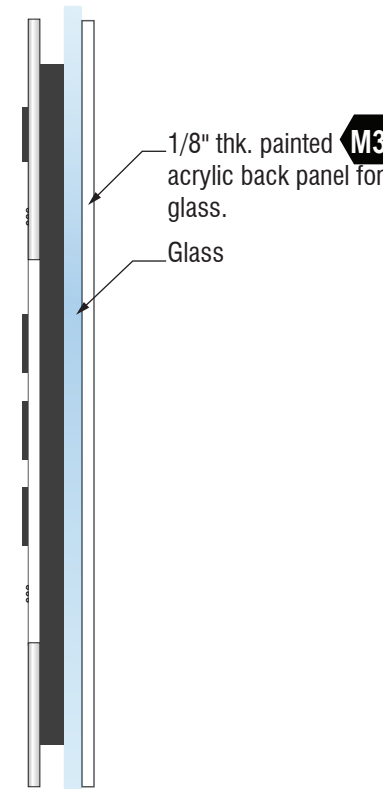

3 ST IE1.2_On Glass_Side View
SG.11.2 Scale: 1:2

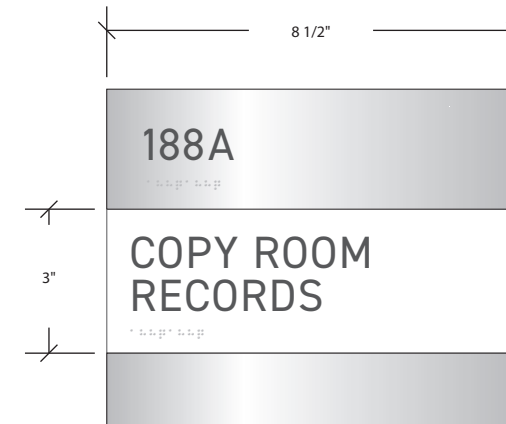

4 Alternate Size ADA Panel
SG.11.2 Scale: 3"=1'-0"

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024


Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
IE1.2
ADA Plaque - Room
Name Sign Type 2

DRAWING SHEET
SG.11.2

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

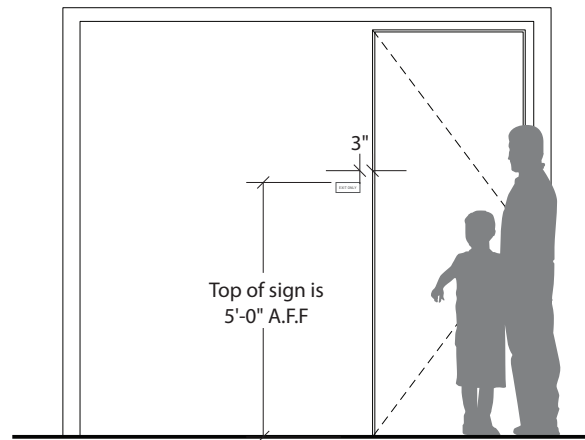

3 ST IE1.3_Location Elevation
 SG.11.3 Scale: 1/4"=1'

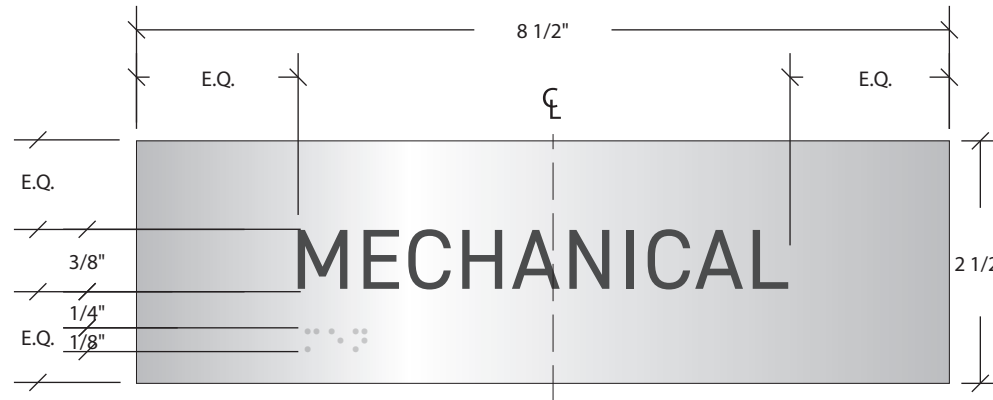

4 ST IE1.3_Alternate Size
 SG.11.3 Scale: 1:2

1/8" thk. satin aluminum panel with applied text and braille chemically bonded to surface

M3 C1 T2

*Alt. - 1/8" thk. painted acrylic panel with photopolymer text and braille (for back of house areas)

T2 M3 P1 P6




*Alt. - 1/8" thk. painted acrylic panel with photopolymer text and braille (for back of house areas)

T2 M3 P1 P6



1/8" thk. satin aluminum panel with applied text and braille chemically bonded to surface

M3 C1 T2

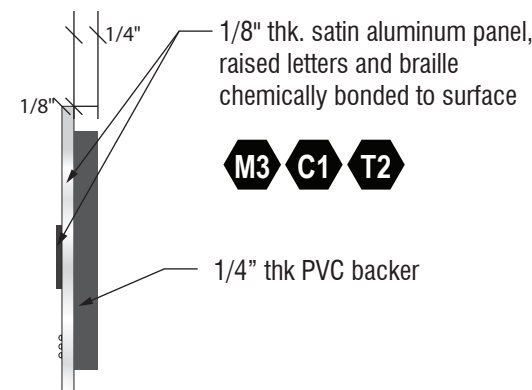

1/8" thk. satin aluminum panel, raised letters and braille chemically bonded to surface

M3 C1 T2

1/4" thk PVC backer

1 ST IE1.3_Front Elevation
 SG.11.3 Scale: 1:2

2 ST IE1.3_Side View
 SG.11.3 Scale: 1:2

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE

IE1.3
 ADA Plaque - Room Name
 Sign Type 3


DRAWING SHEET

SG.11.3

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB

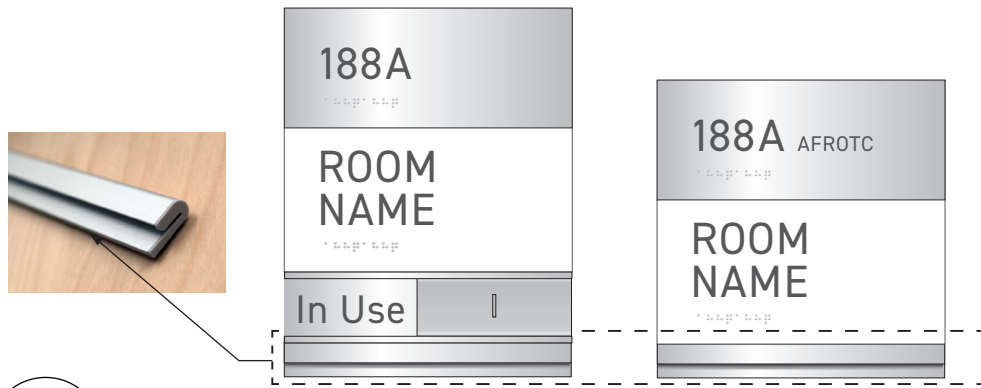


5 Alt Sign Feature
SG.12
Scale: 3"=1'

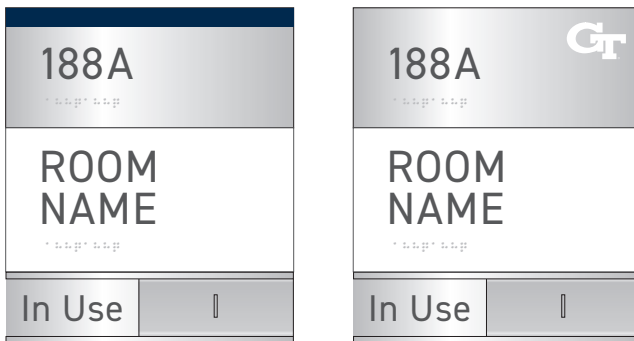


4 Alt Graphic Panel / Alt Room Name Layout
SG.12
Scale: 3"=1'


NOTE: GT TO PICK THE OPTION PER SPECIFIC BUILDING, LOGO TO PROVIDE BY GT

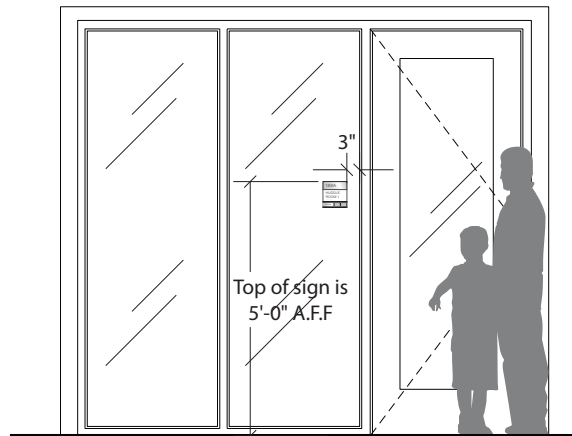


5 ST IE2_ADA Plaque - Meeting_Elevation
SG.12
Scale: 1/4"=1'

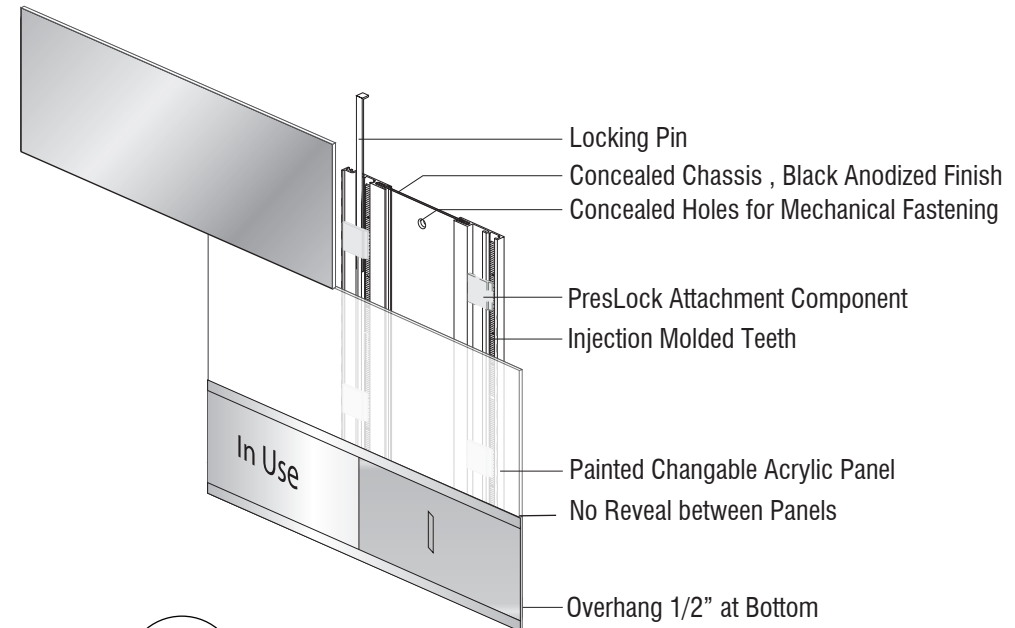


6 ST IE2_Detail
SG.12
Scale: N.T.S

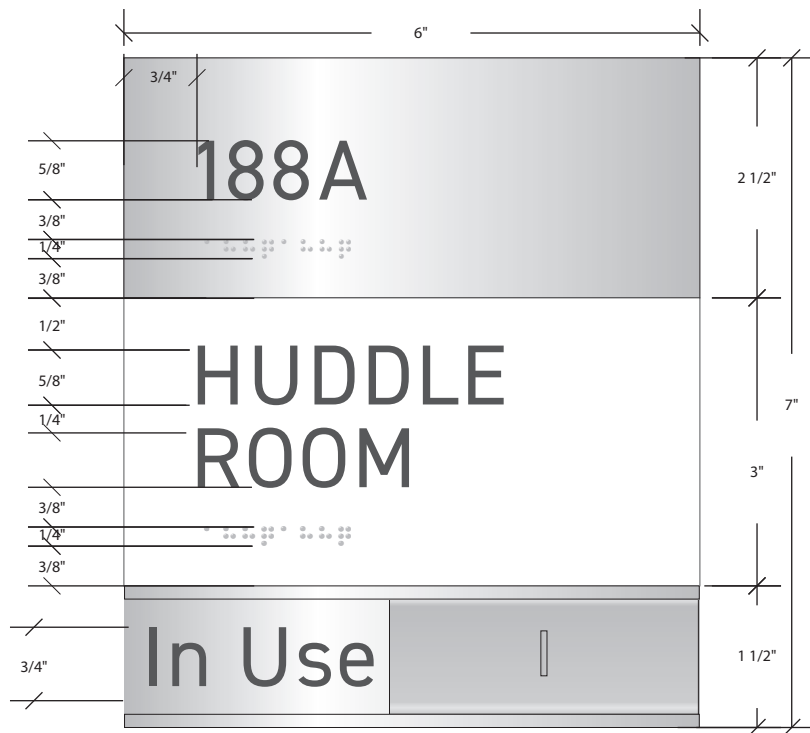

1 ST IE2_ADA Plaque - Meeting_Front Elevation
SG.12
Scale: 1:2

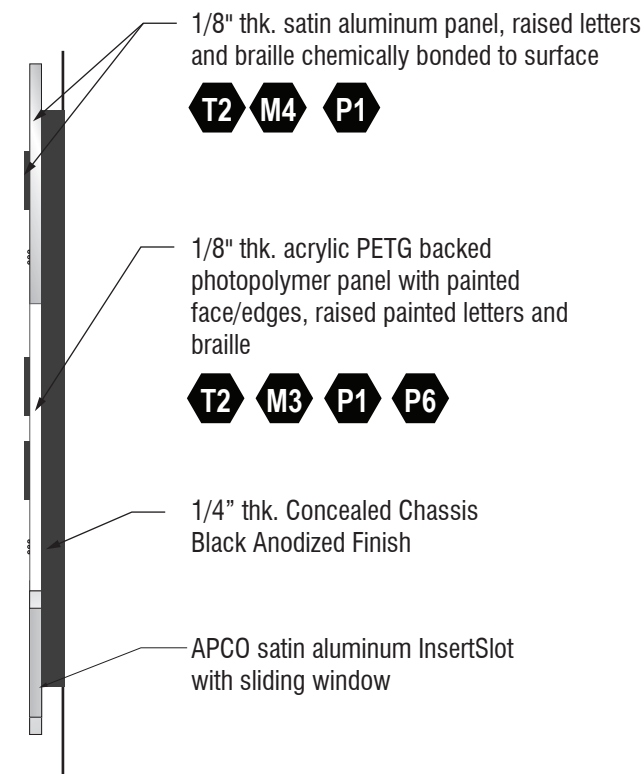

2 ST IE2_ADA Plaque - Meeting_Side View
SG.12
Scale: 1:2

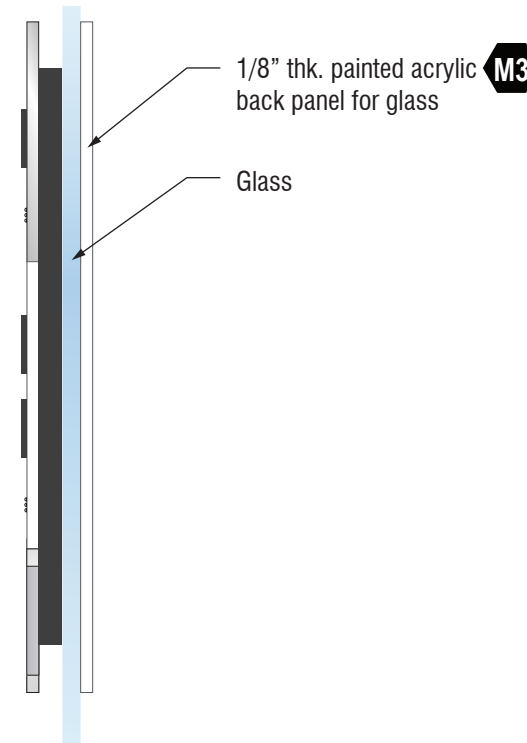

3 ST IE2_On Glass_Side View
SG.12
Scale: 1:2

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE
IE2
ADA Plaque - Meeting

DRAWING SHEET

SG.12

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
IE3
ADA Plaque - Changeable Insert

DRAWING SHEET


SG.13

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL14\X24\XXX14AC240033_Design14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

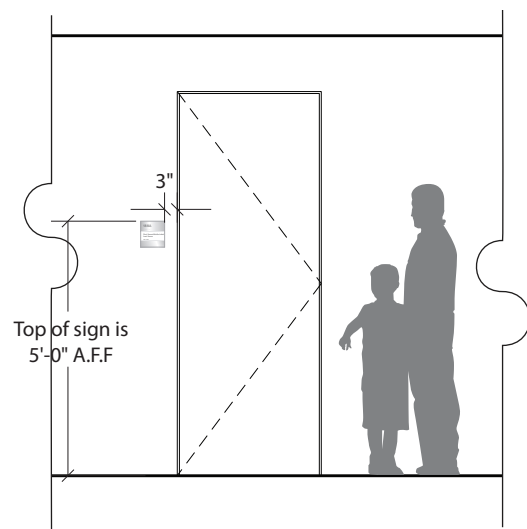


5 ST IE3_Location Elevation
SG.13 Scale: 1/4"=1'-0"

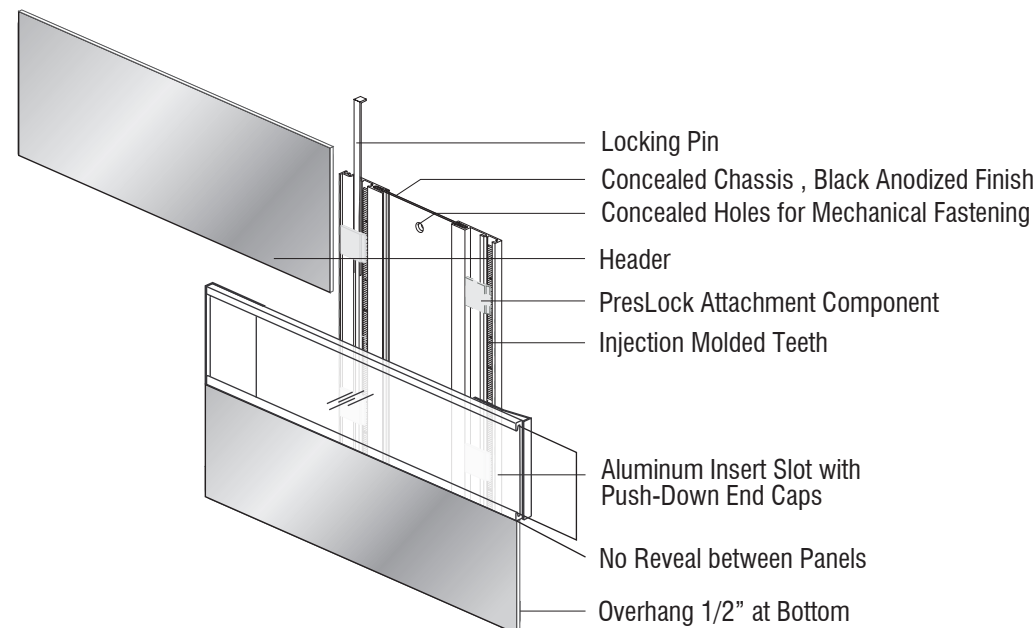


6 ST IE3_Detail
SG.13 Scale: N.T.S

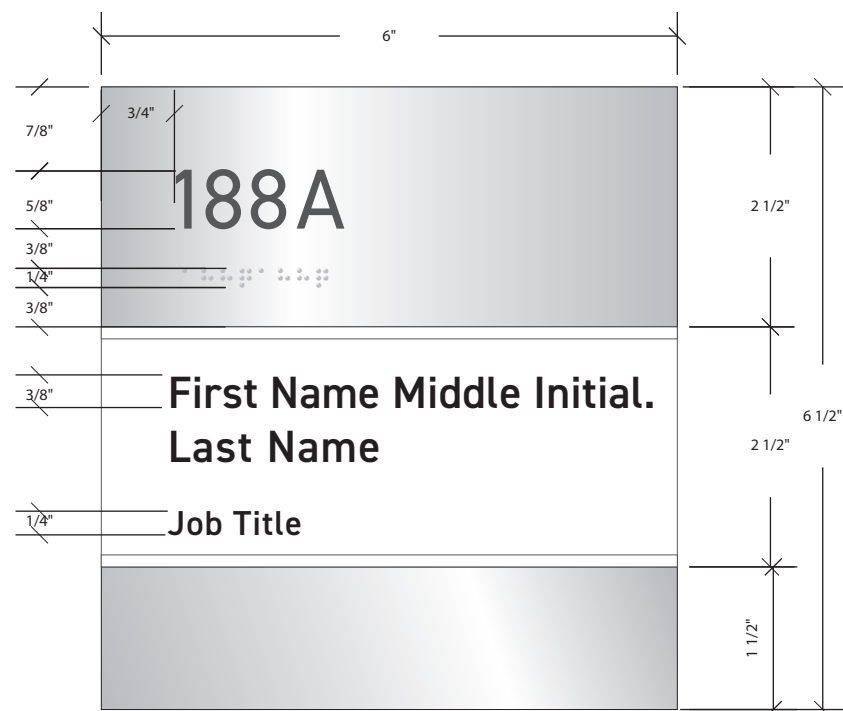

1 ST IE3_ADA Plaque - Changeable Insert_Front Elevation
SG.13 Scale: 1:2

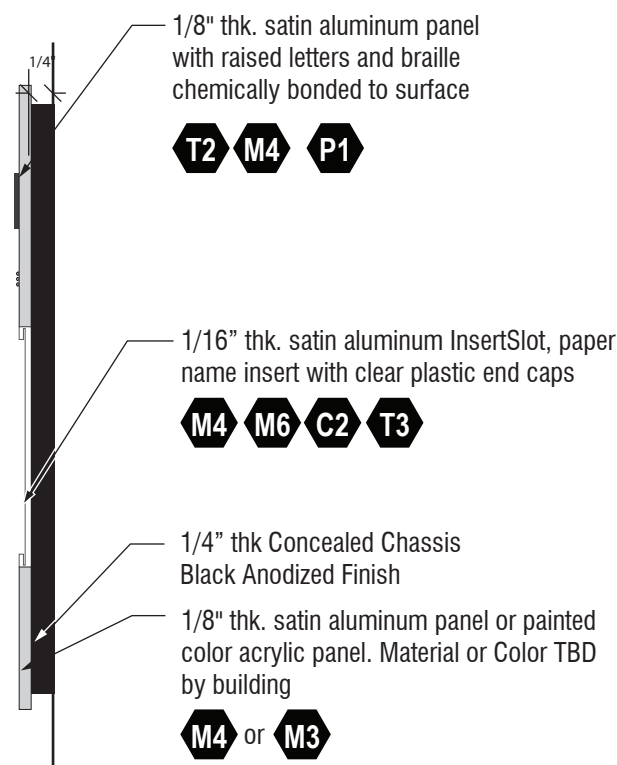


2 ST IE3_Side View
SG.13 Scale: 1:2

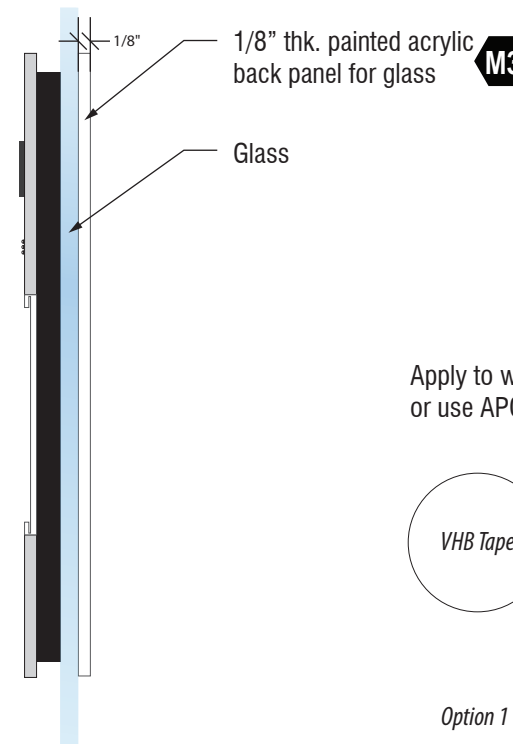

3 ST IE3_On Glass_Side View
SG.13 Scale: 1:2

Apply to wall with VHB tape, mechanical fastener or use APCO panel clip for work stations.

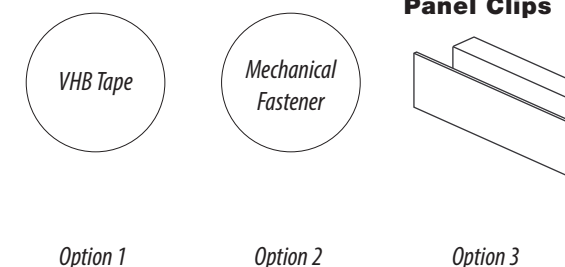

4 Alt Mounted Details
SG.13 Scale: N.T.S.

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

IE3
ADA Plaque - Changeable
Insert_Alt Layout


DRAWING SHEET

SG.13.1


Principal-In-Charge:
David Deis
 Project Manager:
CB/PN
 EGD Designers:
CB
 Drawn by:
CB

File Path:
Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021


NOTE: GT TO PICK THE OPTION PER SPECIFIC BUILDING, LOGO TO PROVIDE BY GT

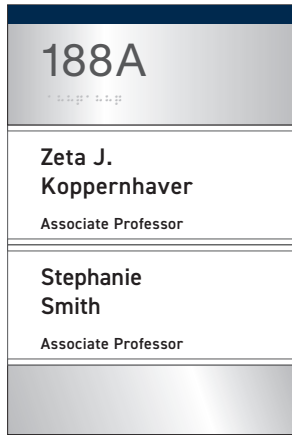


ADA Panel w/ Color Stripe_-
Color TBD

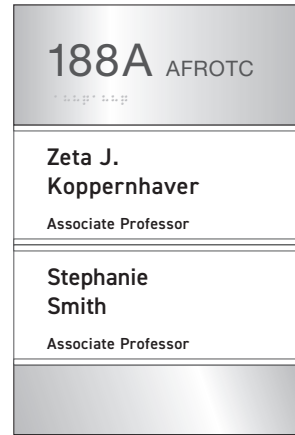

ADA Panel_Room Number
with Department name

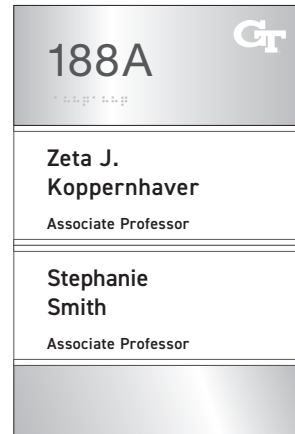


ADA Panel w/ Logo

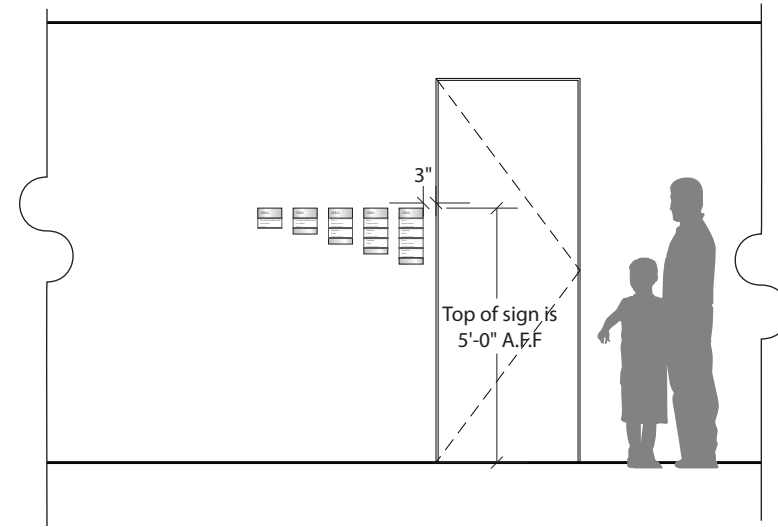


3 ST IE3_Location Elevation
 SG.13.1 Scale: 1/4" = 1'-0"


2 ST IE3_Alt Layout and Color
 SG.13.1 Scale: 3" = 1'

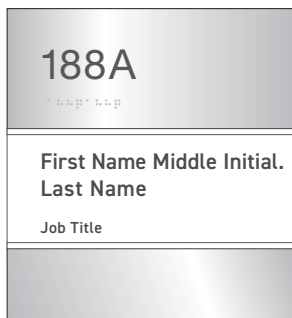


1 Insert

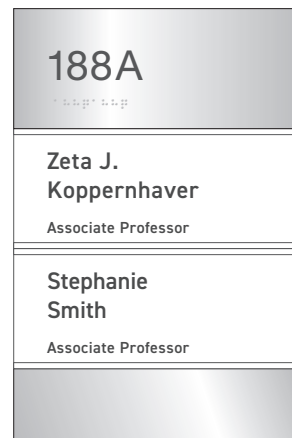

2 Inserts



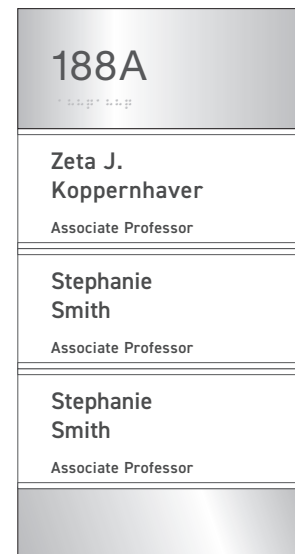


3 Inserts

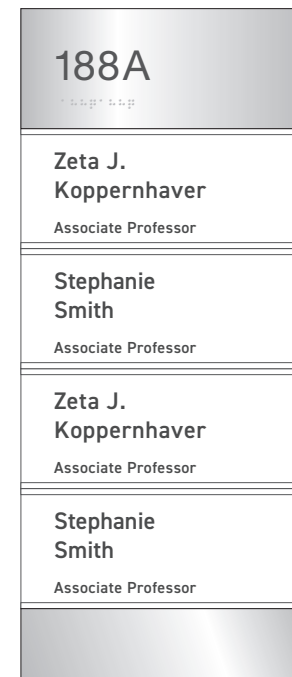

4 Inserts


1 ST IE3_Alt Layouts
 SG.13.1 Scale: 3" = 1'

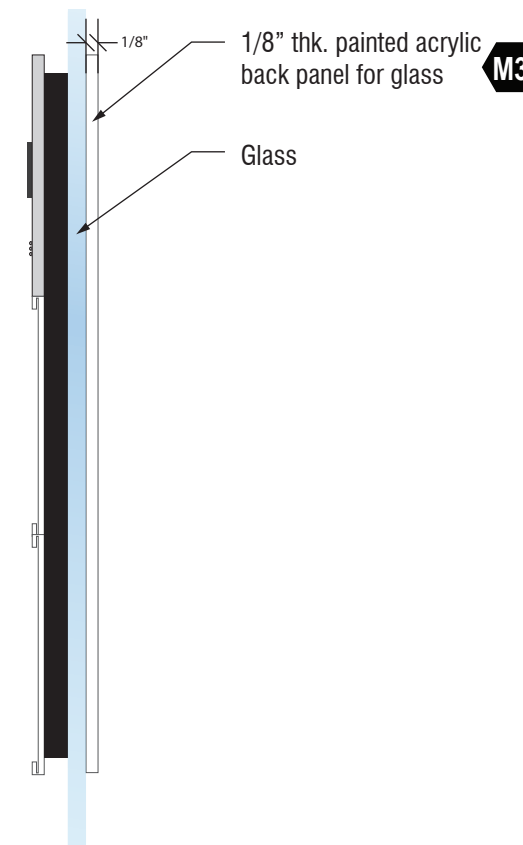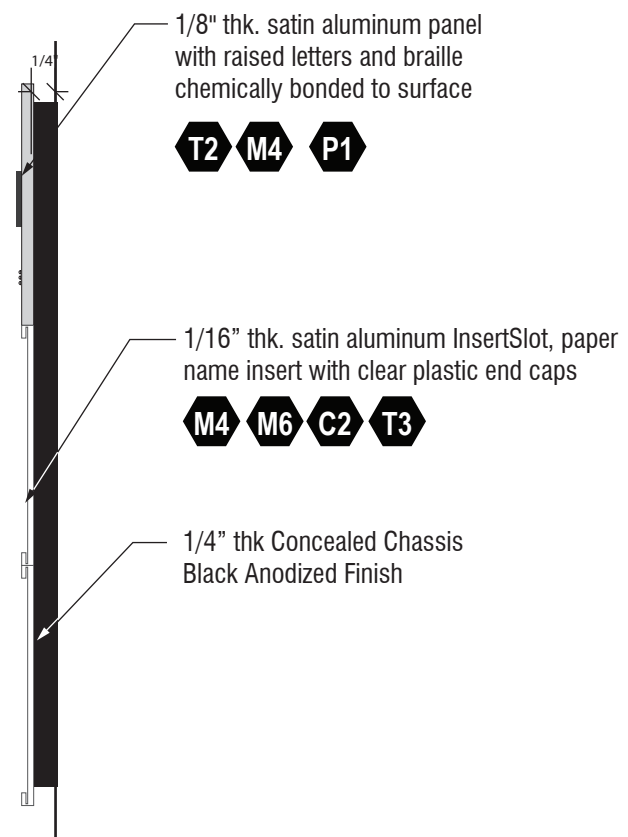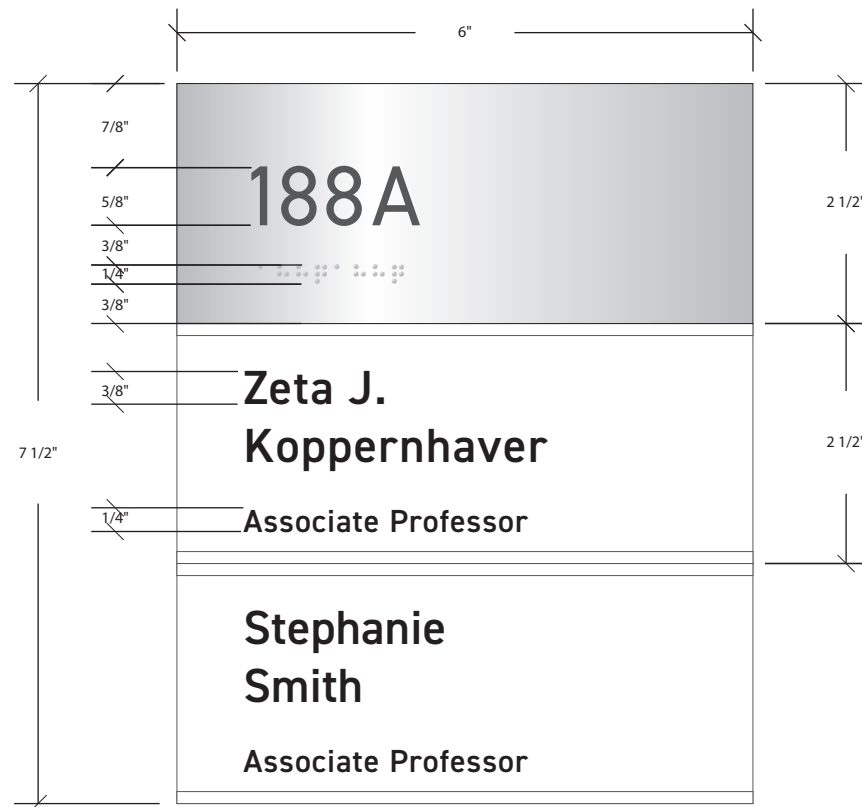


3 ST IE3.1_ADA Plaque Alternative for workstation (without overhang)
SG.13.2 Scale: 1:2

4 ST IE3.1_ADA Plaque Alternative - Side View
SG.13.2 Scale: 1:2

5 ST IE3.1_ADA Plaque Alternative _On Glass_Side View
SG.13.2 Scale: 1:2




Option 1



Option 2

Panel Clips



Option 2

EVPC

.040" satin anodized formed aluminum panel clips for 6" or 8-1/2" Elevate signs up to 5" in height



1 Alt Mounted Details
SG.13.2 Scale: N.T.S.

2 ST IE3.1_ADA Plaque Alternative for workstation with no names
SG.13.2 Scale: 1:2

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

IE3.1
ADA Plaque - Changeable
Insert_No Overhang

DRAWING SHEET

SG.13.2

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3


TITLE
IF1
ADA Plaque - Pictogram

DRAWING SHEET


SG.14

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL\14AC24003\14AC24003_Design\14_Graphics_Branding
H_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

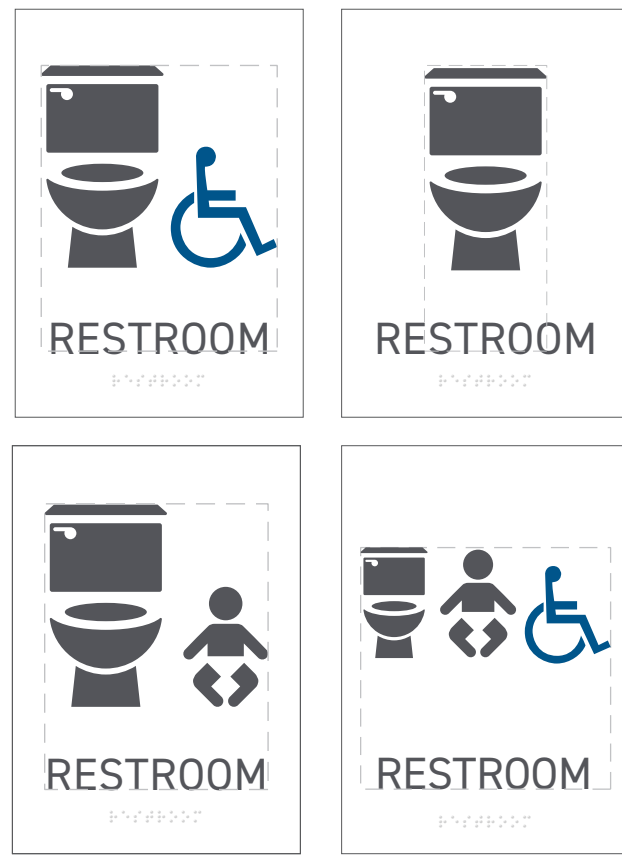


5 ST IF1_ Gender Neutral layouts
SG.14 Scale: 3"=1'

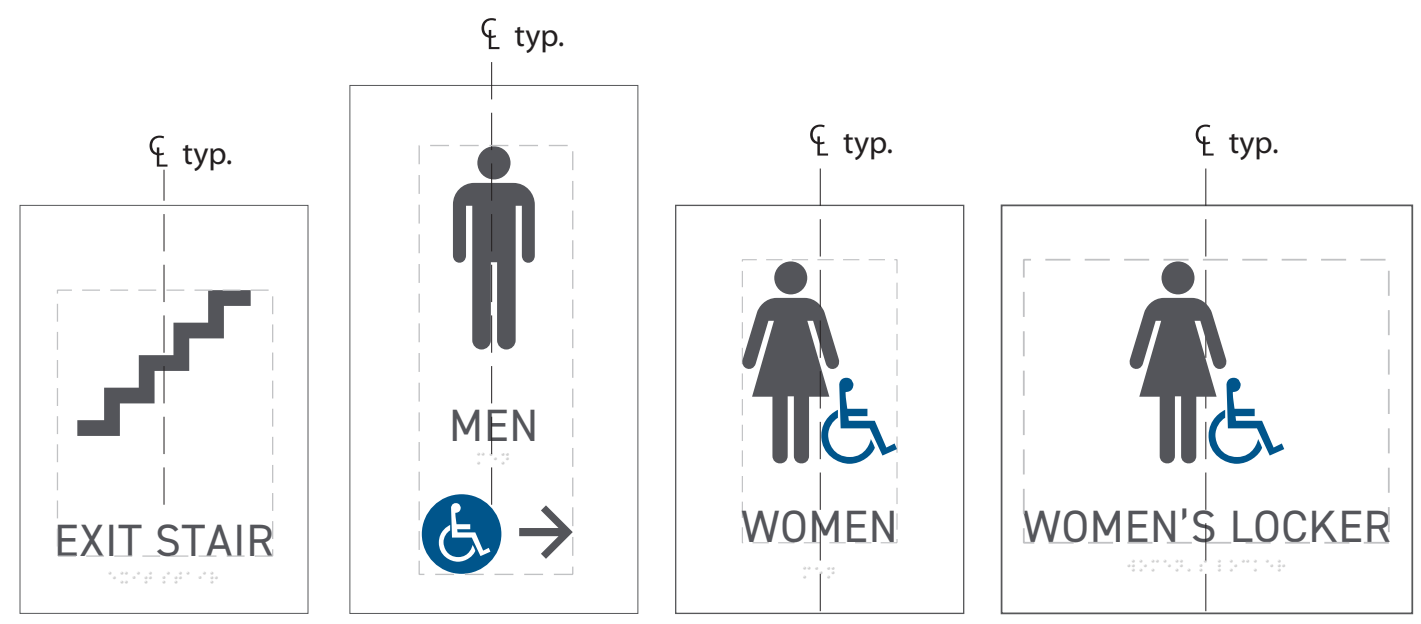


4 ST IF1_ Alternate Layouts
SG.14 Scale: 3"=1'

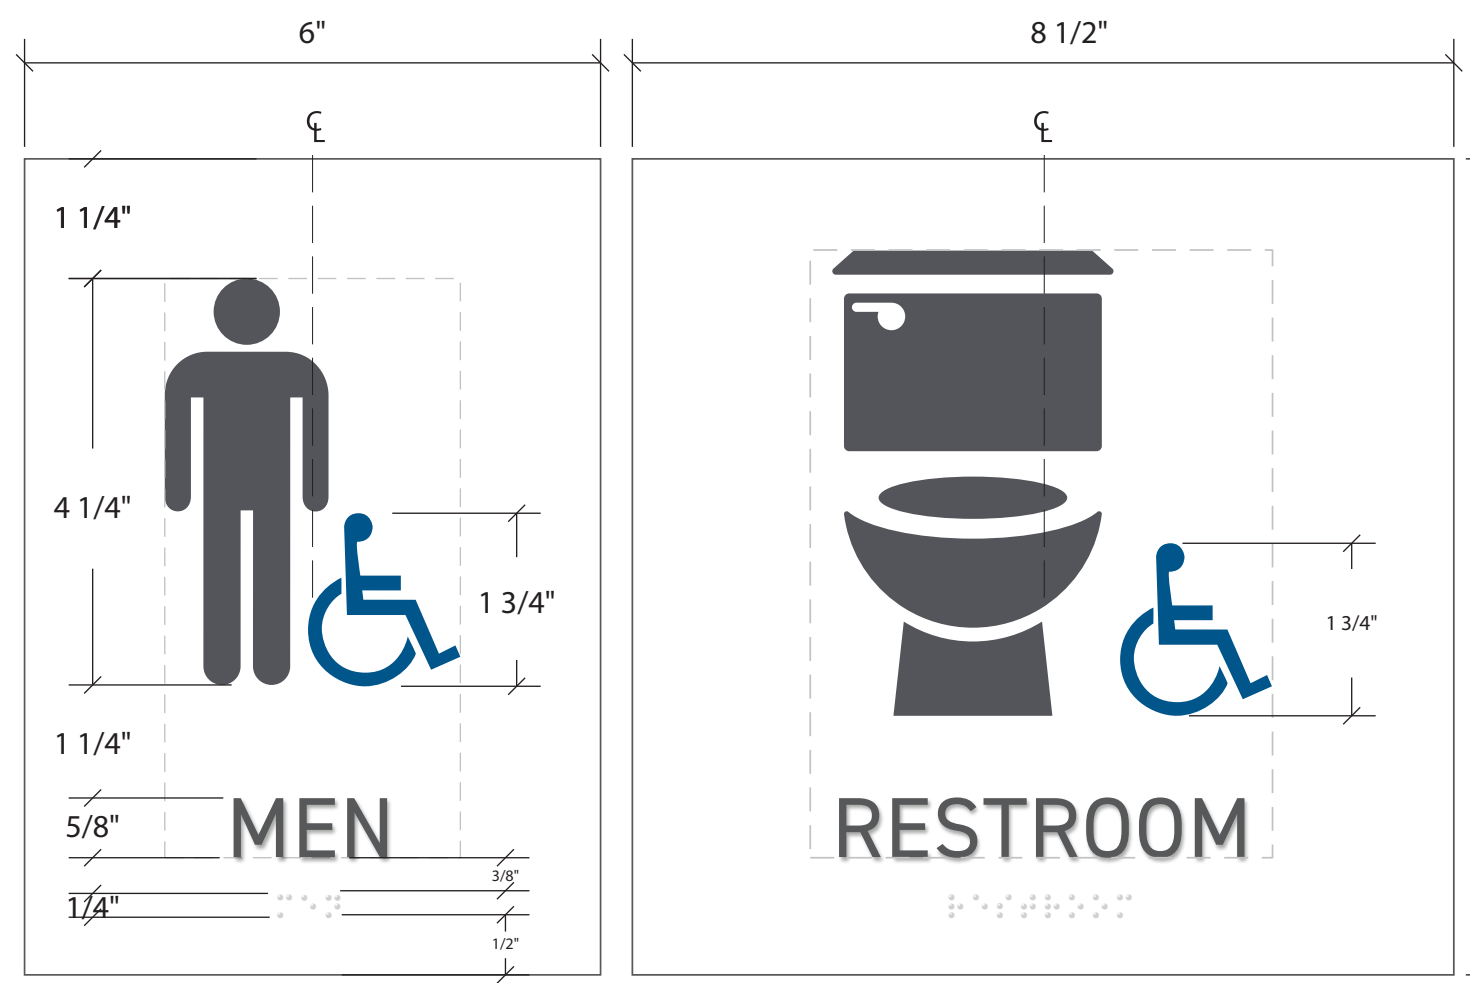

1 ST IF1_Front Elevation
SG.14 Scale: 1:2

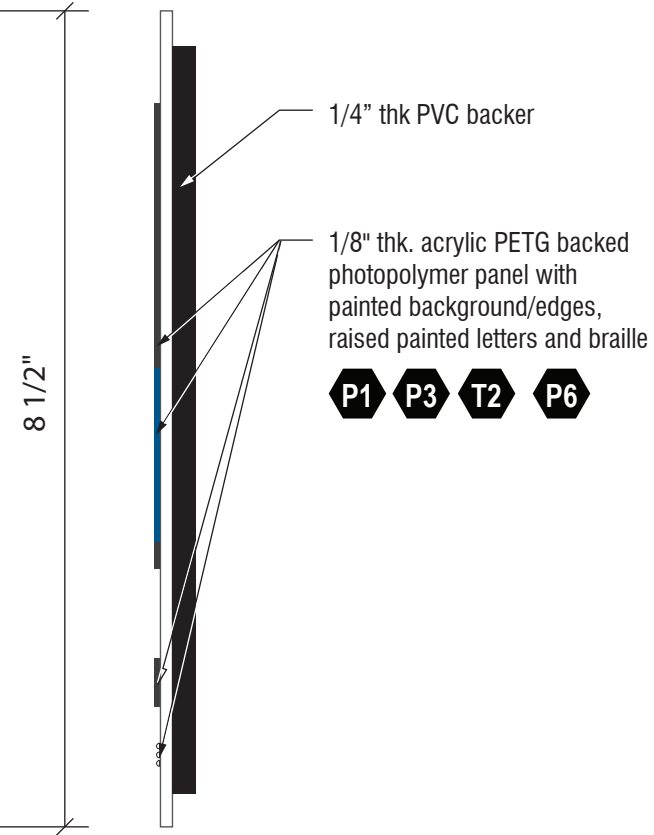


2 ST IF1_Side View
SG.14 Scale: 1:2

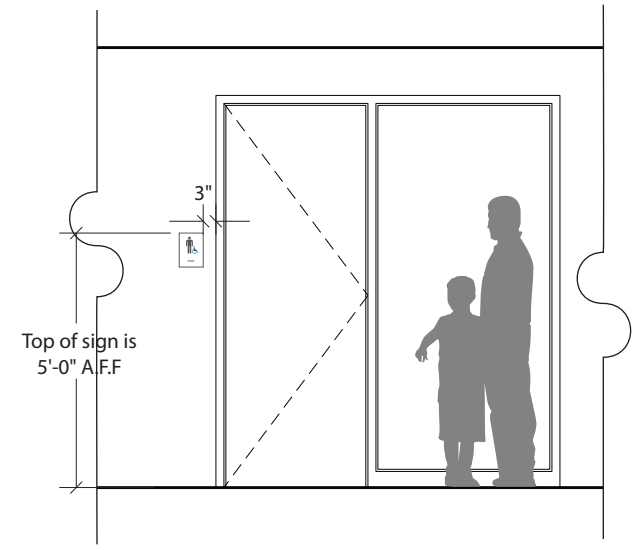

3 ST IF1_Location Elevation
SG.14 Scale: 1/4"=1'-0"




1 ST IF1_Front Elevation
SG.14.1 Scale: 1:2

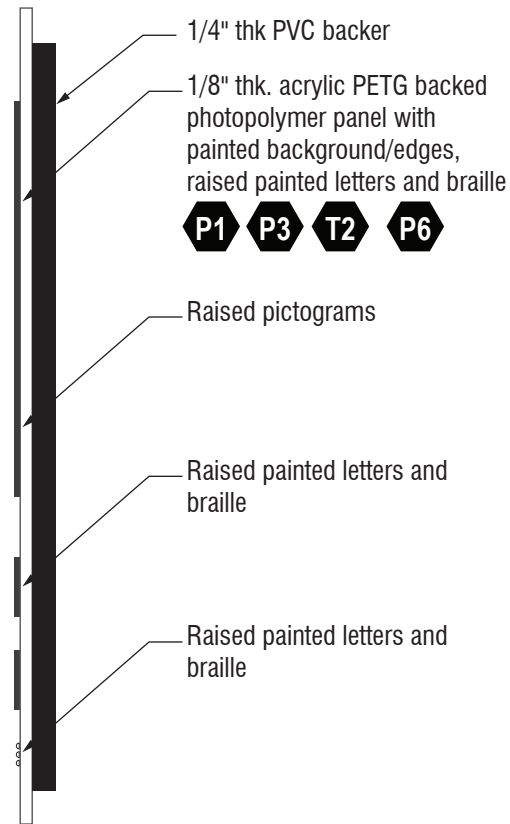

2 ST IF1_Side View
SG.14.1 Scale: 1:2



3 ST IF1_Alt Layout and added Paper Insert
SG.14.1 Scale: 1:2

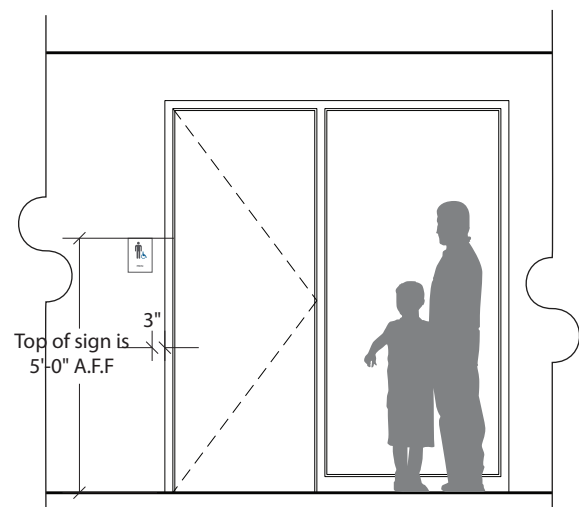

4 ST IF1_Location Elevation
SG.14.1 Scale: 1/4" = 1'-0"

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

IF1.1
ADA Plaque - Pictogram
with Insert

DRAWING SHEET

SG.14.1

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE

IF2
Flag Sign

DRAWING SHEET


SG.15

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJECTS\14AC24003\14AC24003_Design\14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021



4 Alternate layouts
SG.15 Scale: 3"=1'

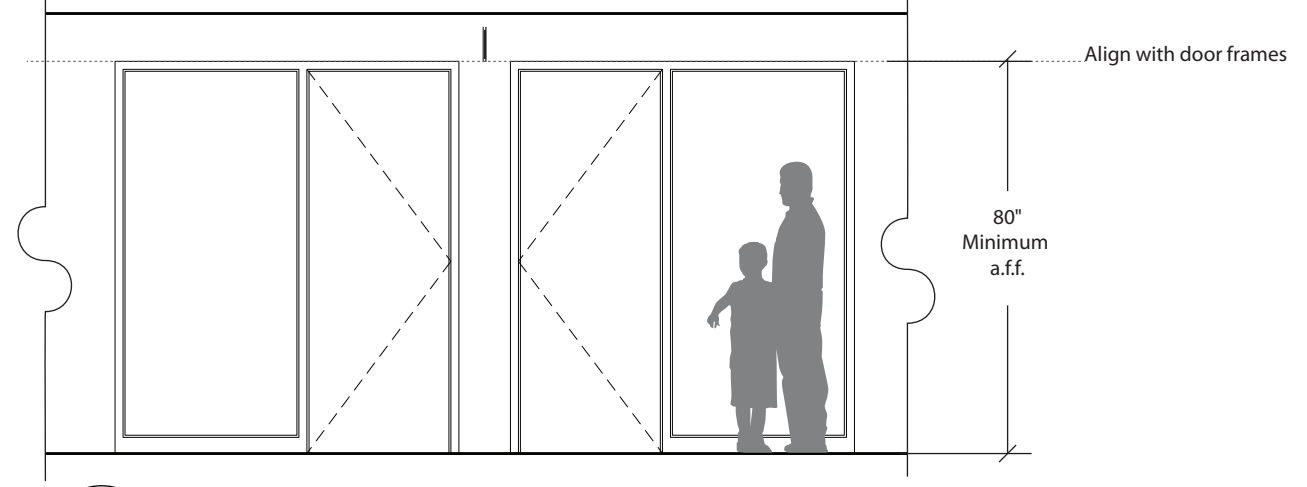


5 ST IF2_Location Elevation - Restrooms
SG.15 Scale: 1/4"=1'-0"

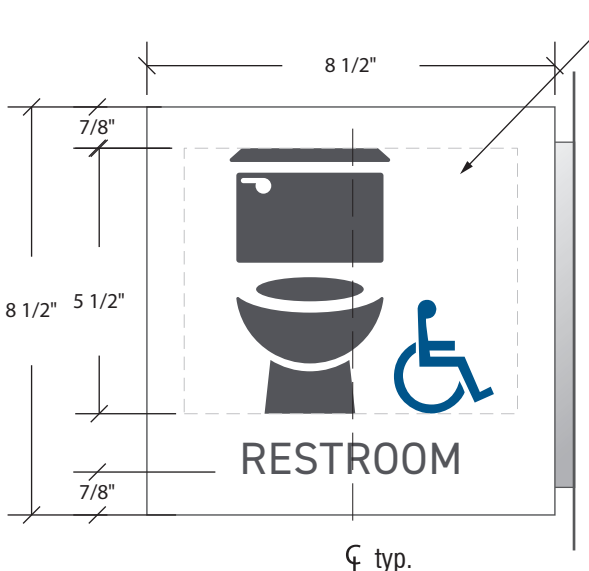


1 ST IF2_Front View
SG.15 Scale: 3"=1'

1/8" thk. painted acrylic with printed text and graphics on both sides. Apply top clear coat.
M3 C1 C3 T2

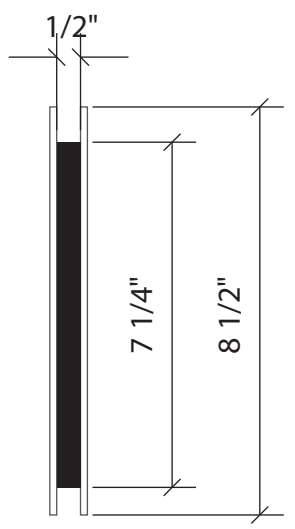

2 ST IF2_Side View
SG.15 Scale: 3"=1'

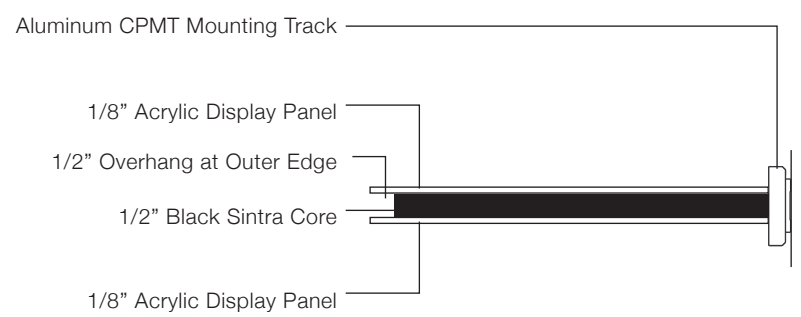

3 ST IF2 - Flag Sign_Top View
SG.15 Scale: 3"=1'

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IG
Stairwell Sign

DRAWING SHEET

SG.16


Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL\140024003\14AC24003_Design\14_Graphics_Branding
W_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

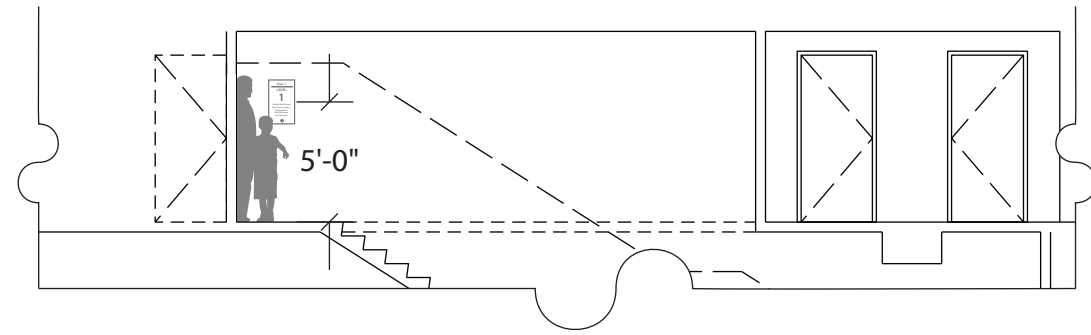


*If Building is 75ft high or higher from lowest level vehicle access, then sign needs to be photo luminescent material

3 ST IG_Location Elevation
SG.16 Scale: 1/8" = 1'-0"

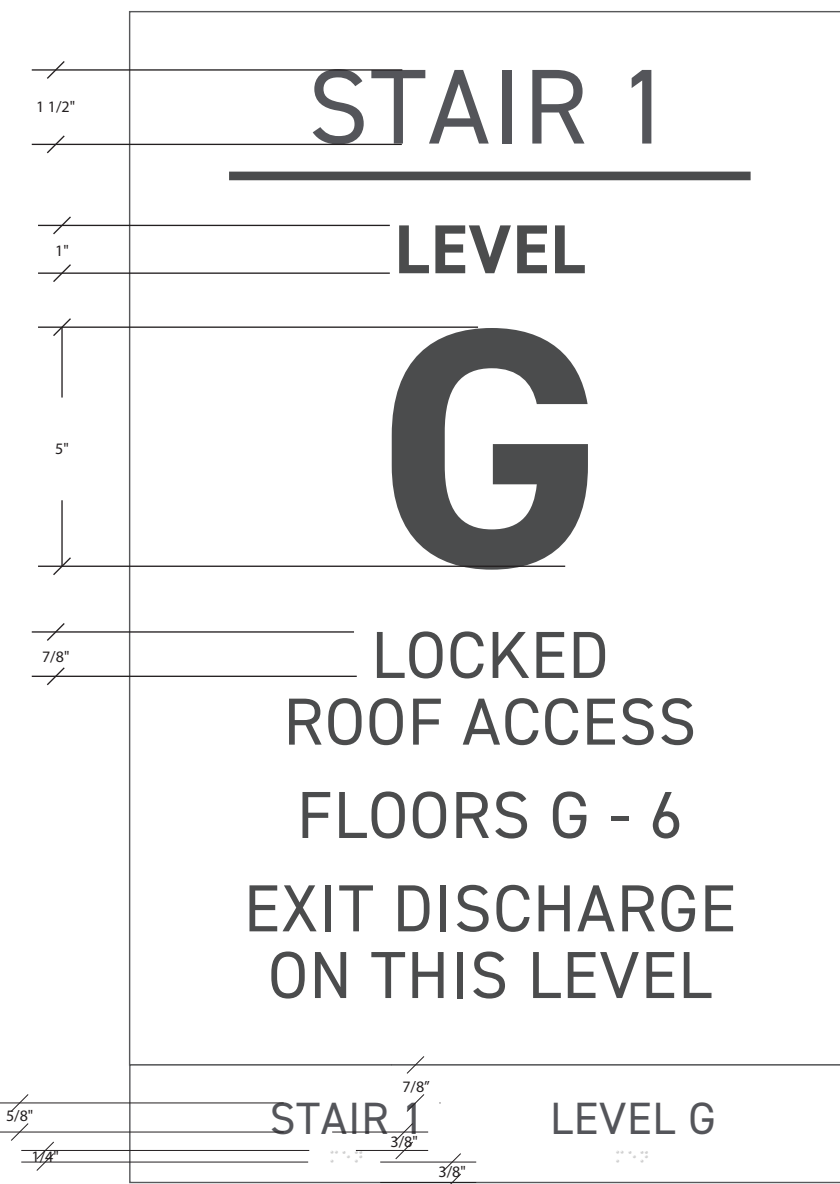

1 ST IG_Front View
SG.16 Scale: 3" = 1'-0"

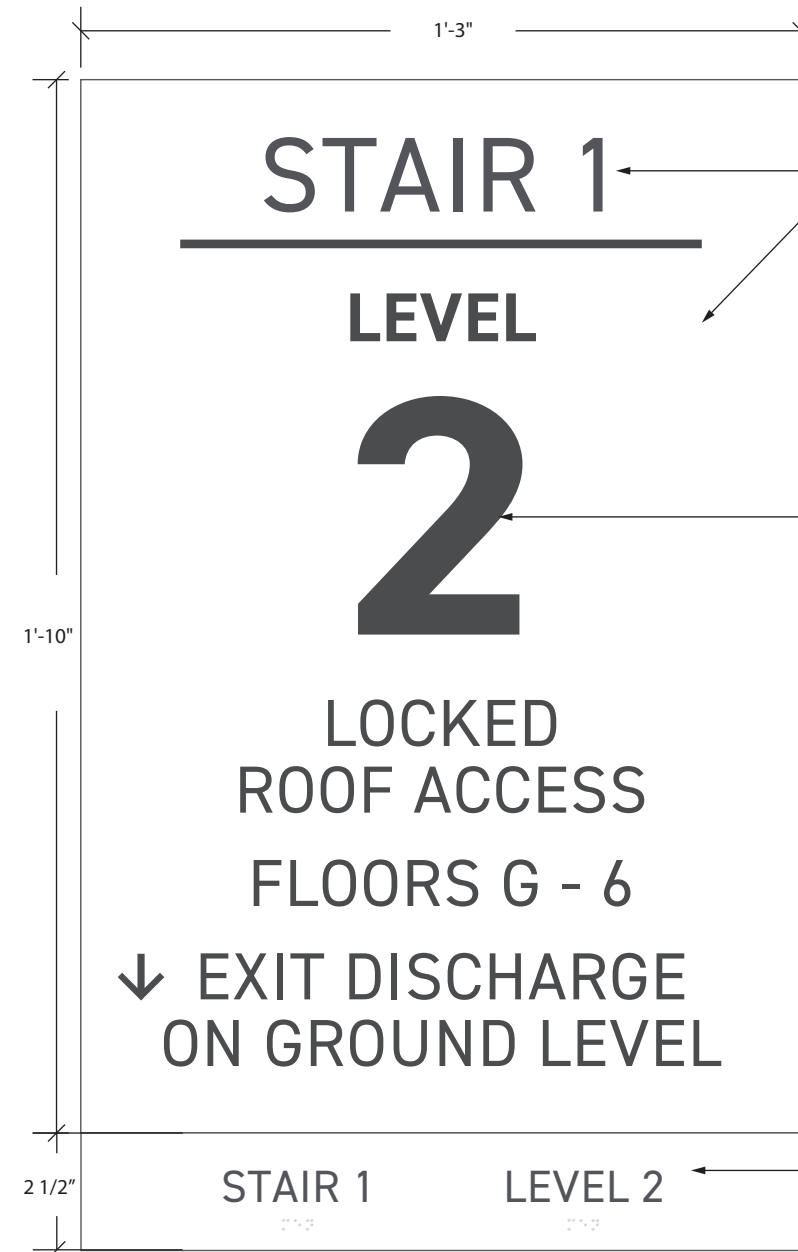

1/8" thk. painted acrylic panel and edges with printed text and graphics. Apply clear top coat.


M3 P1 T2

T1

1/8" thk. painted acrylic photopolymer panel with raised text and braille

M3 P1 T2 P6

2 ST IG_Side View
SG.16 Scale: 3" = 1'-0"



PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


II
Elevator Warning - In Case of Fire

DRAWING SHEET


SG.17

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

File Path:
Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
H_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

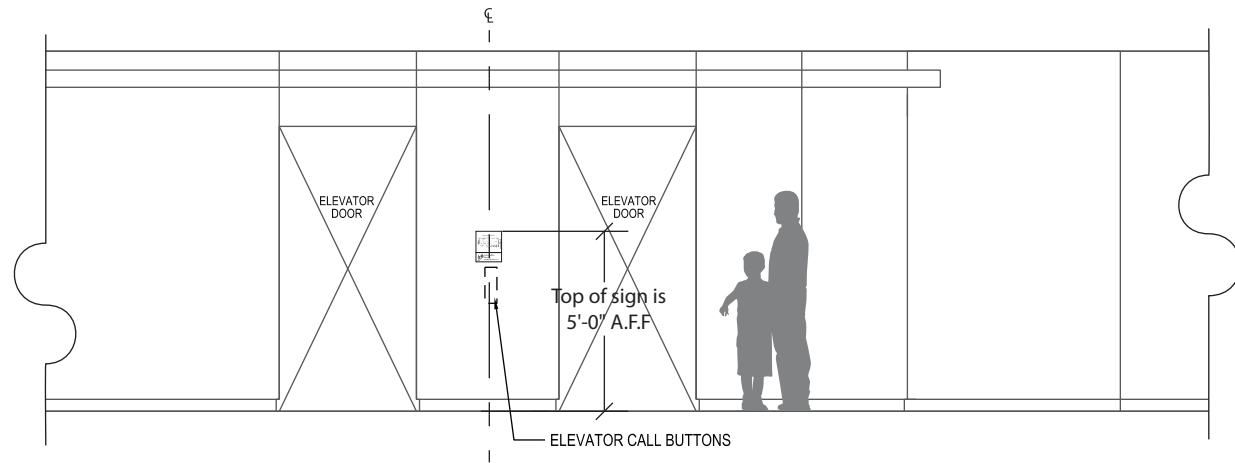

3 ST II_Location Elevation
SG.17 Scale: NTS

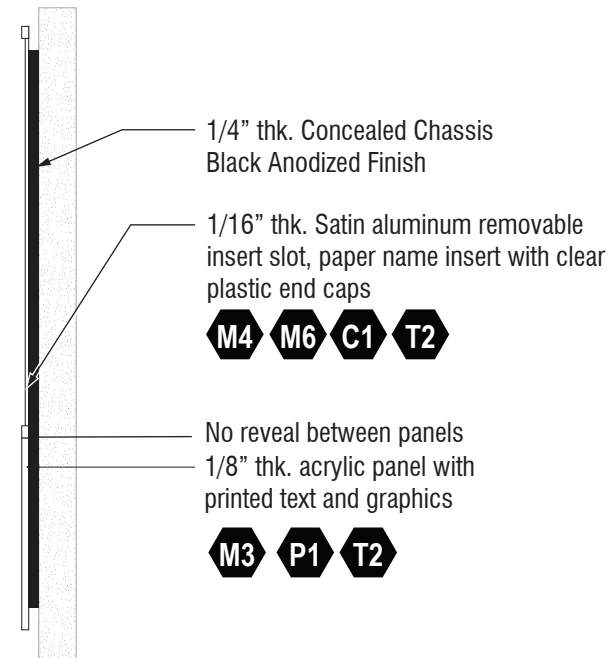

2 ST II_Side View
SG.17 Scale: 3"=1'

1 ST II_Front View
SG.17 Scale: 3"=1'

Note:
Evacuation map to be provided from specific building.

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IK
Warning Sign_SM

DRAWING SHEET


SG.18

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

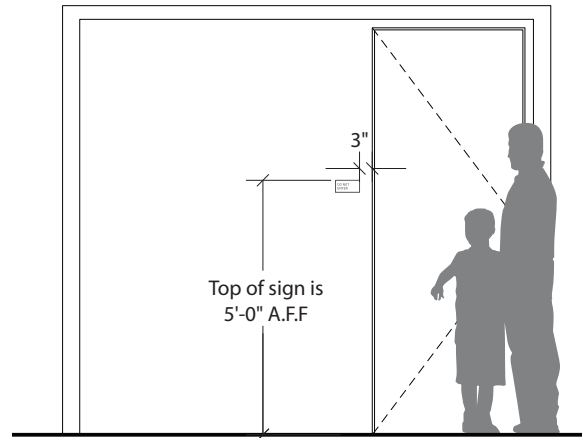


4 ST IK_Location Elevation
SG.18 Scale: 1/4" = 1'

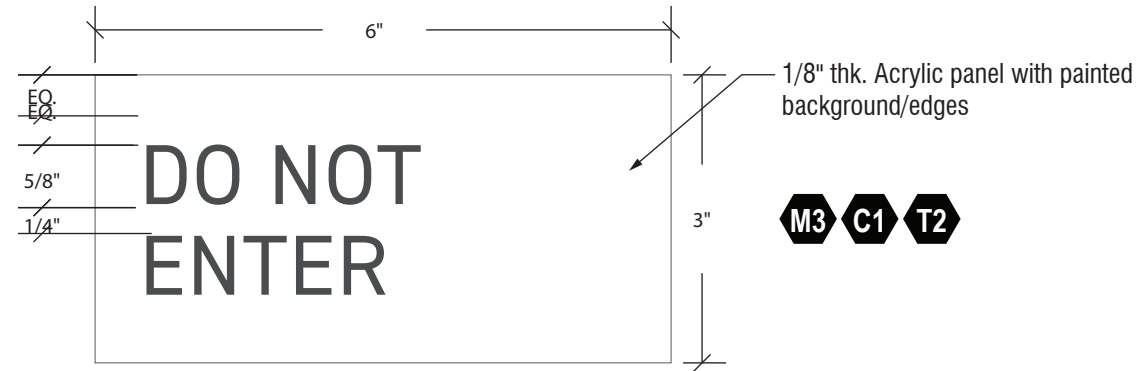

3 ST IK_Front Elevation_Alt Material
SG.18 Scale: 1:2

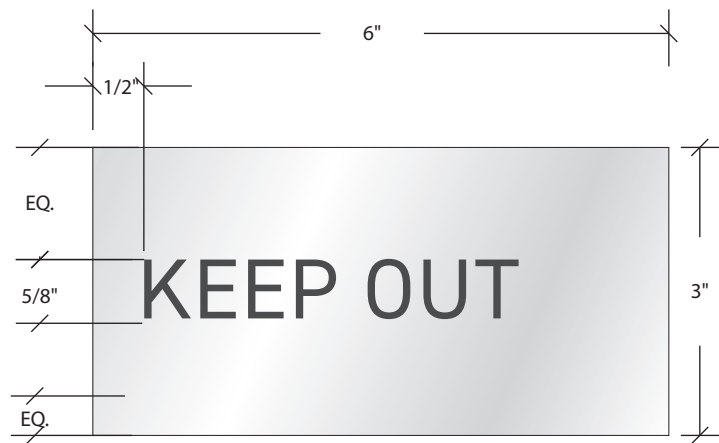

1 ST IK_Front Elevation
SG.18 Scale: 1:2

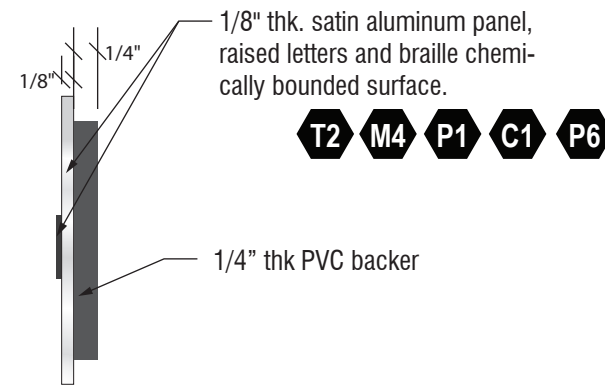

2 ST IK_Side View
SG.18 Scale: 1:2

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description


1 Updated XM.1, XM.2 and XM.3

TITLE
IK1
 Warning Sign_MD


DRAWING SHEET
SG.18.1

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB


File Path:
 Y:\PROJ\ATL14\X24\XXX14AC24003_Design14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

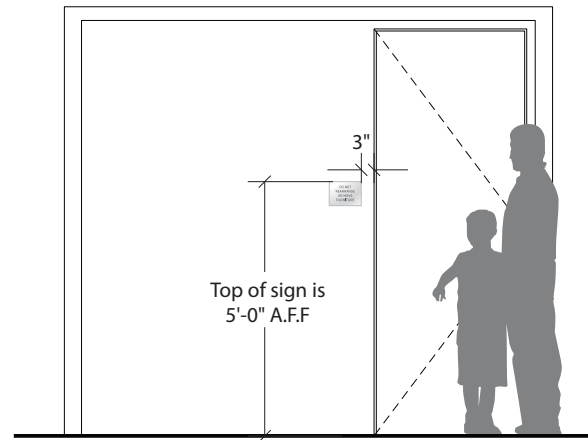


4 ST IK1_Location Elevation
 SG.18.1 Scale: 1/4"=1'-0"

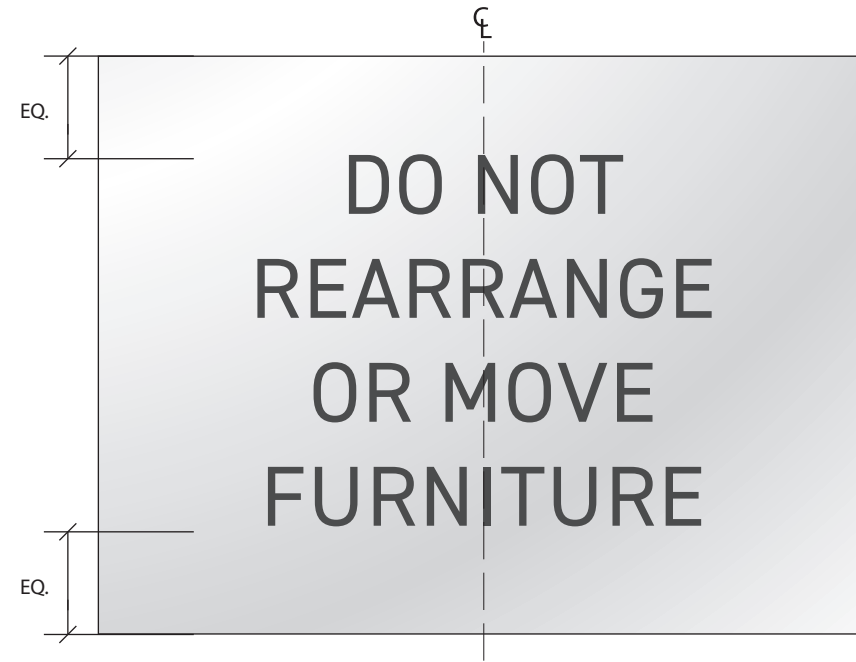

3 ST IK1_Additional Layouts
 SG.18.1 Scale: 1:2

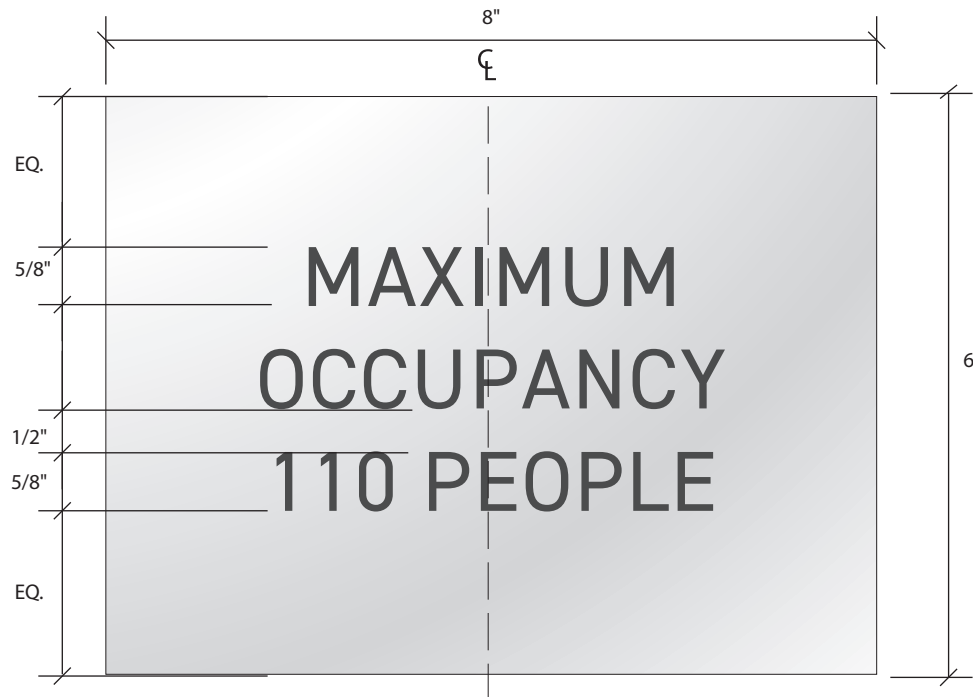

1 ST IK1_Front Elevation
 SG.18.1 Scale: 1:2

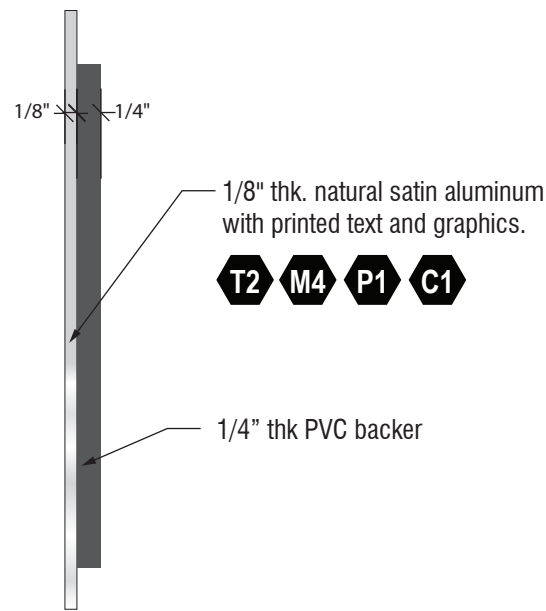

2 ST IK1_Side View
 SG.18.1 Scale: 1:2

PROJECT DATA

Project Number:
 14AC24003

Project Name:

Georgia Institute of Technology
 North Ave NW,
 Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IK2
Warning Sign_LG

DRAWING SHEET


SG.18.2

Principal-In-Charge:
 David Deis
 Project Manager:
 CB/PN
 EGD Designers:
 CB
 Drawn by:
 CB


File Path:
 Y:\PROJ\ATL\14XX24XXX\14AC24003_Design\14_Graphics_Branding
 V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

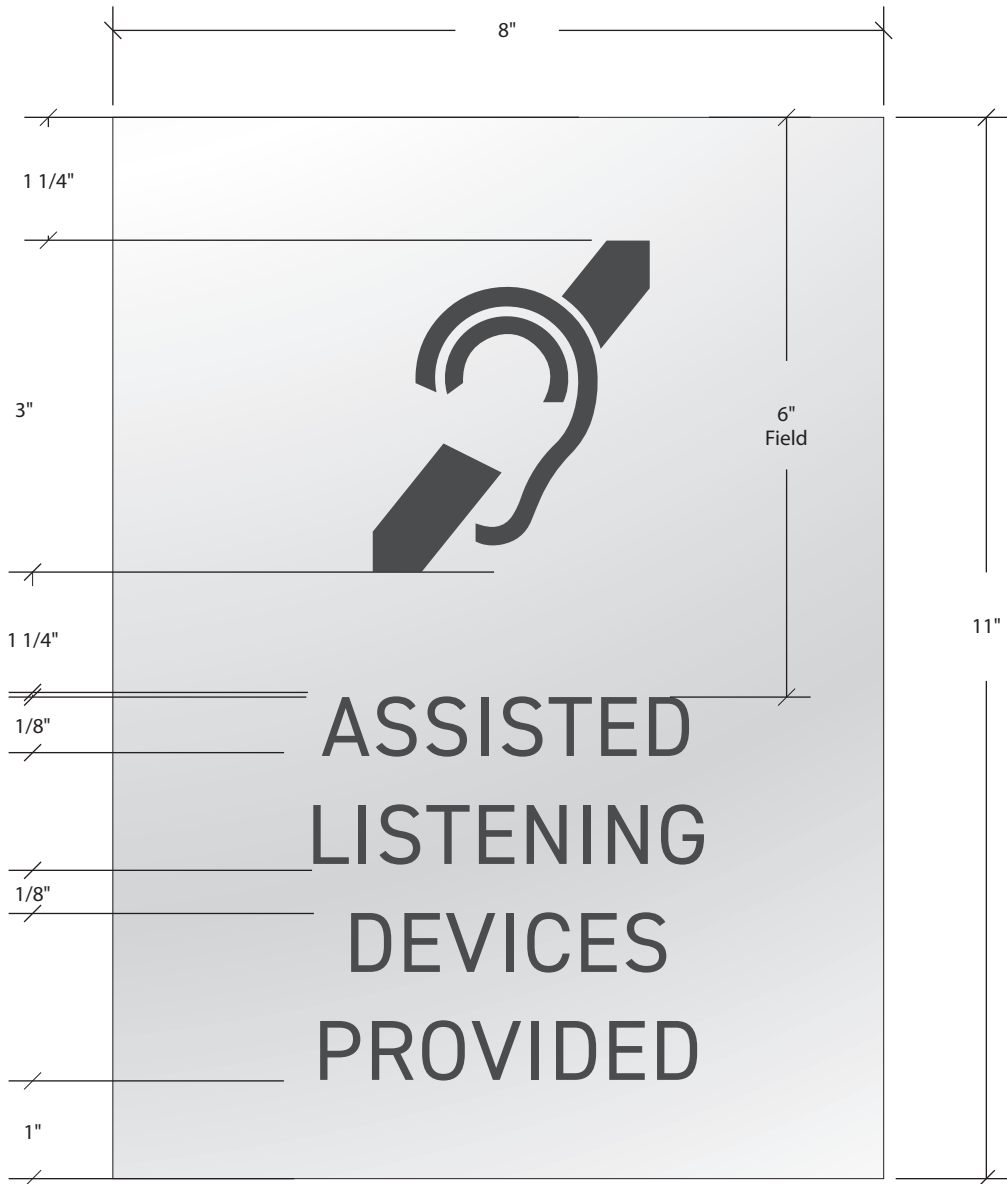

1 ST IK2_Front Elevation
 SG.18.2 Scale: 1:2

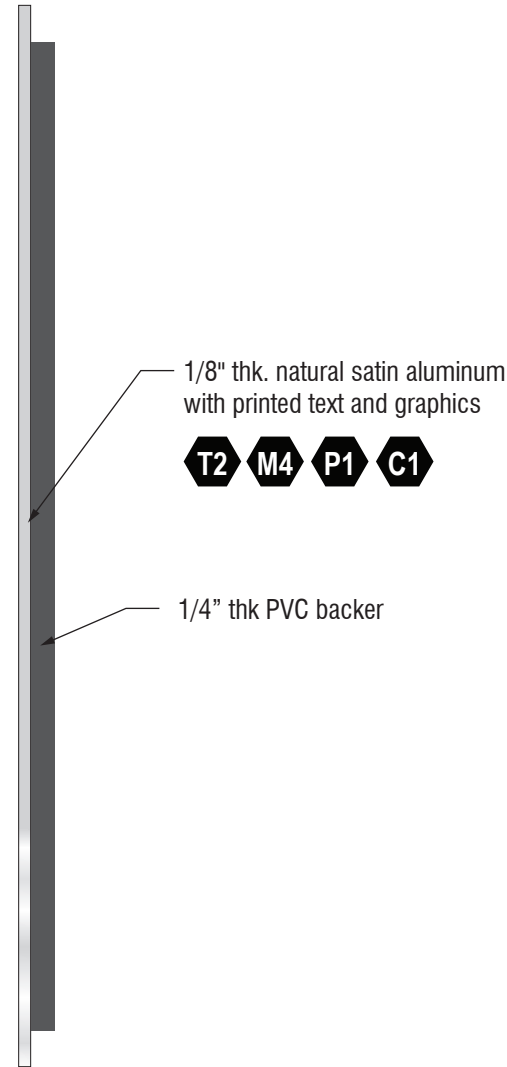

2 ST IK2_Side View
 SG.18.2 Scale: 1:2

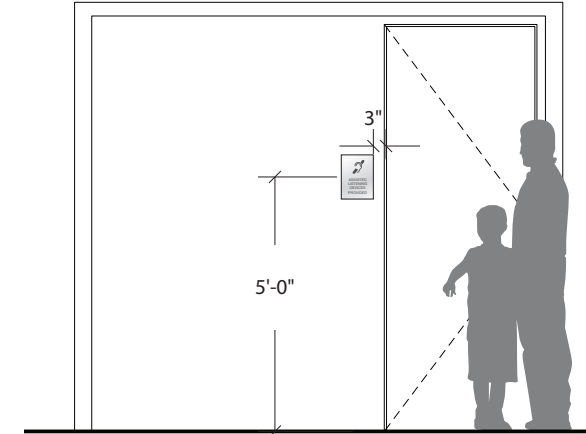

3 ST IK2_Location Elevation
 SG.18.2 Scale: 1/4" = 1'

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IH
Lab Safety Warning

DRAWING SHEET


SG.19

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL14\XG24\XG14AC24003_Design14_Graphics_Branding
V_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

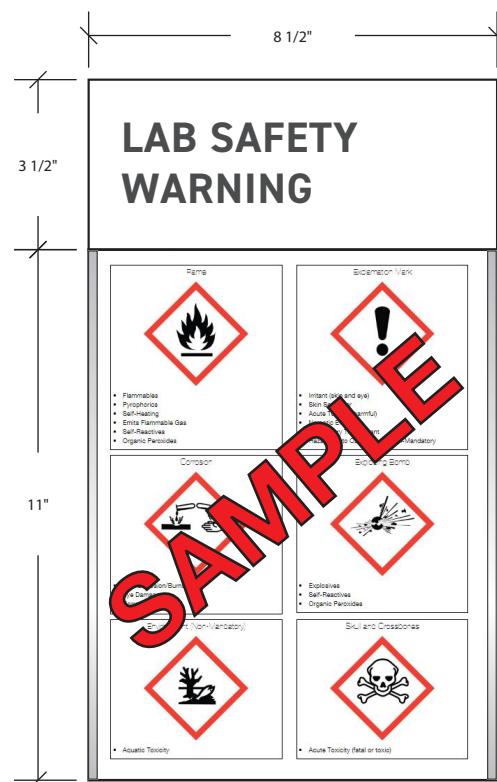


3 Alt layout - 1 Insert Window
SG.19 Scale: NTS

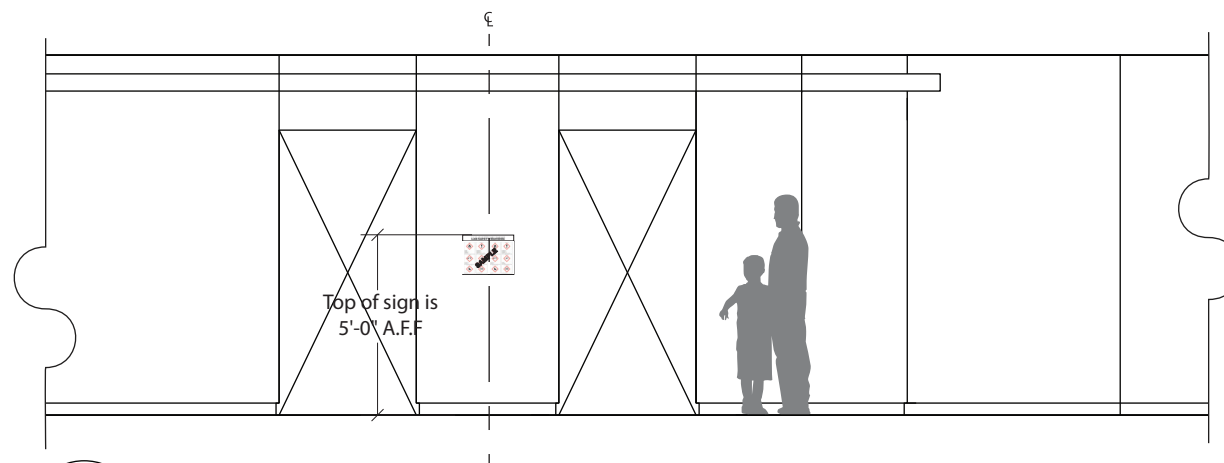

4 ST IH - Location Elevation
SG.19 Scale: 3/16" = 1'-0"

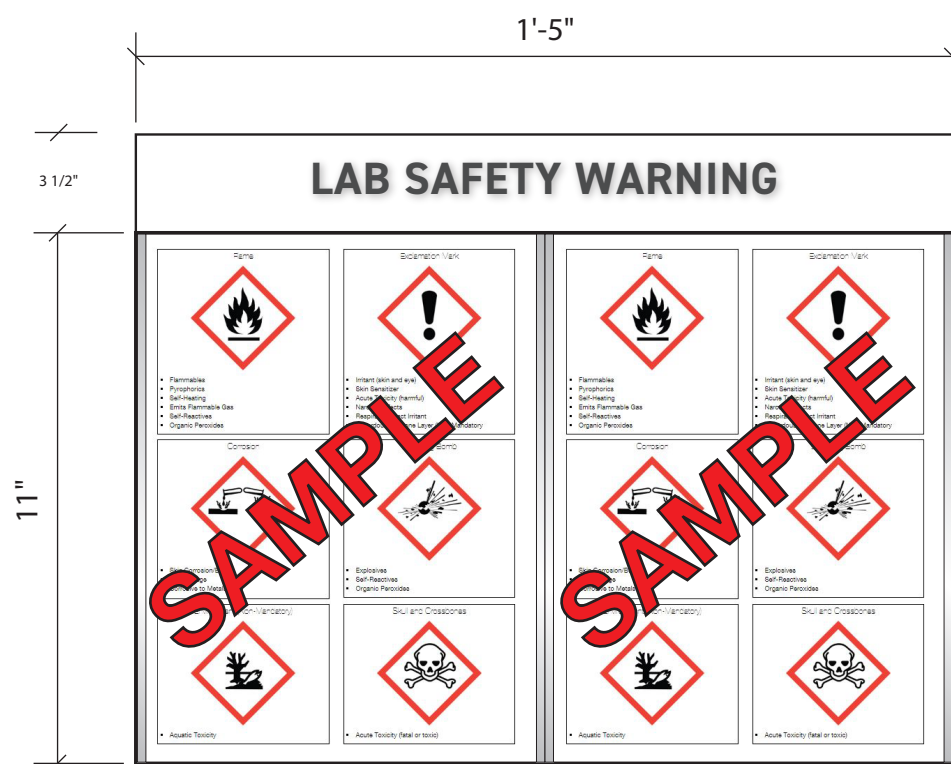

1 ST IH - 2 Insert Windows - Front View
SG.19 Scale: 3" = 1'

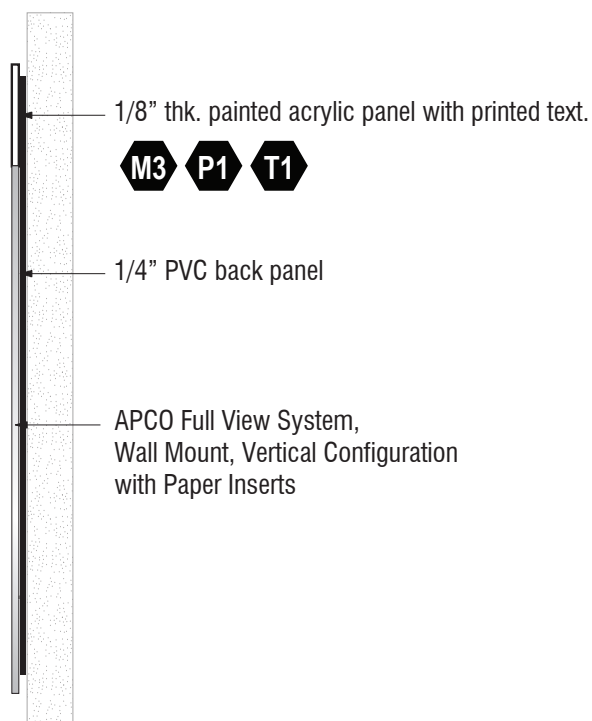

2 ST IH - Side View
SG.19 Scale: 3" = 1'

5 ST IH - Cleanroom
SG.19 Scale: TBD

TBD

Note:
Warning paper insert to be provided from specific building.

PROJECT DATA

Project Number:
14AC24003


Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description


1 Updated XM.1, XM.2 and XM.3

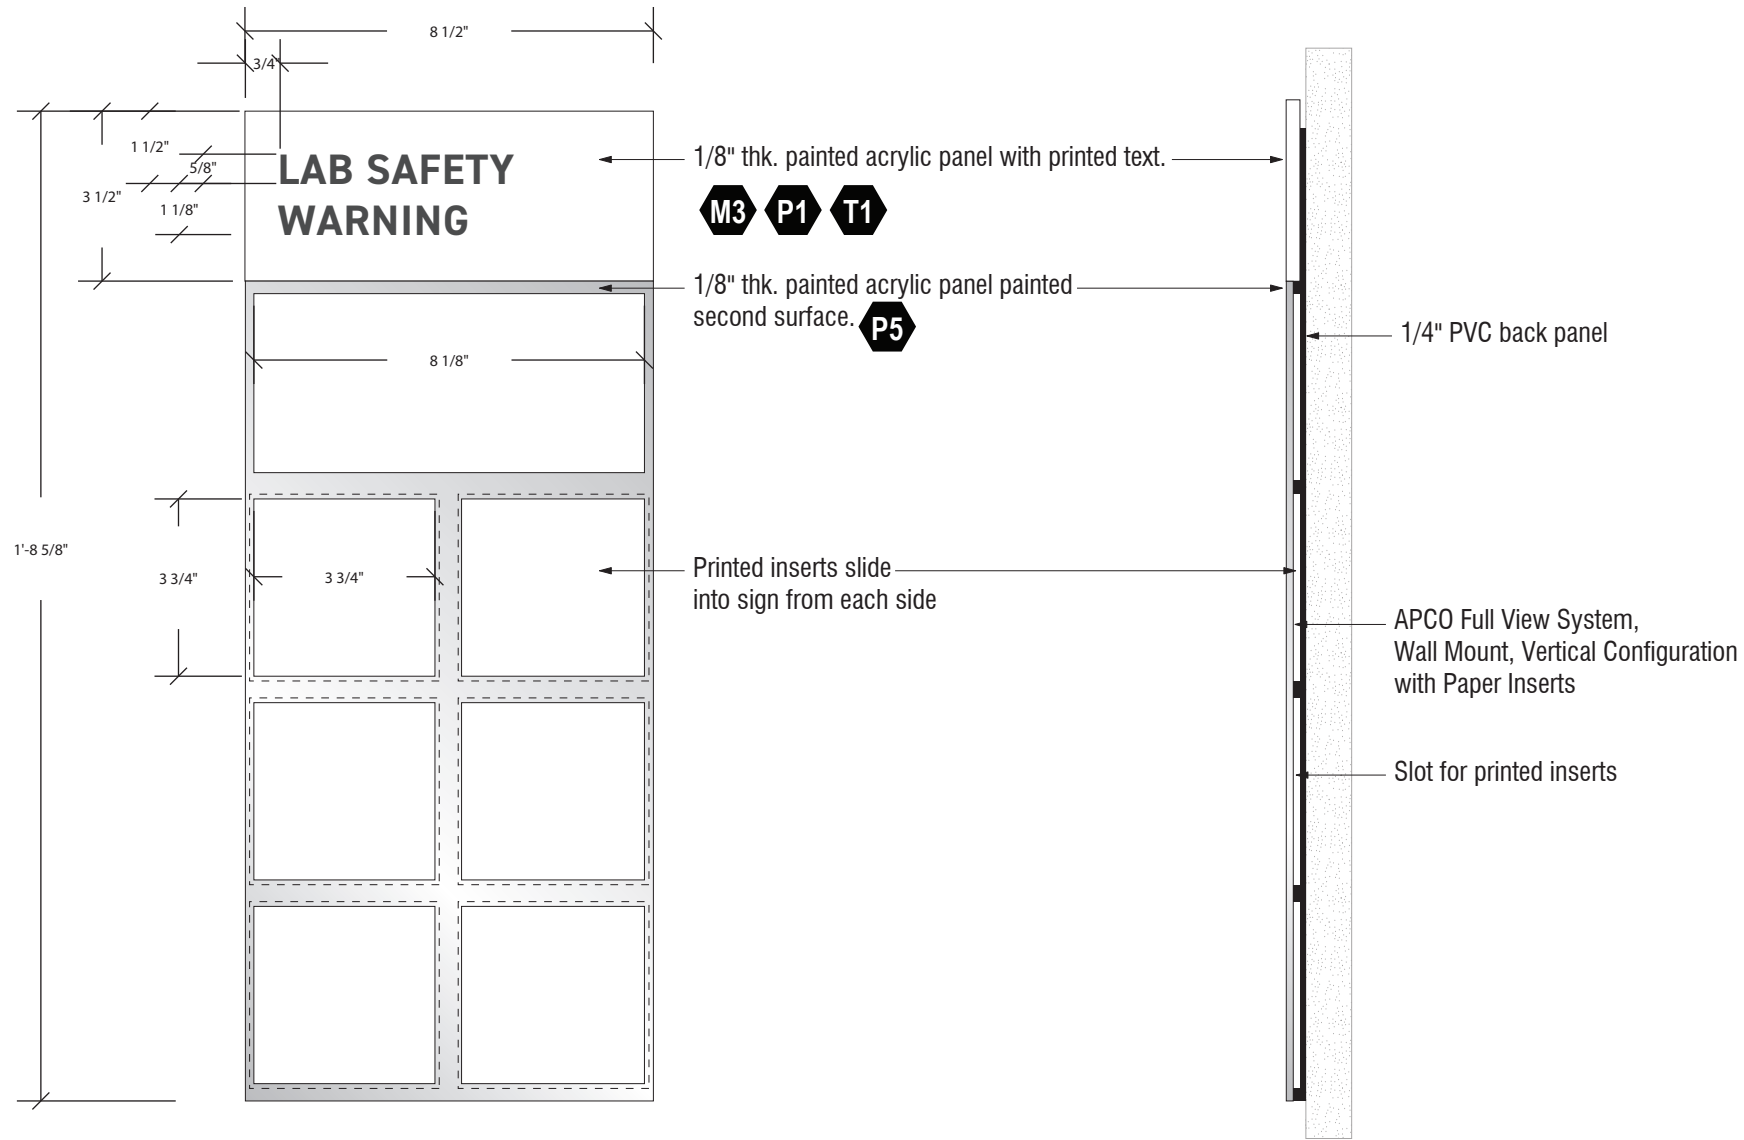

1 ST IH2 - Elevation
SG.19.1 Scale: 3"=1'

2 ST IH2 - Side View
SG.19.1 Scale: 3"=1'

Note: Warning paper insert to be provided from specific building.

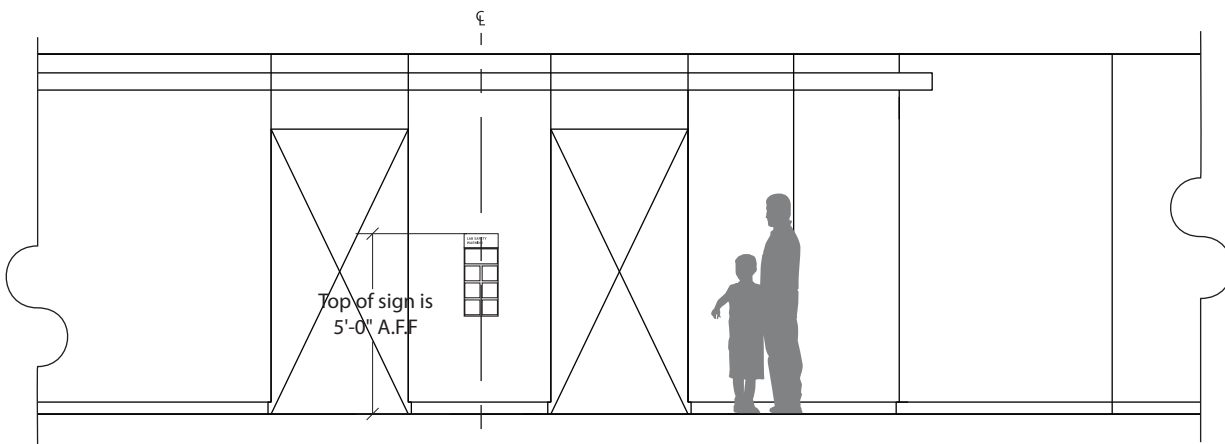

3 ST IH2 - Location Elevation
SG.19.1 Scale: 3/16" = 1'-0"

TITLE

IH.2
EHS Lab Safety Warning

DRAWING SHEET

SG.19.1

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB

PROJECT DATA

Project Number:
14AC24003

Project Name:

Georgia Institute of Technology
North Ave NW,
Atlanta, GA 30332

Date: 07/26/2024

Rev. No. Description

1 Updated XM.1, XM.2 and XM.3

TITLE


IH.3
Room Schedule

DRAWING SHEET

SG.19.2

Principal-In-Charge:
David Deis
Project Manager:
CB/PN
EGD Designers:
CB
Drawn by:
CB


File Path:
Y:\PROJ\ATL\140024XXX\14AC24003_Design\14_Graphics_Branding
H_Signage Updates\Campus Wayfinding Standards - Update Dec. 2021

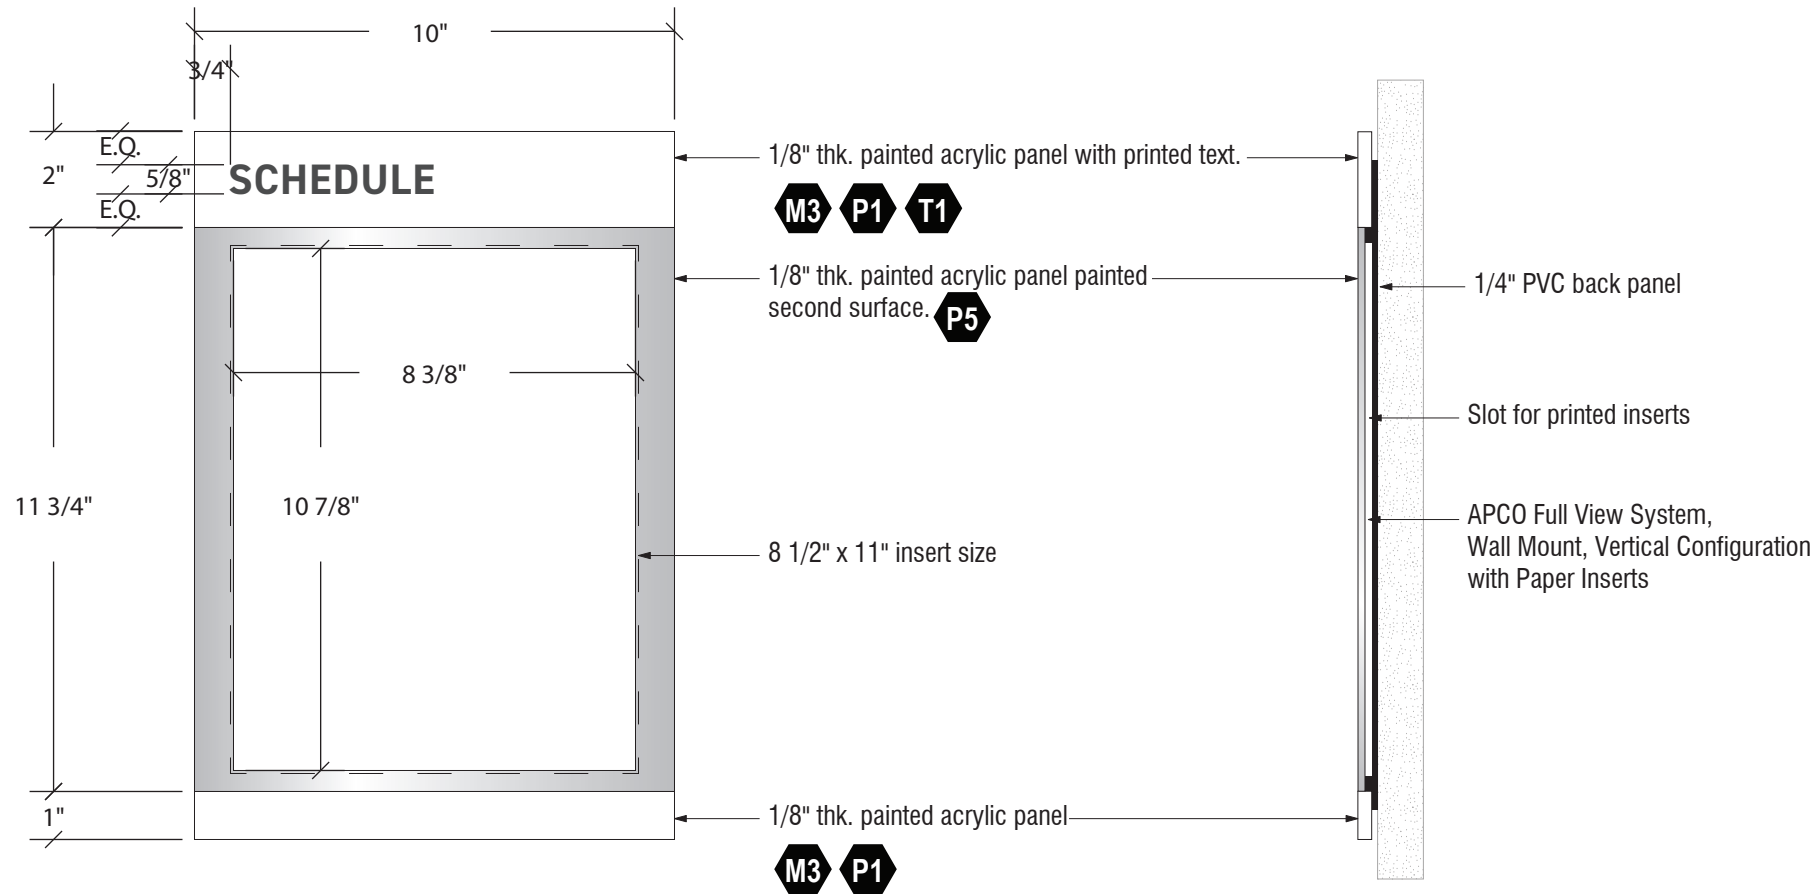


1 ST IH3 - Elevation
SG.19.2 Scale: 3"=1'

2 ST IH3 - Side View
SG.19.2 Scale: 3"=1'

Note: Warning paper insert to be provided from specific building.

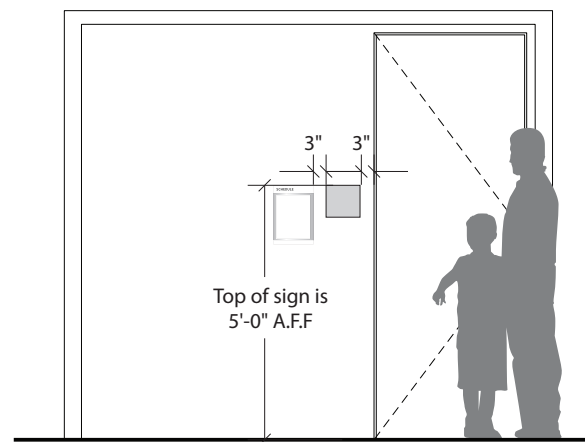

3 ST IH3 - Location Elevation w/Adjancet Room Sign
SG.19.2 Scale: 3/16" = 1'-0"

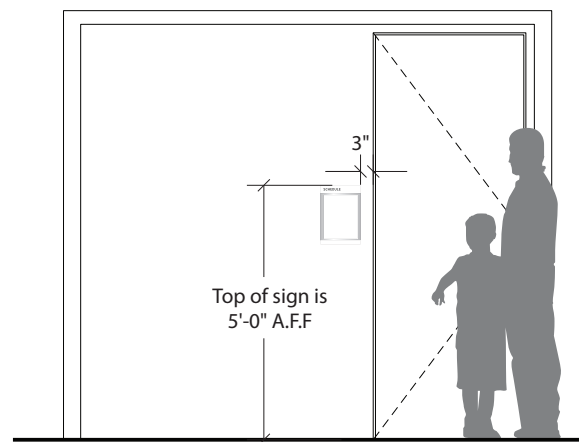

4 ST IH3 - Location Elevation
SG.19.2 Scale: 3/16" = 1'-0"